
CORROSION CONTAMINANTS COOLANT CONDITION

NORMAL NORMAL NORMAL

Machine Id

GEN #2 - TJ036201 Component Coolant

HYBRID (HOAT) COOLANT (GAL)					.,		
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
The fluid is suitable for further service. Resample at the next service interval to monitor.	Sample Number		Client Info		WC0408650		
	Sample Date		Client Info		25 May 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Oil Changed		Client Info		Changed		
	Sample Status				NORMAL		
CORROSION	Iron	ppm	ASTM D5185(m)	>15	3		
All metal levels are normal indicating no corrosion in the cooling system.	Aluminum	ppm	ASTM D5185(m)		<1		
	Copper	ppm	ASTM D5185(m)		<1		
	Lead	ppm	ASTM D5185(m)		0		
	Tin	ppm	ASTM D5185(m)	>10	0		
	Silver	ppm	ASTM D5185(m)	>10	<1		
	Zinc	ppm	ASTM D5185(m)	>10	2		
CONTAMINANTS	Calcium	ppm	ASTM D5185(m)	>100	7		
There is no indication of any contamination in the coolant.	Magnesium	ppm	ASTM D5185(m)	>40	2		
	Appearance	scalar	Visual*	NORML	NORML		
	Odor	scalar	Visual*	NORML	NORML		
	Coolant Appearance		Visual*	Clear	Clear		
COOLANT CONDITION	Boiling Point	°C	WC Method*		107		
The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.	Specific Gravity		ASTM D1298*		1.066		
	pH	Scale 0-14	ASTM D1287*		7.97		
	Nitrites	ppm	Alcan Test Kit*		360		
	Reserve Alkalinity	Scale 0-20	ASTM D1121*		2.9		
	Percentage Glycol		ASTM D3321*		48.9		
	Freezing Point	°C	ASTM D3321*		-35		
	Carboxylate		10711051051				
	Silicon	ppm	ASTM D5185(m)		45		
	Phosphorus	ppm	ASTM D5185(m)		24		
	Boron	ppm	ASTM D5185(m)		170		
	Molybdenum Sodium	ppm	ASTM D5185(m)		90 1755		
	JuliuiII	ppm	ASTM D5185(m)		1100		
	Potassium	ppm	ASTM D5185(m)		1700		

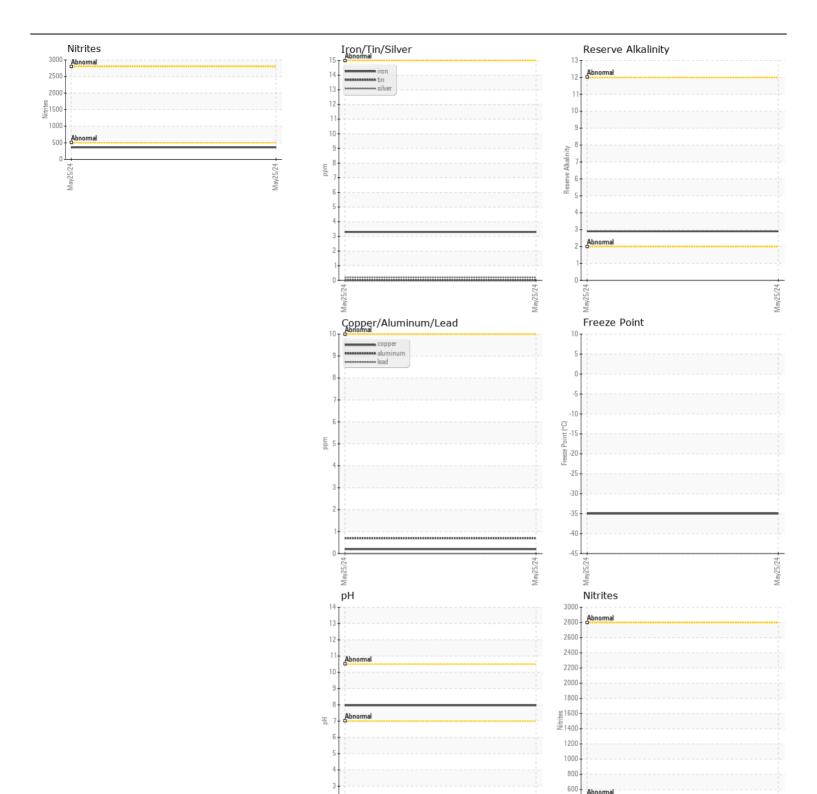



ISO 17025:2017 Accredited Laboratory

Laboratory: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9Sample No.: WC0408650Received: 31 May 2024

 25:2017
 Lab Number
 : 02639266
 Tested
 : 03 Jun 2024

 Idlied
 Unique Number
 : 5788428
 Diagnosed
 : 03 Jun 2024 - Kevin Marson

Test Package : COOL (Additional Tests: GlycolType)

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

GENREP LTD. 121 WATLINE AVENUE MISSISSAUGA, ON CA L4Z 1P2

> Contact: Amit Singh asingh@genrep.com T: (905)502-9950 F: (905)502-9960

400