



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
TG #3
 Component
Oil
 Fluid
IRVING D & E ISO 32 (--- GAL)

RECOMMENDATION

This is a baseline read-out on the submitted sample.

WEAR

{not applicable}



CONTAMINATION

{not applicable}

FLUID CONDITION

ASTM D2272 - Rotating Pressure Vessel Oxidation Test (RPVOT) = 486 minutes.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PP	PP	---
Sample Date		Client Info		30 May 2024	28 Jun 2017	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	N/A	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---
Water		WC Method		NEG	NEG	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Oxidation Test (RPVOT)	minutes	ASTM D2272*	663	486	504	---

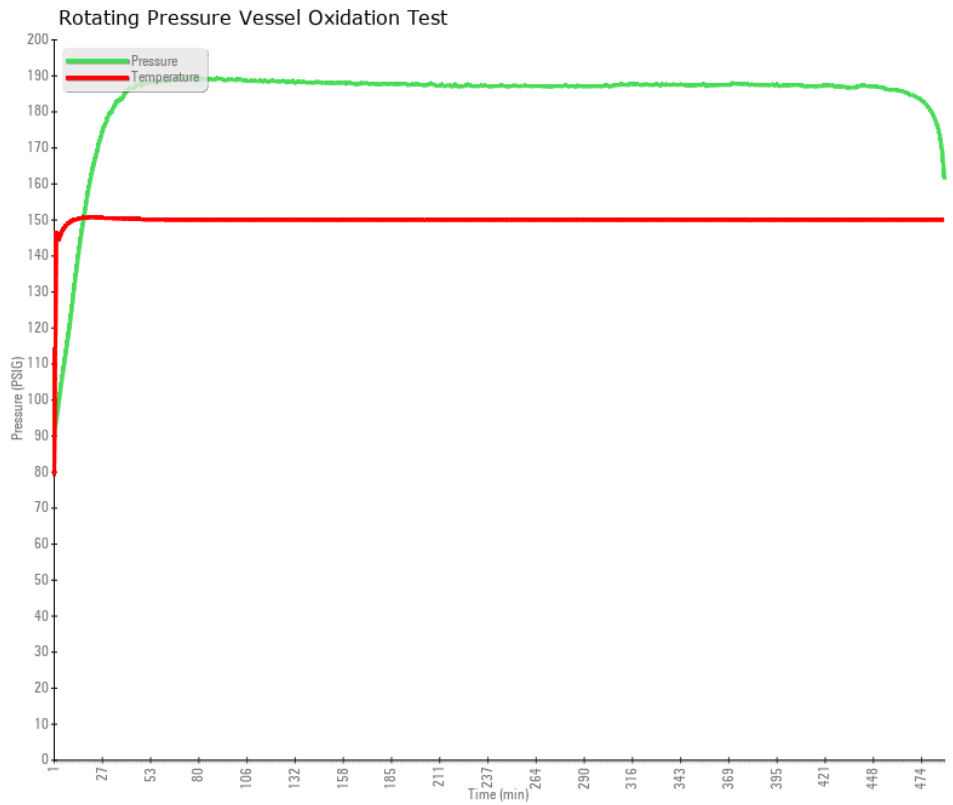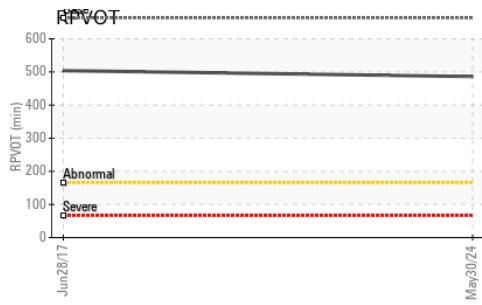

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP
Lab Number : 02639287
Unique Number : 5788449
Test Package : TEST (Additional Tests: RPVOT)

IRVING BLENDING & PACKAGING
 P.O.BOX 1169, 555 COURTENAY CAUSEWAY
 Saint John, NB
 CA E2L 4E6

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Blaine Sherwood
 Blaine.Sherwood@irvingoil.com
 T: (506)202-7730
 F: (506)632-7001