


## UNASSIGNED Machine Id T001395 (S/N 24-M-04-2584)

## Hydraulic System

## PETRO CANADA HYDREX XV ALL SEASON HYDRAULIC OIL (--- GAL)

PETRO CANADA HYDREX XV ALL SEASON H	I DRAULIC		GAL)				
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		WC0937615		
We recommend you service the filters on this component. Resample at the next service interval to monitor.	Sample Date		Client Info		23 May 2024		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				ATTENTION		
WEAR	Iron			. 20	.4		
WEAR	Iron	ppm	ASTM D5185(m)		<1		
All component wear rates are normal.	Chromium	ppm	ASTM D5185(m)		0		
	Nickel	ppm	ASTM D5185(m)	>20	0		
	Titanium	ppm	ASTM D5185(m)		0		
	Silver	ppm	ASTM D5185(m)	00	0		
	Aluminum	ppm	ASTM D5185(m)		0		
	Lead	ppm	ASTM D5185(m)		0		
	Copper	ppm	ASTM D5185(m)		<1		
	Tin	ppm	ASTM D5185(m)	>20	0		
	Vanadium	ppm	ASTM D5185(m)	NONE	0		
	White Metal	scalar	Visual*	NONE	NONE		
	Yellow Metal	scalar	Visual*	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>15	<1		
CONTAMINATION	Potassium	ppm	ASTM D5185(m)		<1		
There is a light amount of silt (particulates < 14 microns in size) present in the oil.	Water	ppiii	WC Method		NEG		
	Particles >4µm		ASTM D7647		7575		
	Particles >6µm		ASTM D7647		2193		
	Particles >14µm		ASTM D7647		135		
	Particles >21µm		ASTM D7647		33		
	Particles >38µm		ASTM D7647		3		
	Particles >71µm		ASTM D7647		2		
	Oil Cleanliness		ISO 4406 (c)				
	Silt	scalar	Visual*	NONE	NONE		
	Debris	scalar		NONE	NONE		
	Sand/Dirt	scalar	Visual*	NONE	NONE		
	Appearance		Visual*	NORML	NORML		
	Odor		Visual*	NORML	NORML		
	Emulsified Water			>0.05	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)		0		
The condition of the cillie generately for the time in some	Boron	ppm	ASTM D5185(m)		0		
The condition of the oil is acceptable for the time in service.	Barium	ppm	ASTM D5185(m)	0	0		
	Molybdenum	ppm	ASTM D5185(m)	0	0		
	Manganese	ppm	ASTM D5185(m)	1	0		
				0			
	Magnesium	ppm	ASTM D5185(m)	0	<1		
		ppm ppm	ASTM D5185(m) ASTM D5185(m)	0 100	<1 94		
	Magnesium		. ,	100			
	Magnesium Calcium	ppm	ASTM D5185(m)	100	94		
	Magnesium Calcium Phosphorus	ppm ppm	ASTM D5185(m) ASTM D5185(m)	100 670	94 591		

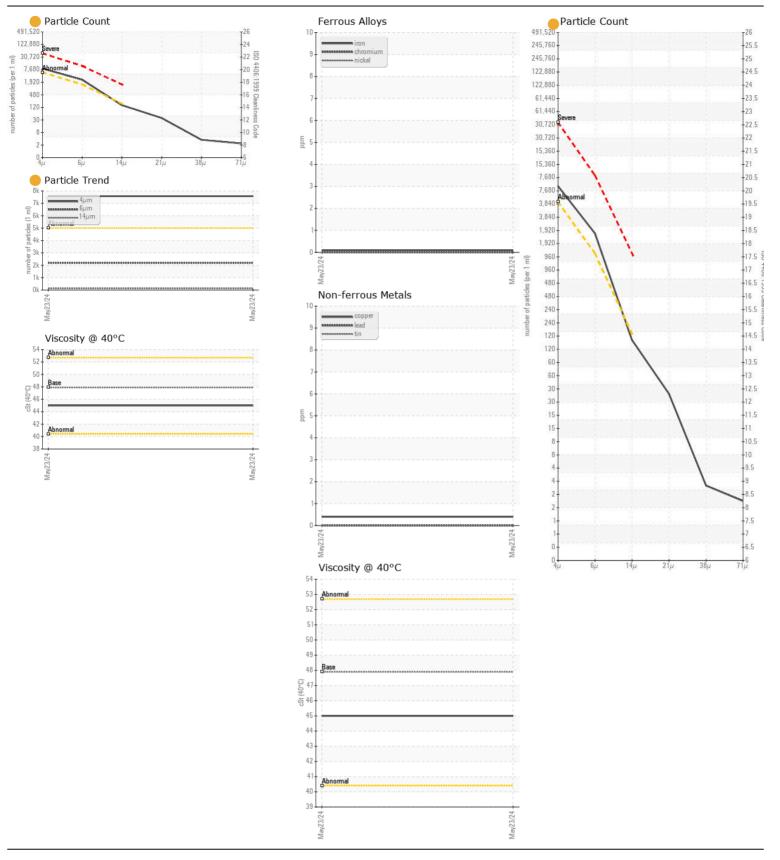

**RWF Industries** Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 CALA Sample No. Received : 04 Jun 2024 873 Devonshire Ave. : WC0937615 Lab Number : 02639664 Tested Woodstock, ON : 05 Jun 2024 ISO 17025:2017 Accredited Laboratory Diagnosed Unique Number : 5788826 : 05 Jun 2024 - Wes Davis CA N4S 8Z4 Test Package : MOB 2 Contact: Tami Arnold To discuss this sample report, contact Customer Service at 1-800-268-2131. tamia@rwfbron.com Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied. F: (519)421-0028

Contact/Location: Tami Arnold - RWFWOO Page 2 of 2

T: