



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

OIL ANALYSIS REPORT

|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Area

[266886]

Machine Id

PE4045L263960

Component

Diesel Engine

Fluid

PETRO CANADA 15W40 (--- GAL)

**RECOMMENDATION**

Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|----------|
| Sample Number  |     | Client Info |           | <b>WA0020844</b>   | WA0018091   | ---      |
| Sample Date    |     | Client Info |           | <b>27 May 2024</b> | 08 Aug 2022 | ---      |
| Machine Age    | hrs | Client Info |           | <b>134</b>         | 104         | ---      |
| Oil Age        | hrs | Client Info |           | <b>25</b>          | 30          | ---      |
| Filter Age     | hrs | Client Info |           | <b>25</b>          | 30          | ---      |
| Oil Changed    |     | Client Info |           | <b>Changed</b>     | Changed     | ---      |
| Filter Changed |     | Client Info |           | <b>Changed</b>     | Changed     | ---      |
| Sample Status  |     |             |           | <b>NORMAL</b>      | NORMAL      | ---      |

**WEAR**

Metal levels are typical for a new component breaking in.

|              |        |               |      |              |     |     |
|--------------|--------|---------------|------|--------------|-----|-----|
| Iron         | ppm    | ASTM D5185(m) | >51  | <b>3</b>     | 2   | --- |
| Chromium     | ppm    | ASTM D5185(m) | >11  | <b>0</b>     | 0   | --- |
| Nickel       | ppm    | ASTM D5185(m) | >5   | <b>0</b>     | 0   | --- |
| Titanium     | ppm    | ASTM D5185(m) |      | <b>0</b>     | 0   | --- |
| Silver       | ppm    | ASTM D5185(m) | >3   | <b>0</b>     | 0   | --- |
| Aluminum     | ppm    | ASTM D5185(m) | >31  | <b>&lt;1</b> | 1   | --- |
| Lead         | ppm    | ASTM D5185(m) | >26  | <b>0</b>     | <1  | --- |
| Copper       | ppm    | ASTM D5185(m) | >26  | <b>7</b>     | 8   | --- |
| Tin          | ppm    | ASTM D5185(m) | >4   | <b>0</b>     | 0   | --- |
| Vanadium     | ppm    | ASTM D5185(m) |      | <b>0</b>     | 0   | --- |
| White Metal  | scalar | Visual*       | NONE | <b>VLITE</b> | --- | --- |
| Yellow Metal | scalar | Visual*       | NONE | <b>NONE</b>  | --- | --- |

**CONTAMINATION**











There is no indication of any contamination in the oil.

|                  |          |               |       |                |       |     |
|------------------|----------|---------------|-------|----------------|-------|-----|
| Silicon          | ppm      | ASTM D5185(m) | >22   | <b>3</b>       | 6     | --- |
| Potassium        | ppm      | ASTM D5185(m) | >20   | <b>0</b>       | <1    | --- |
| Fuel             |          | WC Method     | >2.1  | <b>&lt;1.0</b> | <1.0  | --- |
| Water            |          | WC Method     | >0.21 | <b>NEG</b>     | NEG   | --- |
| Glycol           |          | WC Method     |       | <b>NEG</b>     | NEG   | --- |
| Soot %           | %        | ASTM D7844*   | >3    | <b>0</b>       | 0     | --- |
| Nitration        | Abs/cm   | ASTM D7624*   | >20   | <b>4.9</b>     | 4.8   | --- |
| Sulfation        | Abs/.1mm | ASTM D7415*   | >30   | <b>18.1</b>    | 17.9  | --- |
| Silt             | scalar   | Visual*       | NONE  | <b>NONE</b>    | ---   | --- |
| Debris           | scalar   | Visual*       | NONE  | <b>VLITE</b>   | ---   | --- |
| Sand/Dirt        | scalar   | Visual*       | NONE  | <b>NONE</b>    | ---   | --- |
| Appearance       | scalar   | Visual*       | NORML | <b>NORML</b>   | ---   | --- |
| Odor             | scalar   | Visual*       | NORML | <b>NORML</b>   | NORML | --- |
| Emulsified Water | scalar   | Visual*       | >0.21 | <b>NEG</b>     | NEG   | --- |

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

|              |          |               |     |              |      |     |
|--------------|----------|---------------|-----|--------------|------|-----|
| Sodium       | ppm      | ASTM D5185(m) |     | <b>1</b>     | 2    | --- |
| Boron        | ppm      | ASTM D5185(m) |     | <b>1</b>     | 2    | --- |
| Barium       | ppm      | ASTM D5185(m) |     | <b>0</b>     | 0    | --- |
| Molybdenum   | ppm      | ASTM D5185(m) |     | <b>60</b>    | 56   | --- |
| Manganese    | ppm      | ASTM D5185(m) |     | <b>&lt;1</b> | <1   | --- |
| Magnesium    | ppm      | ASTM D5185(m) |     | <b>969</b>   | 937  | --- |
| Calcium      | ppm      | ASTM D5185(m) |     | <b>1033</b>  | 996  | --- |
| Phosphorus   | ppm      | ASTM D5185(m) |     | <b>1022</b>  | 969  | --- |
| Zinc         | ppm      | ASTM D5185(m) |     | <b>1141</b>  | 1126 | --- |
| Sulfur       | ppm      | ASTM D5185(m) |     | <b>2531</b>  | 2610 | --- |
| Oxidation    | Abs/.1mm | ASTM D7414*   | >25 | <b>13.8</b>  | 13.0 | --- |
| Visc @ 100°C | cSt      | ASTM D7279(m) |     | <b>15.2</b>  | 15.0 | --- |

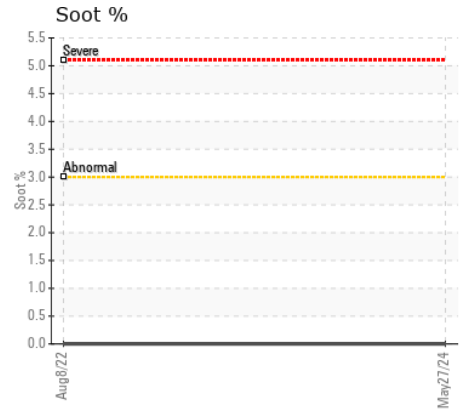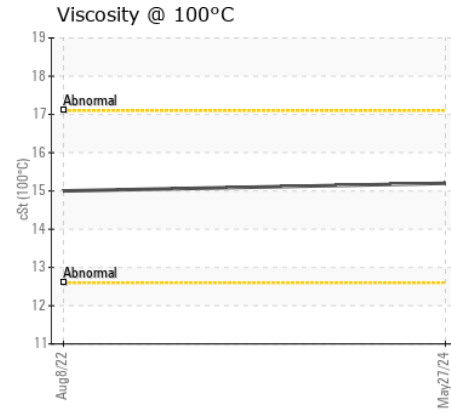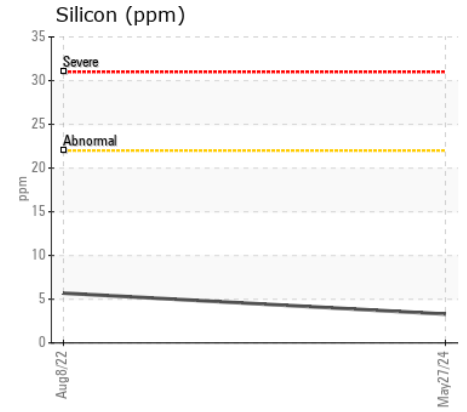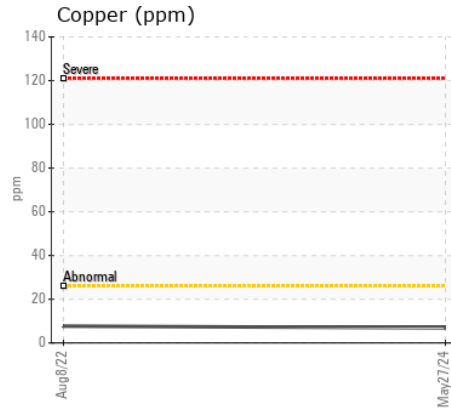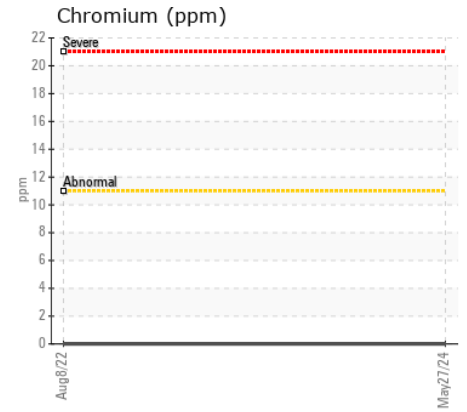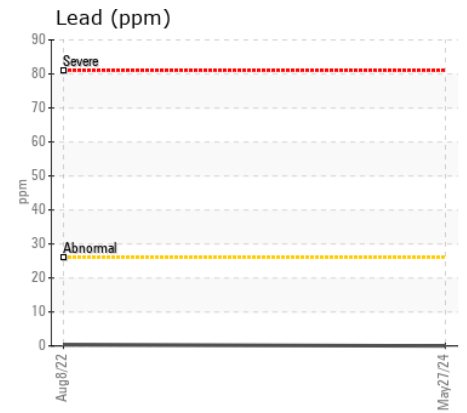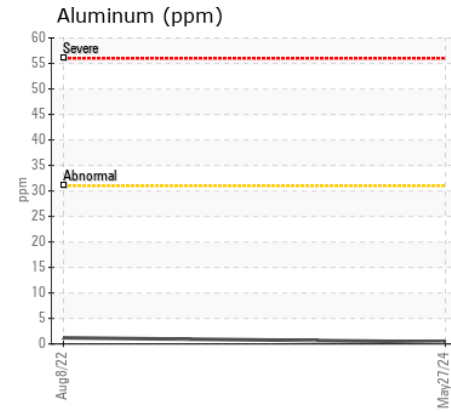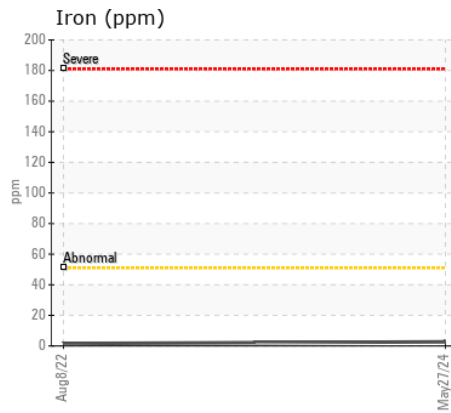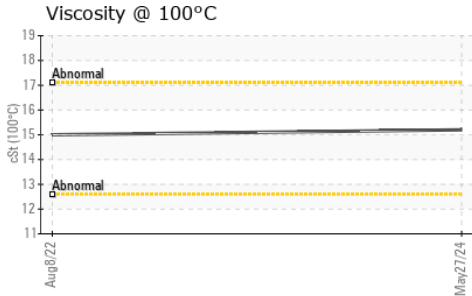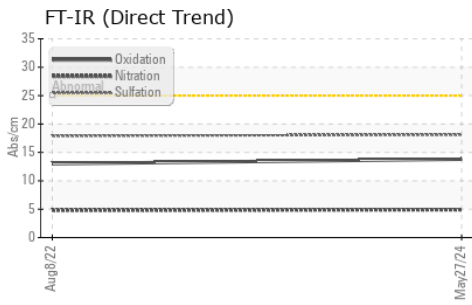

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0020844 **Received** : 05 Jun 2024  
**Lab Number** : 02639766 **Tested** : 05 Jun 2024  
**Unique Number** : 5788928 **Diagnosed** : 05 Jun 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Power Systems**  
 70 Raddall Avenue  
 Dartmouth, NS  
 CA B3B 1T7  
 Contact: Danelle Hoffman  
 dhoffman@wajax.com  
 T: (902)468-6200  
 F: (902)468-3325