



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[6100285605]

Machine Id

7YR04183

Component

Diesel Engine

Fluid

PETRO CANADA DURON SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021452	---	---
Sample Date		Client Info		03 Jun 2024	---	---
Machine Age	hrs	Client Info		2321	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	1	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	0	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>25	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	1	---	---
Copper	ppm	ASTM D5185(m)	>330	51	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	1	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	4.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.1	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		10	---	---
Boron	ppm	ASTM D5185(m)	1	35	---	---
Barium	ppm	ASTM D5185(m)	1	0	---	---
Molybdenum	ppm	ASTM D5185(m)	60	46	---	---
Manganese	ppm	ASTM D5185(m)	1	0	---	---
Magnesium	ppm	ASTM D5185(m)	1010	745	---	---
Calcium	ppm	ASTM D5185(m)	1070	1259	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	981	---	---
Zinc	ppm	ASTM D5185(m)	1270	1130	---	---
Sulfur	ppm	ASTM D5185(m)	2060	2651	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	14.3	---	---

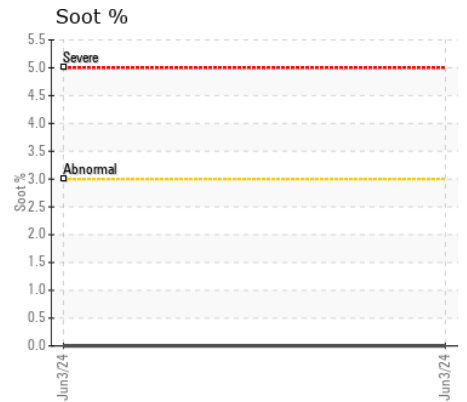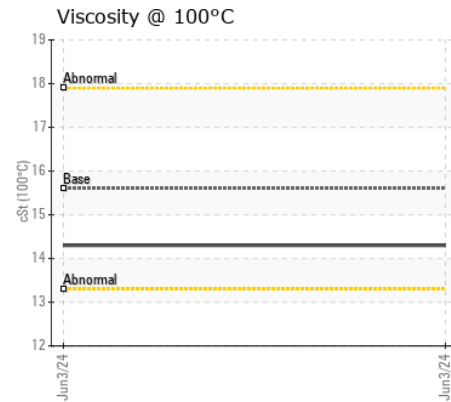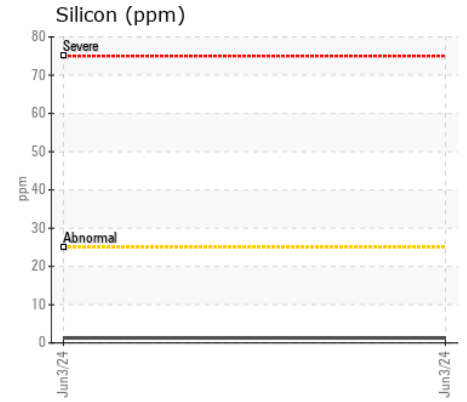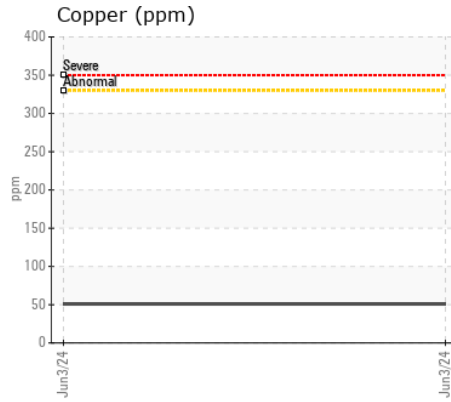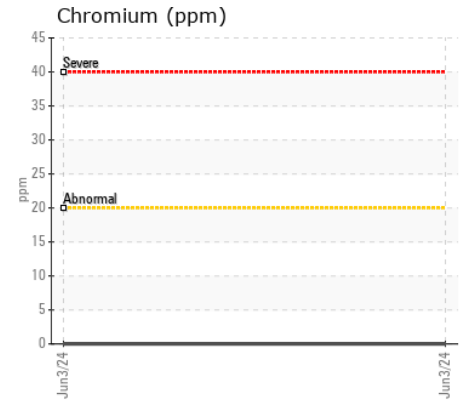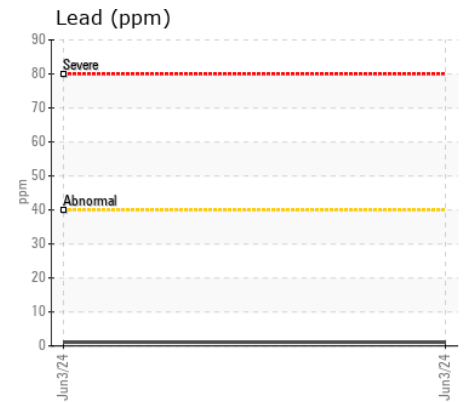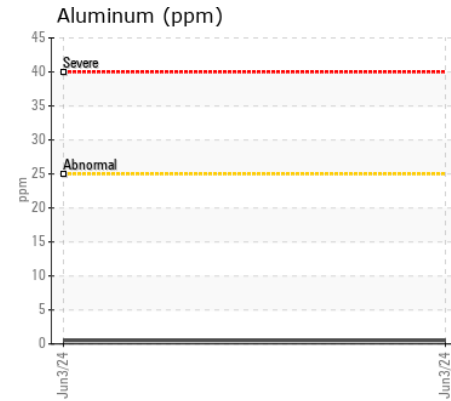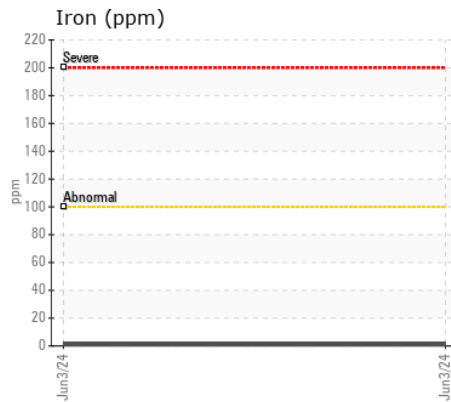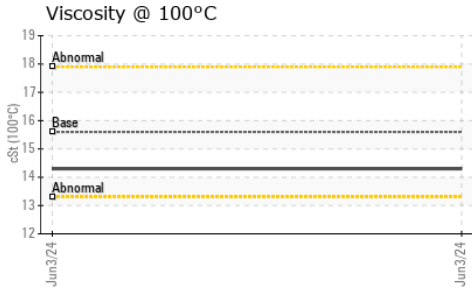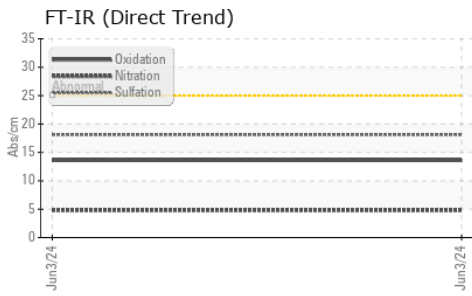

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021452 **Received** : 06 Jun 2024
Lab Number : 02640110 **Tested** : 06 Jun 2024
Unique Number : 5789272 **Diagnosed** : 06 Jun 2024 - Wes Davis
Test Package : MOB 1

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.