



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[86436]

Machine Id

30 CARLTON ST T.O TORONTO HOLIDAY INN NTA855G

Component

Right Diesel Engine

Fluid

ESSO XD-3 EXTRA 15W40 (30 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006286	PN0004788	PN0003176
Sample Date		Client Info		29 May 2024	12 May 2023	05 Apr 2022
Machine Age	hrs	Client Info		472	462	247
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	3	3	5
Chromium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Nickel	ppm	ASTM D5185(m)	>2	0	0	<1
Titanium	ppm	ASTM D5185(m)	>2	0	<1	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	3	3
Lead	ppm	ASTM D5185(m)	>40	1	2	3
Copper	ppm	ASTM D5185(m)	>330	4	5	10
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185(m)	>25	3	5	8
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.2	7.3	6.8
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.7	17.4	18.7
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION


The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	2	3	3
Boron	ppm	ASTM D5185(m)		18	75	79
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		64	86	84
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		777	31	42
Calcium	ppm	ASTM D5185(m)	3780	1335	2230	2144
Phosphorus	ppm	ASTM D5185(m)	1370	1030	1118	1054
Zinc	ppm	ASTM D5185(m)	1500	1197	1147	1145
Sulfur	ppm	ASTM D5185(m)	3800	2776	3301	3222
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.3	13.2	11.9
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	14.8	14.2	14.2


FT-IR (Direct Trend)

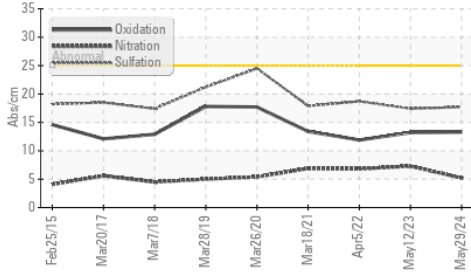


Viscosity @ 100°C

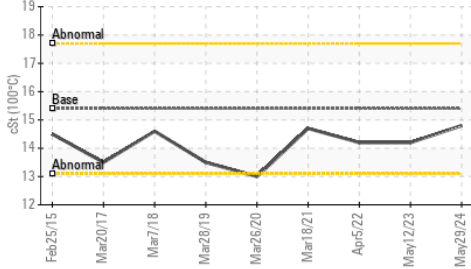


Iron (ppm)

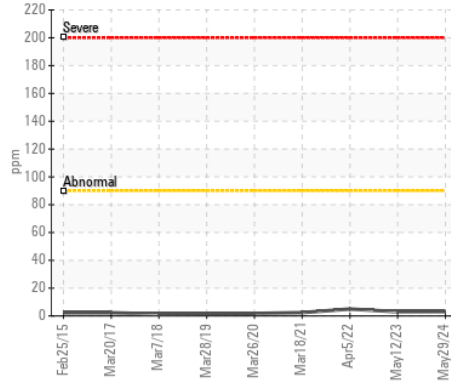


Aluminum (ppm)

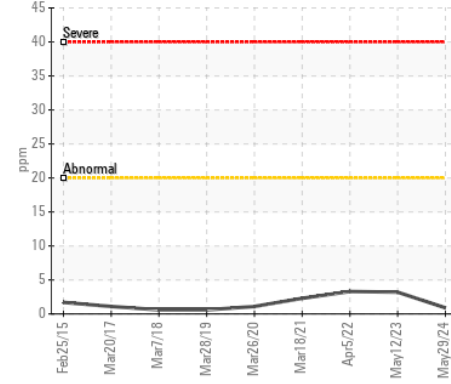


Copper (ppm)

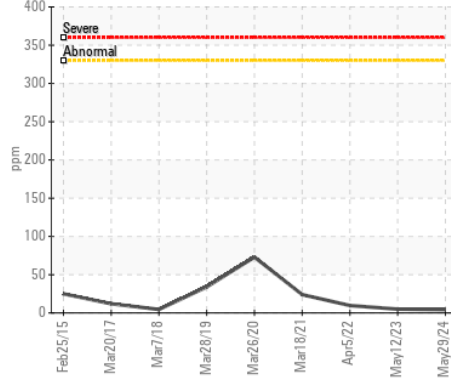


Viscosity @ 100°C

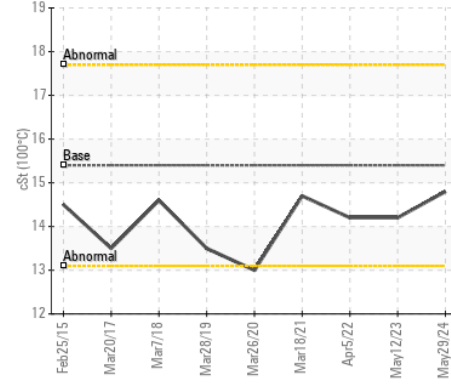


Lead (ppm)

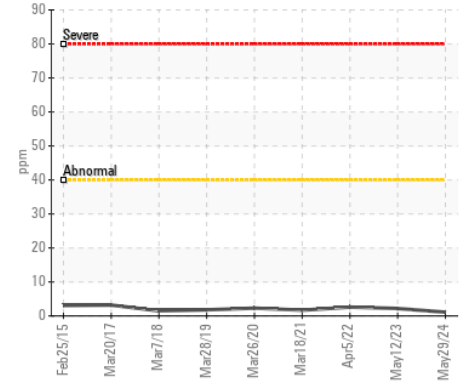


Chromium (ppm)

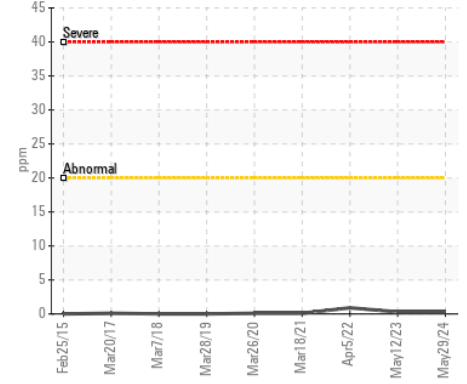

Silicon (ppm)

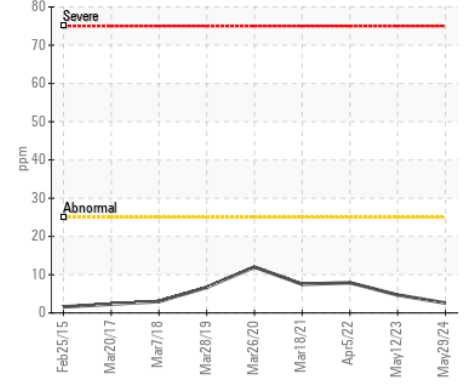

Soot %

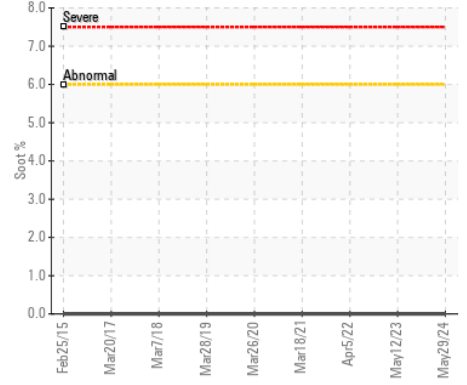

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006286
Lab Number : 02640194
Unique Number : 5789356
Test Package : MOB 1
Received : 06 Jun 2024
Tested : 06 Jun 2024
Diagnosed : 06 Jun 2024 - Wes Davis

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.