



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
TERANET [154441]
Machine Id
GENERATOR #1
Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0021442	CU0021208	CU0022279
Sample Date		Client Info		25 May 2024	20 Apr 2024	24 Feb 2024
Machine Age	hrs	Client Info		236	0	233
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	2	2	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	0
Silver	ppm	ASTM D5185(m)	>2	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	<1
Lead	ppm	ASTM D5185(m)	>40	0	0	0
Copper	ppm	ASTM D5185(m)	>330	23	23	23
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION













Tests indicate that there is no fuel present in the oil. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	6	6	6
Potassium	ppm	ASTM D5185(m)	>20	0	<1	<1
Fuel	%	ASTM D7593*	>3.0	0.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>6	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.5	6.5	6.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.1	20.2	20.3
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	3	3	3
Boron	ppm	ASTM D5185(m)	250	43	44	44
Barium	ppm	ASTM D5185(m)	10	0	0	0
Molybdenum	ppm	ASTM D5185(m)	100	46	46	46
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)	450	799	806	797
Calcium	ppm	ASTM D5185(m)	3000	1150	1153	1162
Phosphorus	ppm	ASTM D5185(m)	1150	695	706	691
Zinc	ppm	ASTM D5185(m)	1350	804	805	814
Sulfur	ppm	ASTM D5185(m)	4250	1984	1928	2024
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.4	17.4	17.7
Visc @ 40°C	cSt	ASTM D7279(m)	115	113	113	113
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.7	14.8	14.8
Viscosity Index (VI)	Scale	ASTM D2270*	126	133	135	135

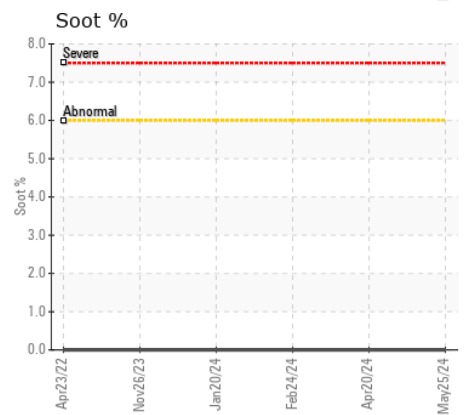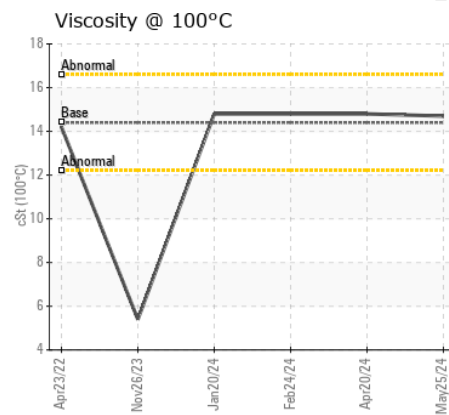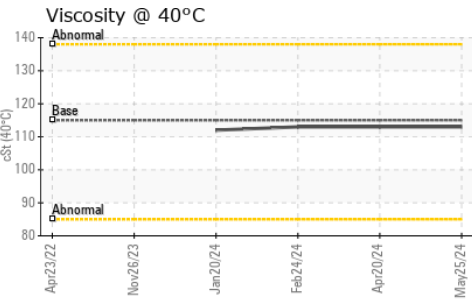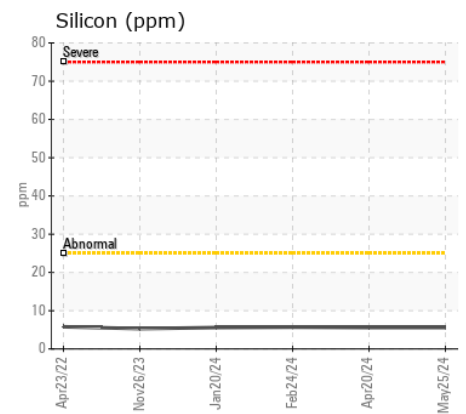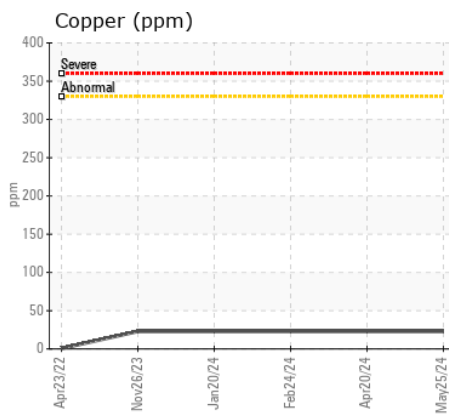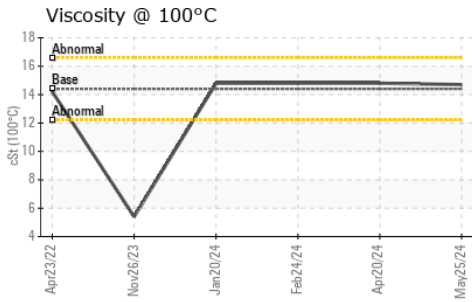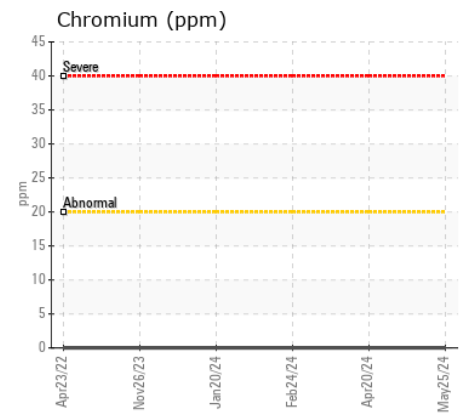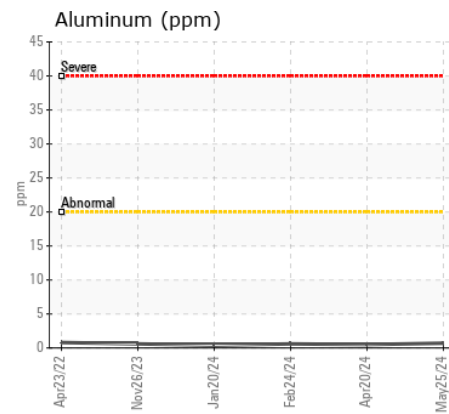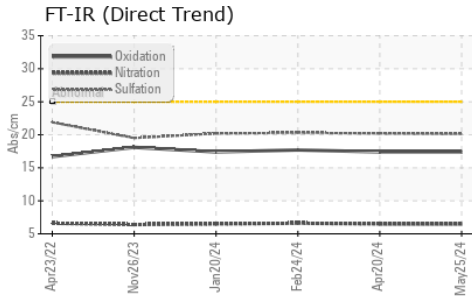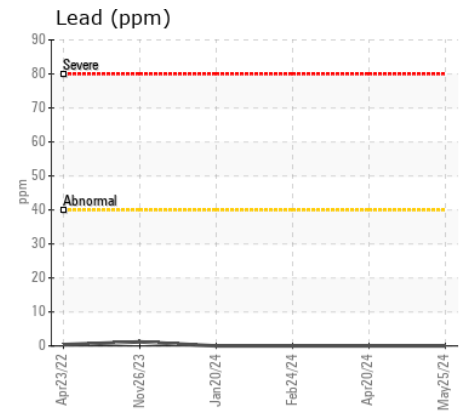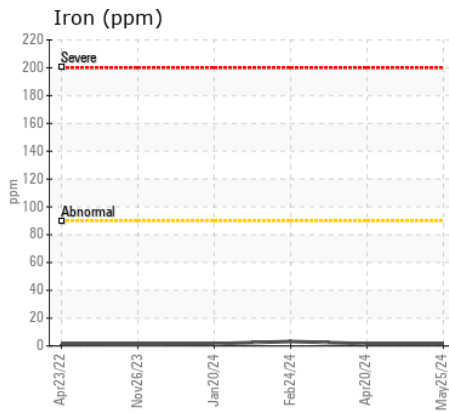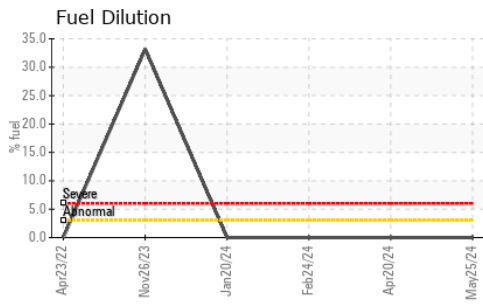

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0021442
Lab Number : 02640829
Unique Number : 5789991
Test Package : MOB 1 (Additional Tests: FuelDilution, KV40, PercentFuel, VI)

CUMMINS CANADA ULC - GENERATOR DIVISION
 7175 PACIFIC CIRCLE
 MISSISSAUGA, ON
 CA L5T 2A5
 Contact: Elisia Johnson
 elisia.johnson@cummins.com
 T: (905)795-0050
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.