



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

HALIFAX WATER [266846]

Machine Id

RG6090L075148

Component

Diesel Engine

Fluid

PETRO CANADA DURON SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0020854	WA0018114	---
Sample Date		Client Info		06 Jun 2024	12 Oct 2022	---
Machine Age	hrs	Client Info		369	331	---
Oil Age	hrs	Client Info		40	0	---
Filter Age	hrs	Client Info		40	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>51	1	2	---
Chromium	ppm	ASTM D5185(m)	>11	0	0	---
Nickel	ppm	ASTM D5185(m)	>5	0	0	---
Titanium	ppm	ASTM D5185(m)		0	<1	---
Silver	ppm	ASTM D5185(m)	>3	0	0	---
Aluminum	ppm	ASTM D5185(m)	>31	<1	<1	---
Lead	ppm	ASTM D5185(m)	>26	0	0	---
Copper	ppm	ASTM D5185(m)	>26	<1	<1	---
Tin	ppm	ASTM D5185(m)	>4	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	2	3	---
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	---
Fuel		WC Method	>2.1	<1.0	<1.0	---
Water		WC Method	>0.21	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	4.5	4.9	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.7	18.7	---
Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>31	1	1	---
Boron	ppm	ASTM D5185(m)	1	2	8	---
Barium	ppm	ASTM D5185(m)	1	0	0	---
Molybdenum	ppm	ASTM D5185(m)	60	57	53	---
Manganese	ppm	ASTM D5185(m)	1	0	<1	---
Magnesium	ppm	ASTM D5185(m)	1010	958	875	---
Calcium	ppm	ASTM D5185(m)	1070	1038	1051	---
Phosphorus	ppm	ASTM D5185(m)	1150	973	998	---
Zinc	ppm	ASTM D5185(m)	1270	1141	1067	---
Sulfur	ppm	ASTM D5185(m)	2060	2515	2491	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.0	13.8	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	14.5	14.3	---

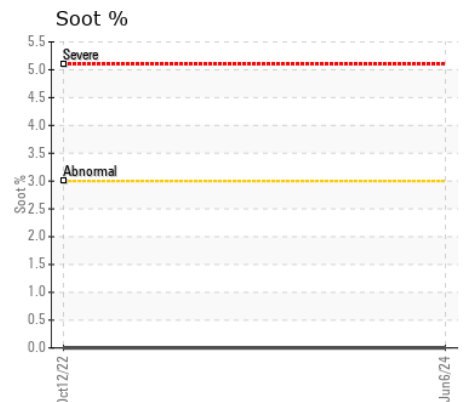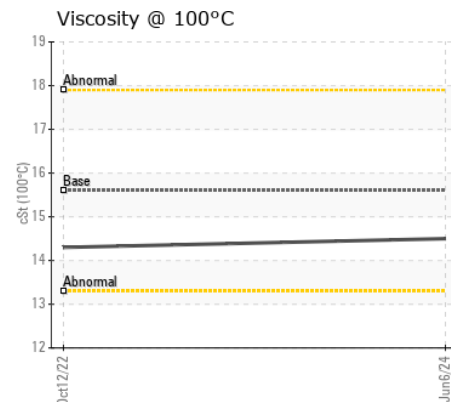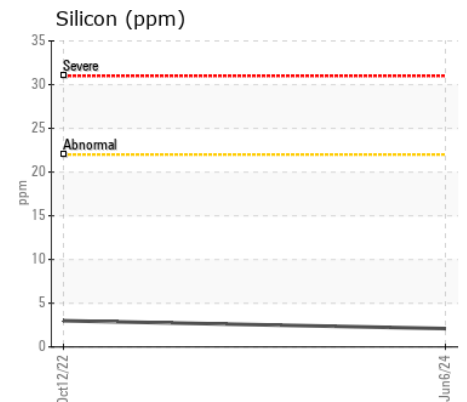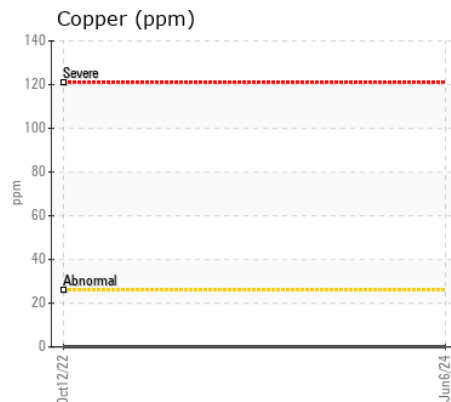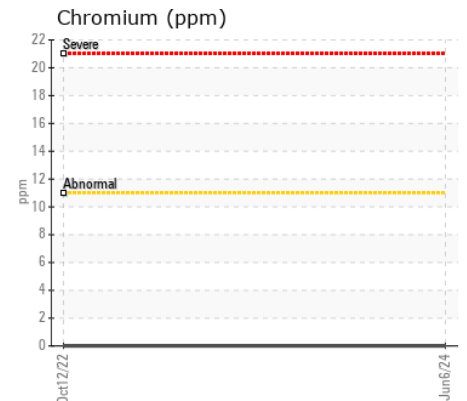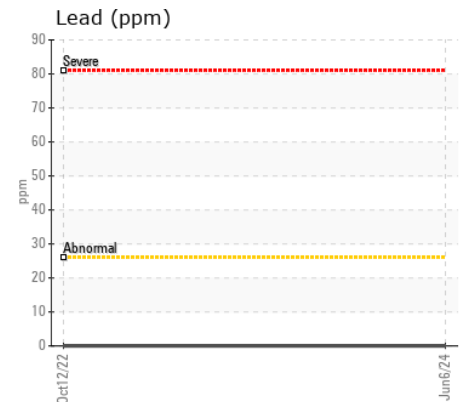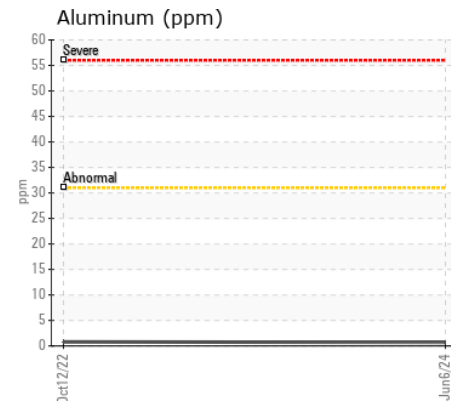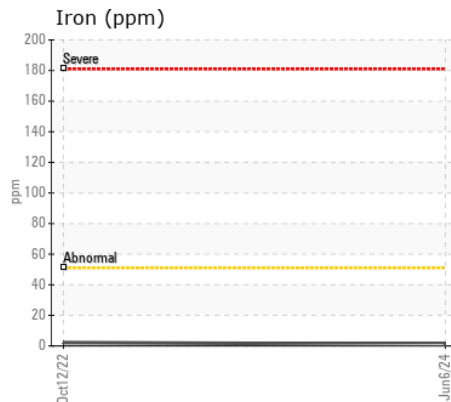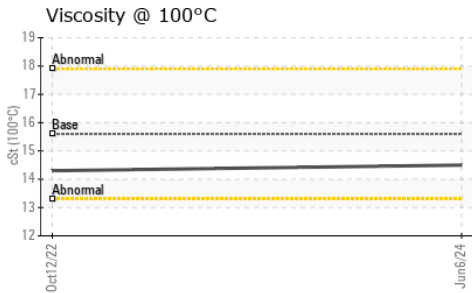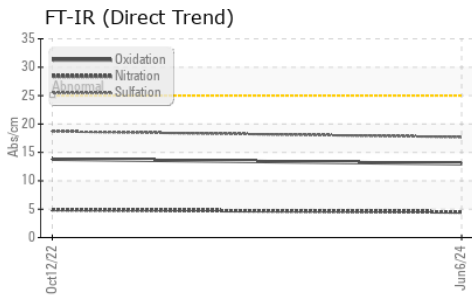

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020854 **Received** : 11 Jun 2024
Lab Number : 02641052 **Tested** : 11 Jun 2024
Unique Number : 5798591 **Diagnosed** : 11 Jun 2024 - Wes Davis
Test Package : MOB 1

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325