



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[6100306176]

Machine Id

WATER TOWER GEN

Component

Diesel Engine

Fluid

DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 15W40. Please confirm.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021749	---	---
Sample Date		Client Info		29 May 2024	---	---
Machine Age	hrs	Client Info		192	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>51	1	---	---
Chromium	ppm	ASTM D5185(m)	>11	0	---	---
Nickel	ppm	ASTM D5185(m)	>5	0	---	---
Titanium	ppm	ASTM D5185(m)		<1	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>31	<1	---	---
Lead	ppm	ASTM D5185(m)	>26	0	---	---
Copper	ppm	ASTM D5185(m)	>26	<1	---	---
Tin	ppm	ASTM D5185(m)	>4	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>22	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
Fuel		WC Method	>2.1	<1.0	---	---
Water		WC Method	>0.21	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	4.3	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.9	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.21	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	<1	---	---
Boron	ppm	ASTM D5185(m)	250	3	---	---
Barium	ppm	ASTM D5185(m)	10	0	---	---
Molybdenum	ppm	ASTM D5185(m)	100	56	---	---
Manganese	ppm	ASTM D5185(m)		0	---	---
Magnesium	ppm	ASTM D5185(m)	450	946	---	---
Calcium	ppm	ASTM D5185(m)	3000	1006	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	971	---	---
Zinc	ppm	ASTM D5185(m)	1350	1115	---	---
Sulfur	ppm	ASTM D5185(m)	4250	2499	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.9	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	115	114	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	14.9	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	126	135	---	---

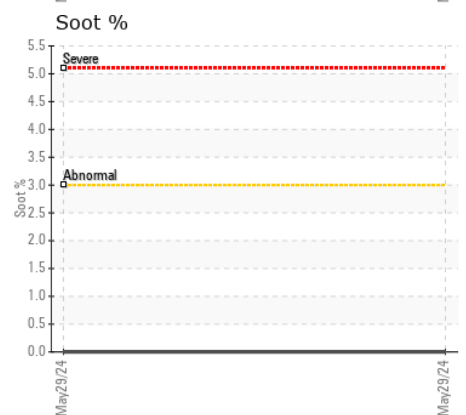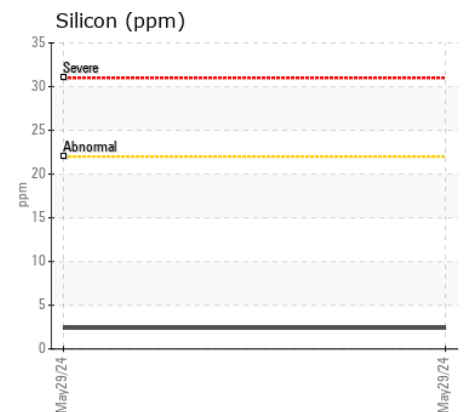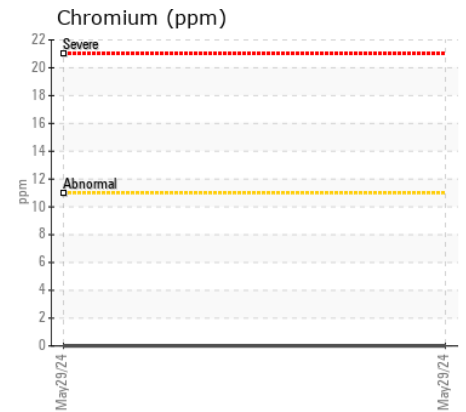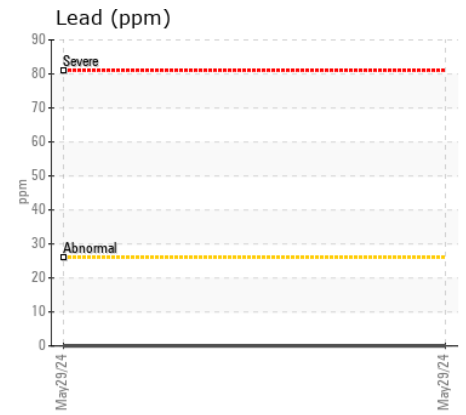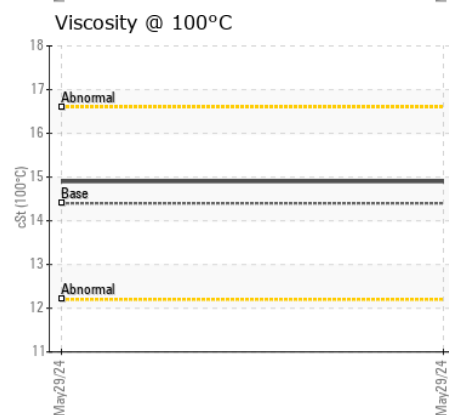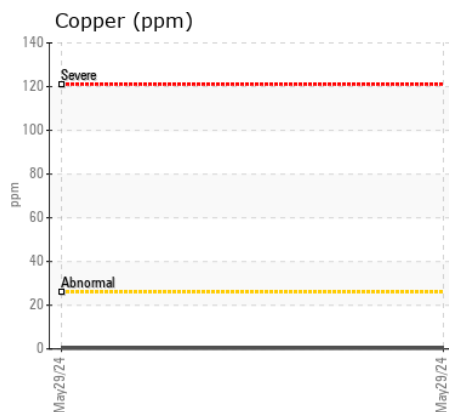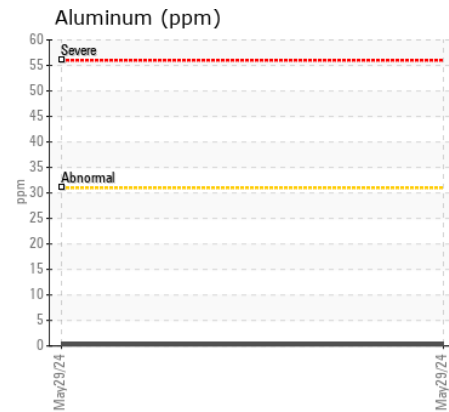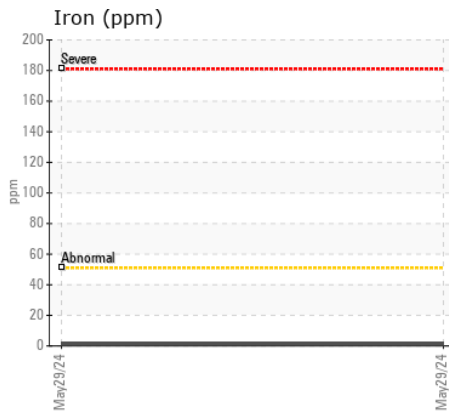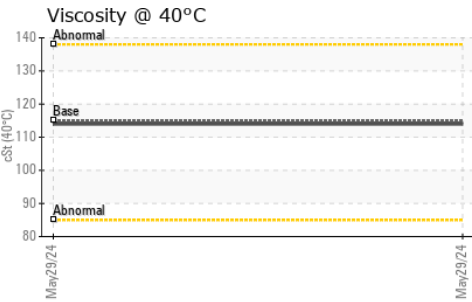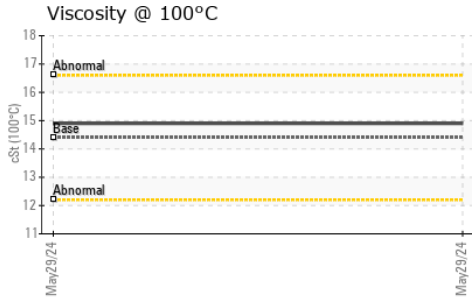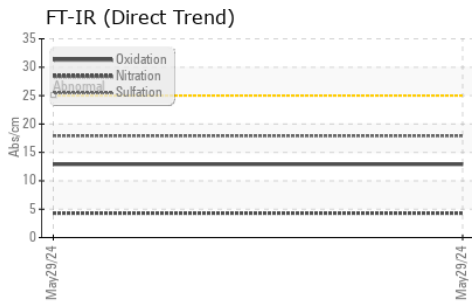

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021749 **Received** : 12 Jun 2024
Lab Number : 02641373 **Tested** : 12 Jun 2024
Unique Number : 5798912 **Diagnosed** : 12 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: KV40, VI, Visual)

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.