



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	MARGINAL
FLUID CONDITION	ABNORMAL

Machine Id
112994
Component
Diesel Engine
Fluid
SAE 15W40 (--- GAL)

RECOMMENDATION

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0933621	---	---
Sample Date		Client Info		05 Jun 2024	---	---
Machine Age	hrs	Client Info		39	---	---
Oil Age	hrs	Client Info		39	---	---
Filter Age	hrs	Client Info		39	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				ABNORMAL	---	---

WEAR

Metal levels are typical for a components first oil change.

Iron	ppm	ASTM D5185(m)	>100	6	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	7	---	---
Tin	ppm	ASTM D5185(m)	>15	2	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION













Light fuel dilution occurring.

Silicon	ppm	ASTM D5185(m)	>25	26	---	---
Potassium	ppm	ASTM D5185(m)	>20	9	---	---
Fuel	%	ASTM D7593*	>5	▲ 2.2	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.8	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.9	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

Fuel is present in the oil and is lowering the viscosity. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>57	2	---	---
Boron	ppm	ASTM D5185(m)		23	---	---
Barium	ppm	ASTM D5185(m)		<1	---	---
Molybdenum	ppm	ASTM D5185(m)		11	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		82	---	---
Calcium	ppm	ASTM D5185(m)		3365	---	---
Phosphorus	ppm	ASTM D5185(m)		1029	---	---
Zinc	ppm	ASTM D5185(m)		1154	---	---
Sulfur	ppm	ASTM D5185(m)		7895	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	11.5	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	115	80.8	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.5	▲ 11.8	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	128	139	---	---

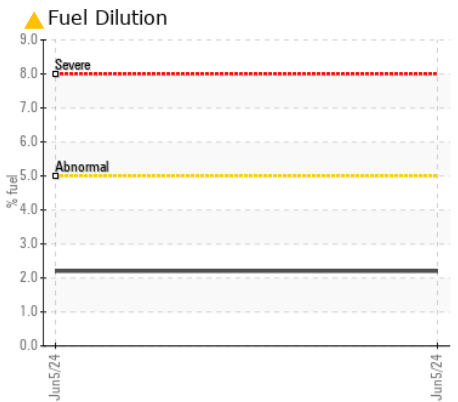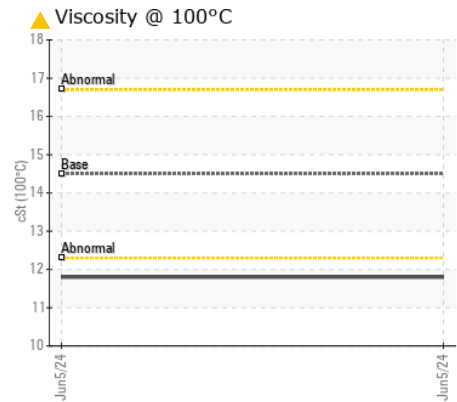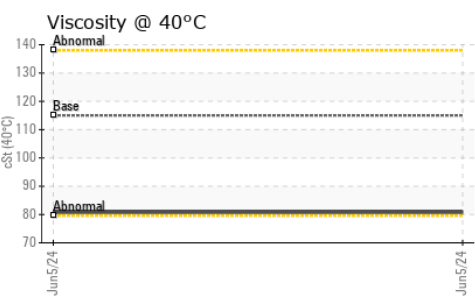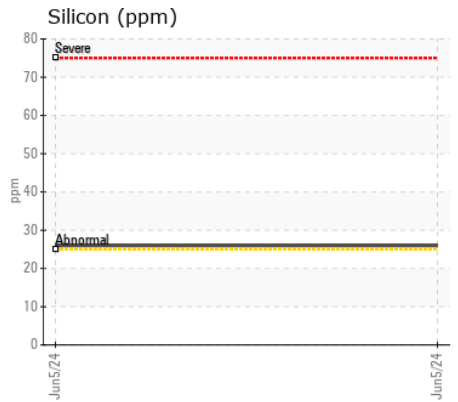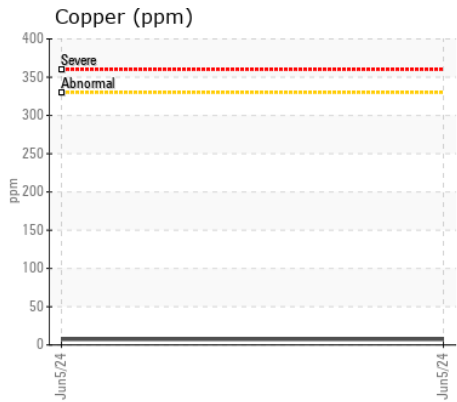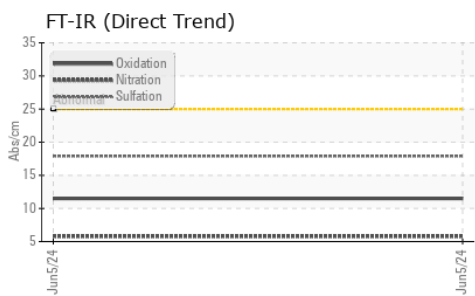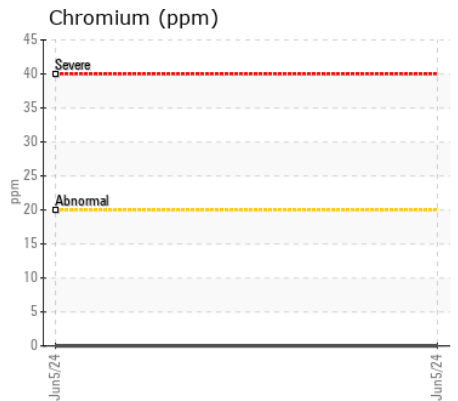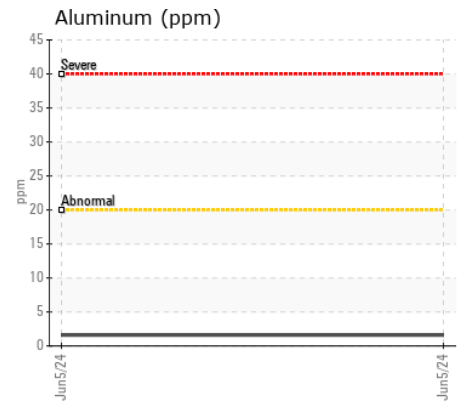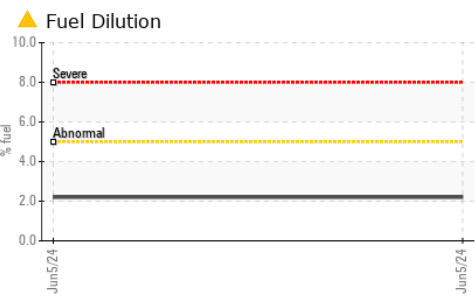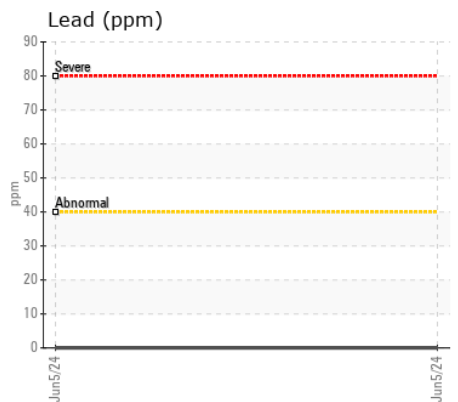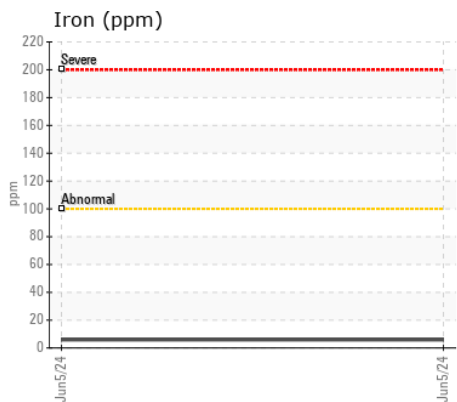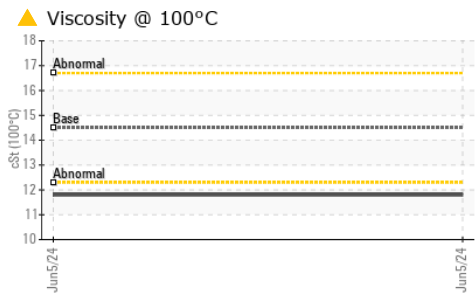

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0933621
Lab Number : 02641585
Unique Number : 5799124
Test Package : MOB 1 (Additional Tests: FuelDilution, KV40, PercentFuel, VI, Visual)

SOMMERS GENERATOR SALES LTD.
 70 PACKHAM AVENUE
 STRATFORD, ON
 CA N4Z 0A6
 Contact: Pat Devereaux
 pat.devereaux@sommersgen.com
 T: (519)655-2396
 F: (519)655-6881

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.