



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area

COMPRESSEUR

Machine Id

1401-CPS-008

Component

8 Air Compressor

Fluid

ESSO TERESSO ISO 68 (80 LTR)

RECOMMENDATION

Nous recommandons le remplacement des filtres de ce composant. Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition.

WEAR

Les taux d'usure de tous les composants sont normaux.










CONTAMINATION

Il y a une légère quantité de limon (particules de 4 à 14 microns) dans l'huile. La teneur en eau est négligeable.

FLUID CONDITION

Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0868797	WC0865986	WC0803863
Sample Date		Client Info		03 Jun 2024	15 Oct 2023	11 Jun 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Filter Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	NORMAL	NORMAL
Iron	ppm	ASTM D5185(m)	>70	0	0	0
Chromium	ppm	ASTM D5185(m)	>15	0	0	0
Nickel	ppm	ASTM D5185(m)	>6	0	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	0
Aluminum	ppm	ASTM D5185(m)	>10	0	0	0
Lead	ppm	ASTM D5185(m)	>20	0	0	0
Copper	ppm	ASTM D5185(m)	>80	0	<1	0
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185(m)	>12	0	1	1
Potassium	ppm	ASTM D5185(m)	>20	0	0	<1
Water	%	ASTM D6304*	>0.1	0.001	0.004	0.001
ppm Water	ppm	ASTM D6304*	>1000	2	40.6	0.8
Particles >4µm		ASTM D7647		3412	135	172
Particles >6µm		ASTM D7647	>640	1010	42	48
Particles >14µm		ASTM D7647	>80	97	4	6
Particles >21µm		ASTM D7647	>20	30	1	2
Particles >38µm		ASTM D7647	>4	3	1	1
Particles >71µm		ASTM D7647	>3	0	1	1
Oil Cleanliness		ISO 4406 (c)	--/16/13	19/17/14	14/13/9	15/13/10
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Sodium	ppm	ASTM D5185(m)		0	0	0
Boron	ppm	ASTM D5185(m)	4.5	<1	<1	0
Barium	ppm	ASTM D5185(m)	0.4	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1	0	0
Calcium	ppm	ASTM D5185(m)	0	0	0	0
Phosphorus	ppm	ASTM D5185(m)	0.7	0	<1	0
Zinc	ppm	ASTM D5185(m)	0	<1	<1	<1
Sulfur	ppm	ASTM D5185(m)	1315	6899	6807	6605
Acid Number (AN)	mg KOH/g	ASTM D974*	0.02	0.03	0.06	0.09
Visc @ 40°C	cSt	ASTM D7279(m)	68	69.4	68.6	67.3
Visc @ 100°C	cSt	ASTM D7279(m)	8.26	8.7	8.7	8.6
Viscosity Index (VI)	Scale	ASTM D2270*		96	98	98

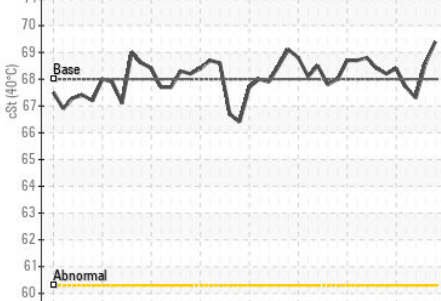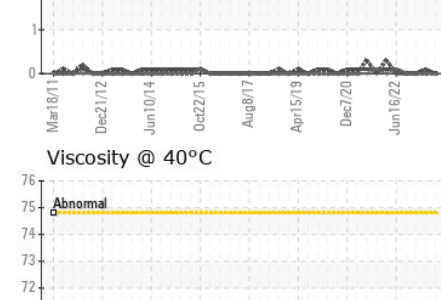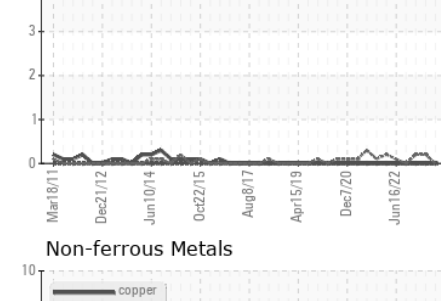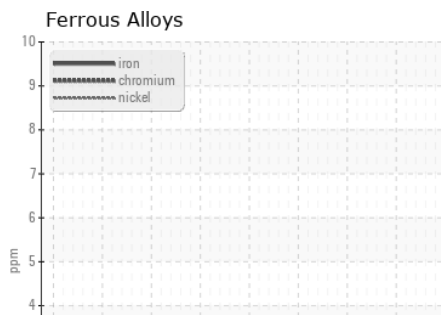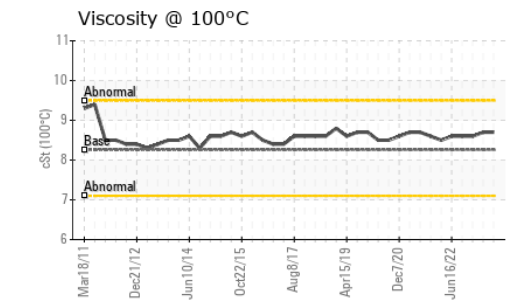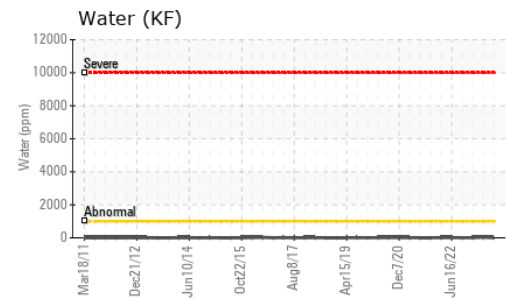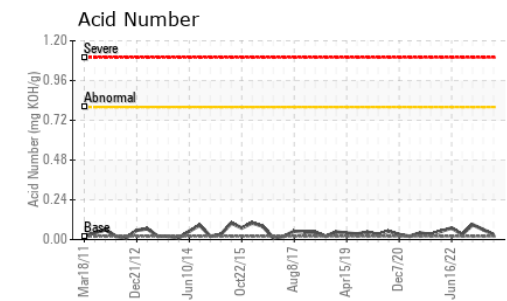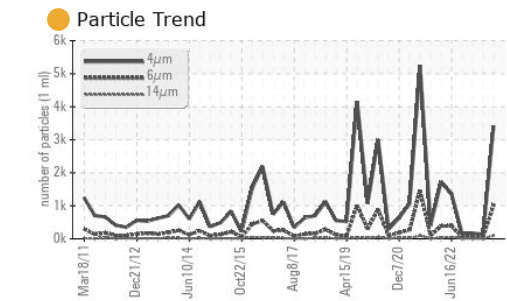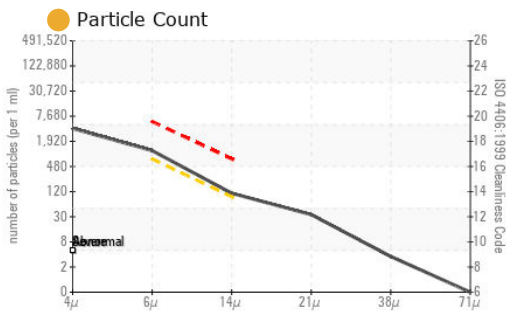

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0868797
Lab Number : 02641724
Unique Number : 5799263
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, TAN Man, VI)
Received : 13 Jun 2024
Tested : 14 Jun 2024
Diagnosed : 14 Jun 2024 - Wes Davis

RTA - ALMA
 3000 RUE DES PINS OUEST, BATISSE 7103 MEZZALINE
 ALMA, QC
 CA G8B 6T3
 Contact: Guy Dufour
 guy.dufour-almacou@riotinto.com
 T:
 F: (418)480-6004

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.