



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[GH-9142A]

Machine Id

170831 HB (S/N GH-9142A)

Component

Unknown Component

Fluid

{not provided} (--- GAL)

RECOMMENDATION

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. Please provide more complete information on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PP	PP	---
Sample Date		Client Info		13 Jun 2024	18 Apr 2024	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	N/A	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

PQ		ASTM D8184*		0	0	---
Iron	ppm	ASTM D5185(m)		6	6	---
Chromium	ppm	ASTM D5185(m)		0	0	---
Nickel	ppm	ASTM D5185(m)		<1	0	---
Titanium	ppm	ASTM D5185(m)		0	0	---
Silver	ppm	ASTM D5185(m)		0	0	---
Aluminum	ppm	ASTM D5185(m)		0	0	---
Lead	ppm	ASTM D5185(m)		<1	<1	---
Copper	ppm	ASTM D5185(m)		7	6	---
Tin	ppm	ASTM D5185(m)		0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---

CONTAMINATION










The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Silicon	ppm	ASTM D5185(m)		<1	<1	---
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	---
Water		WC Method		NEG	NEG	---
Particles >4µm		ASTM D7647	>5000	285	141	---
Particles >6µm		ASTM D7647	>1300	71	41	---
Particles >14µm		ASTM D7647	>160	6	3	---
Particles >21µm		ASTM D7647	>40	2	1	---
Particles >38µm		ASTM D7647	>10	1	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	15/13/10	14/13/9	---
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*		NEG	NEG	---

FLUID CONDITION

Viscosity of sample indicates oil is within ISO 32 range, advise investigate. The AN level is acceptable for this fluid. The condition of the sample is suitable for further service.

Sodium	ppm	ASTM D5185(m)		<1	0	---
Boron	ppm	ASTM D5185(m)		<1	<1	---
Barium	ppm	ASTM D5185(m)		<1	0	---
Molybdenum	ppm	ASTM D5185(m)		0	0	---
Manganese	ppm	ASTM D5185(m)		0	0	---
Magnesium	ppm	ASTM D5185(m)		6	6	---
Calcium	ppm	ASTM D5185(m)		42	41	---
Phosphorus	ppm	ASTM D5185(m)		223	215	---
Zinc	ppm	ASTM D5185(m)		254	249	---
Sulfur	ppm	ASTM D5185(m)		2486	2568	---
Acid Number (AN)	mg KOH/g	ASTM D974*		0.31	0.29	---
Visc @ 40°C	cSt	ASTM D7279(m)		33.9	33.6	---

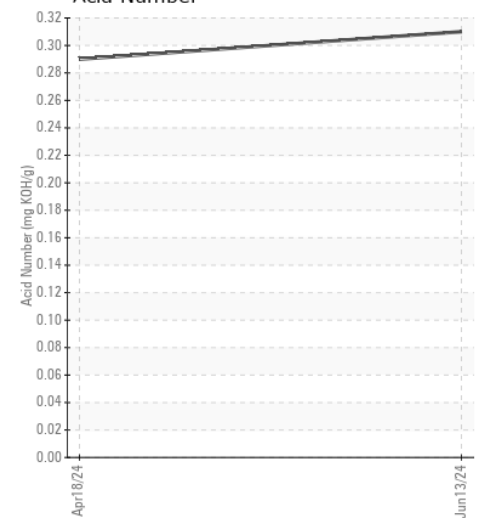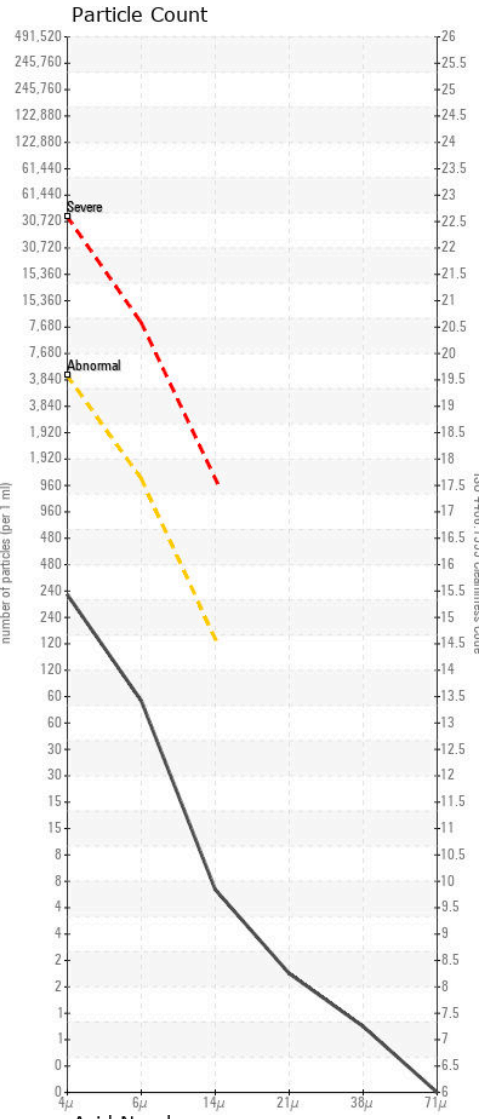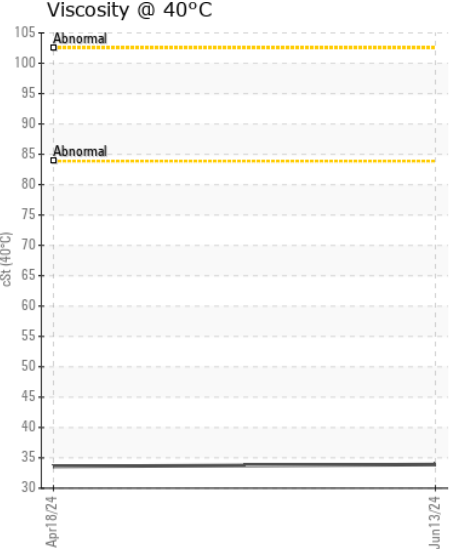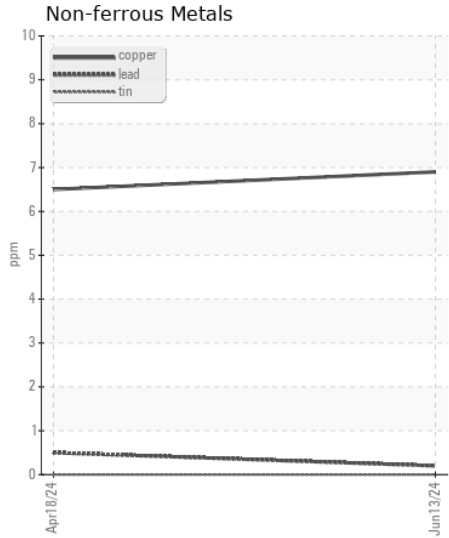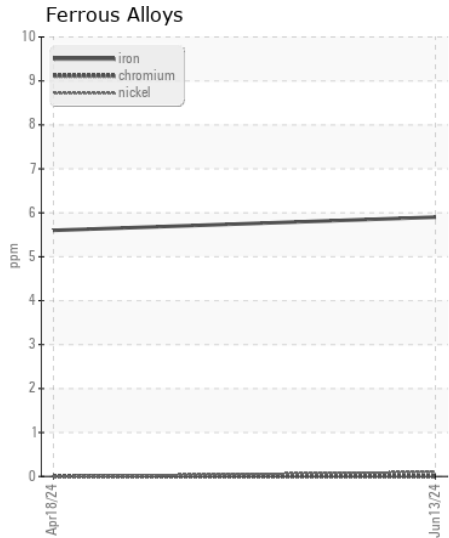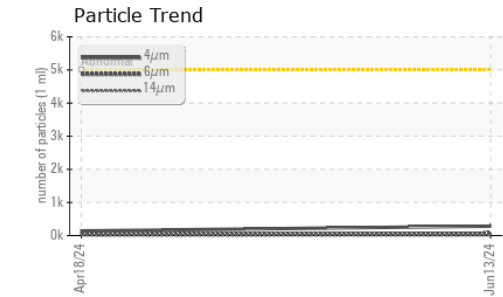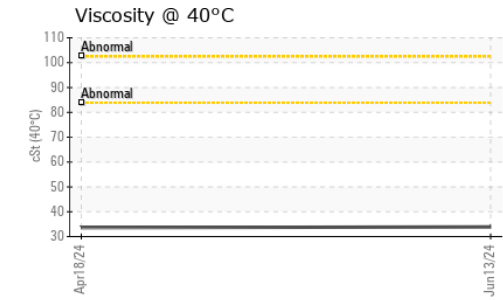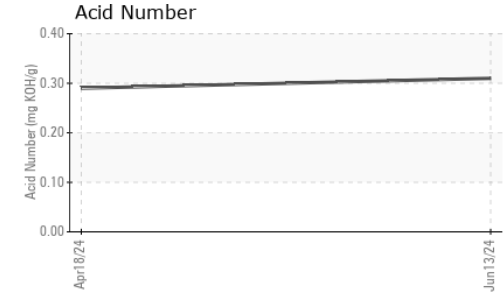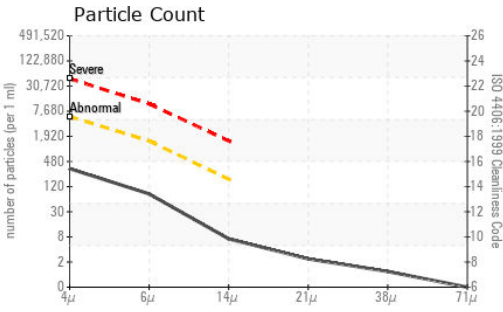

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PP **Received** : 14 Jun 2024
Lab Number : 02641966 **Tested** : 18 Jun 2024
Unique Number : 5799505 **Diagnosed** : 18 Jun 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: PQ, PRTCOUNT)

HIBERNIA MGMT & DEVELOPMENT CO. LTD
 SUITE 1000,, 100 NEW GOWER STREET
 ST.JOHNS, NL
 CA A1C 6K3
 Contact: Sam Nash
 samantha.m.nash@exxonmobil.com
 T:
 F: (709)722-3766

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.