



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**[104635]**  
 Machine Id  
**74703571**  
 Component  
**Diesel Engine**  
 Fluid  
**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 15W40. Please confirm.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CU0023406</b>	---	---
Sample Date		Client Info		<b>13 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>568</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>Changed</b>	---	---
Filter Changed		Client Info		<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	<b>10</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>2</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>18</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
White Metal	scalar	Visual*	NONE	<b>VLITE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

## CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>15</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>4</b>	---	---
Fuel		WC Method	>3.0	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>6	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.6</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>20.3</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	<b>4</b>	---	---
Boron	ppm	ASTM D5185(m)	250	<b>123</b>	---	---
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>14</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185(m)	450	<b>223</b>	---	---
Calcium	ppm	ASTM D5185(m)	3000	<b>2030</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>881</b>	---	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1042</b>	---	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2711</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>16.8</b>	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	115	<b>104</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>13.7</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	126	<b>131</b>	---	---

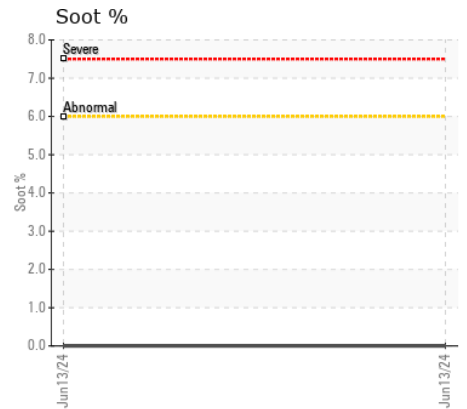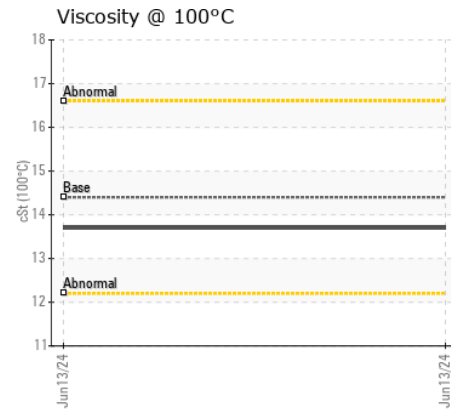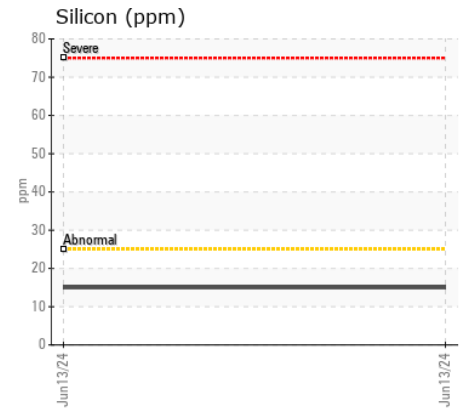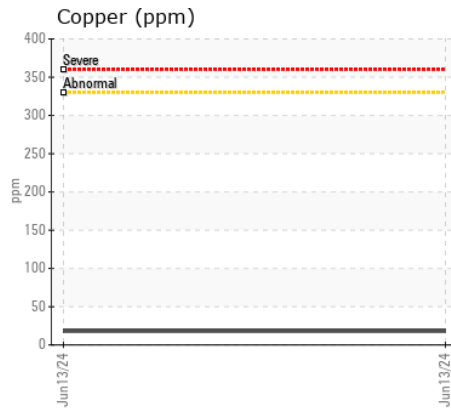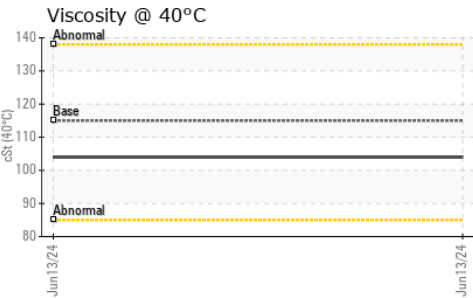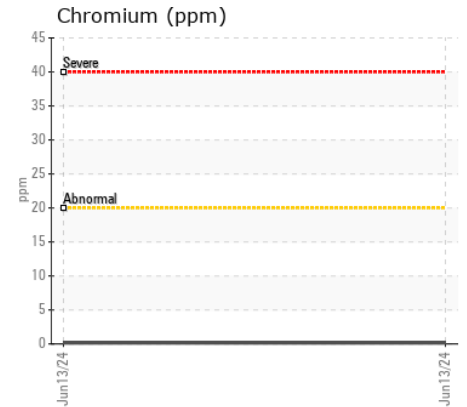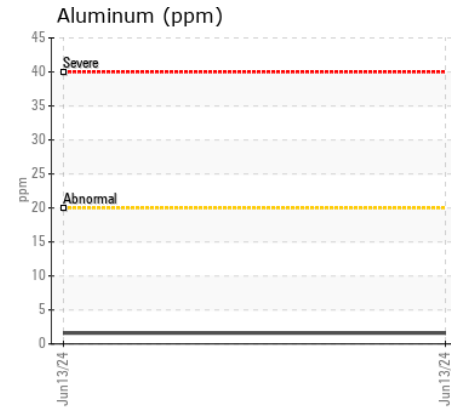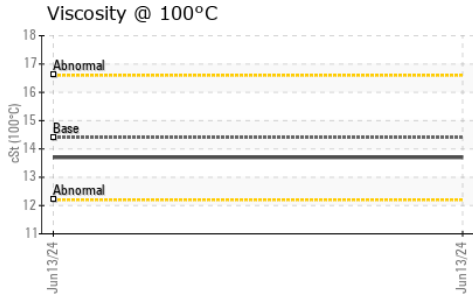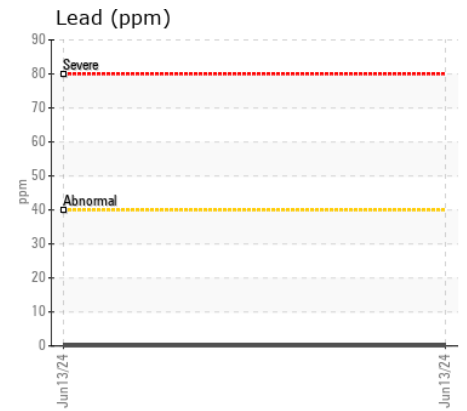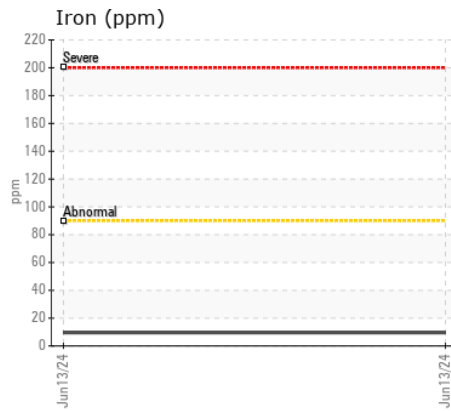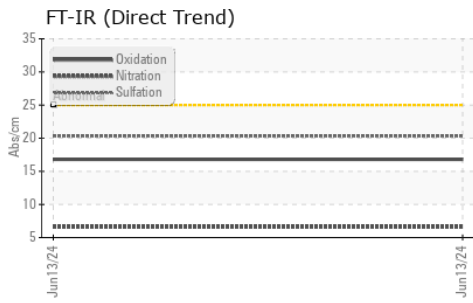

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : CU0023406 **Received** : 17 Jun 2024  
**Lab Number** : 02642250 **Tested** : 18 Jun 2024  
**Unique Number** : 5799789 **Diagnosed** : 18 Jun 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: KV40, VI, Visual )

**CUMMINS EASTERN CANADA LP**  
 3189 SWANSEA CRESCENT  
 OTTAWA, ON  
 CA K1G 3W5  
 Contact: Cindy Harrison  
 cindy.harrison@cummins.com  
 T: (613)736-1146  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.