



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	ABNORMAL

Area
HRM WATER TREATMENT [6100287098]

Machine Id
MTU 5362003457

Component
Diesel Engine

Fluid
SHELL ROTELLA T 15W40 (--- LTR)

RECOMMENDATION

The oil change at the time of sampling has been noted. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. The fluid was specified as SHELL ROTELLA T 15W40, however, a fluid match indicates that this fluid is SAE 10W30 Diesel Engine Oil. Please confirm the oil type and grade on your next sample.

WEAR

Metal levels are typical for a new component breaking in.

CONTAMINATION

There is a moderate amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

FLUID CONDITION














This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The oil is no longer serviceable due to the presence of contaminants.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0020836	WA0018993	WA0015348
Sample Date		Client Info		11 Jun 2024	07 Nov 2022	05 Mar 2020
Machine Age	hrs	Client Info		640	604	474
Oil Age	hrs	Client Info		0	100	0
Filter Age	hrs	Client Info		0	100	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	ABNORMAL	MARGINAL

Iron	ppm	ASTM D5185(m)	>100	7	29	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	<1
Nickel	ppm	ASTM D5185(m)	>4	0	<1	0
Titanium	ppm	ASTM D5185(m)		0	<1	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	1
Lead	ppm	ASTM D5185(m)	>40	<1	<1	<1
Copper	ppm	ASTM D5185(m)	>330	1	2	2
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

Silicon	ppm	ASTM D5185(m)	>25	3	3	2
Potassium	ppm	ASTM D5185(m)	>20	<1	2	5
Fuel	%	ASTM D7593*	>5	▲ 7.3	▲ 6	▲ 3.7
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.4	6.7	6.8
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.1	17.5	23.1
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

Sodium	ppm	ASTM D5185(m)		5	4	2
Boron	ppm	ASTM D5185(m)	35	7	29	137
Barium	ppm	ASTM D5185(m)	0	0	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	46	1	<1
Manganese	ppm	ASTM D5185(m)	0	0	<1	<1
Magnesium	ppm	ASTM D5185(m)	10	766	17	11
Calcium	ppm	ASTM D5185(m)	2340	1167	2269	2263
Phosphorus	ppm	ASTM D5185(m)	1110	924	968	1039
Zinc	ppm	ASTM D5185(m)	1210	1092	1015	1148
Sulfur	ppm	ASTM D5185(m)	3890	2565	3111	3270
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.4	10.8	15.7
Visc @ 40°C	cSt	ASTM D7279(m)	120.	▲ 77.5	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.7	▲ 11.8	▲ 11.8	12.7
Viscosity Index (VI)	Scale	ASTM D2270*	139	146	---	---

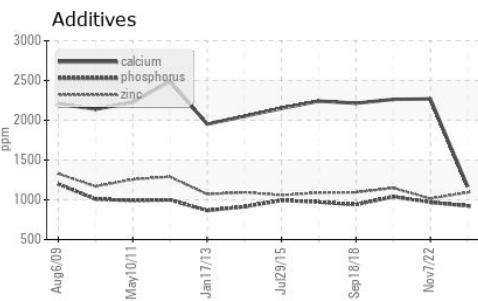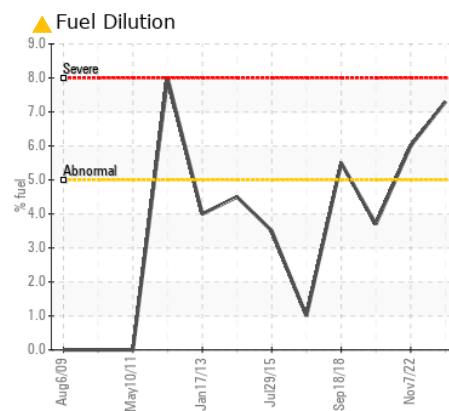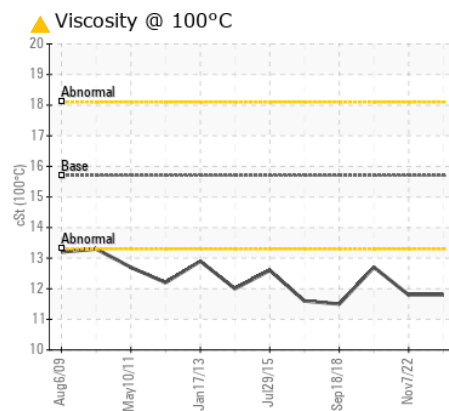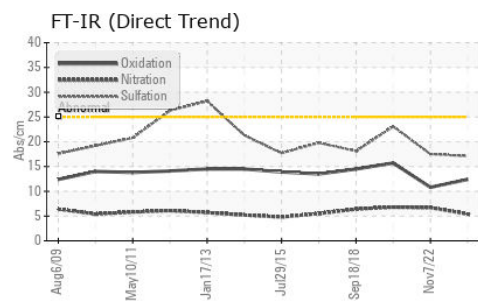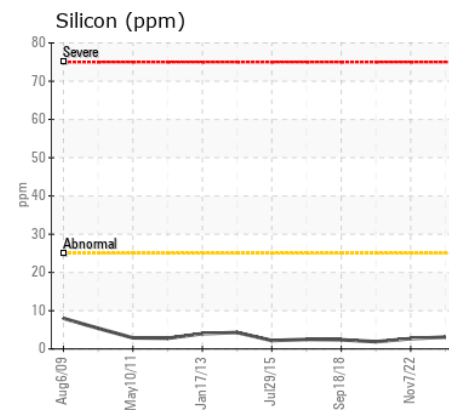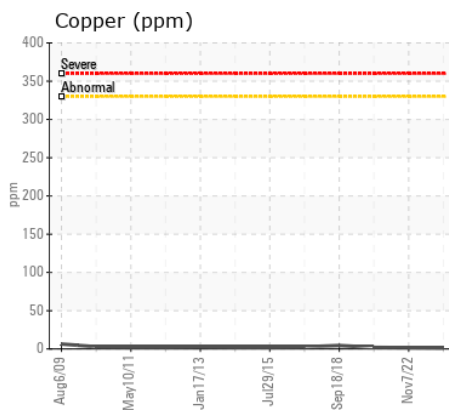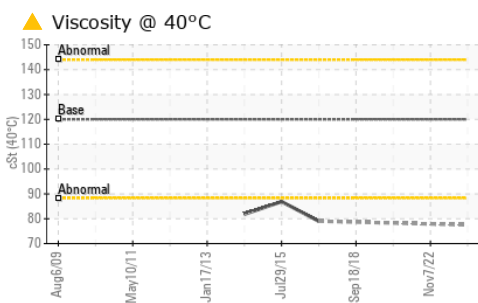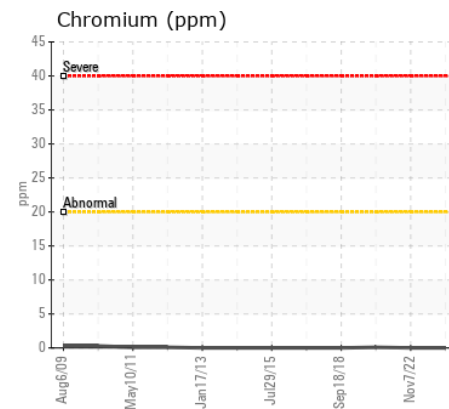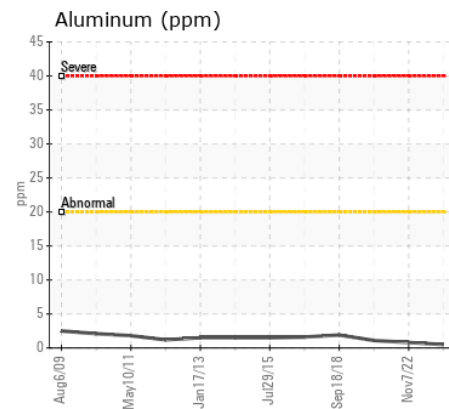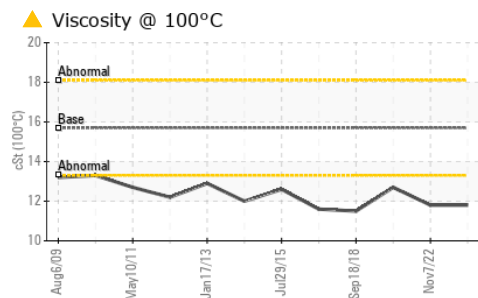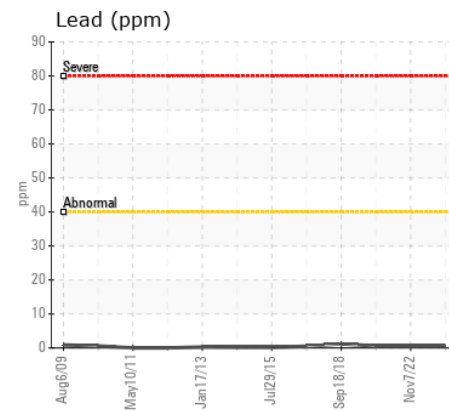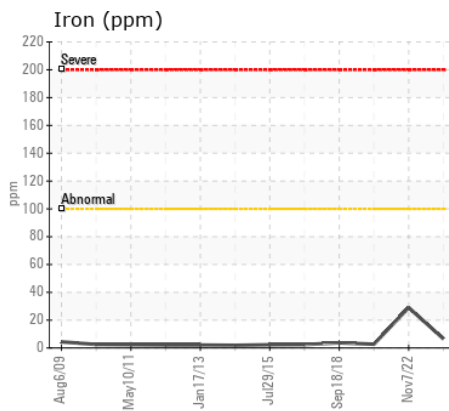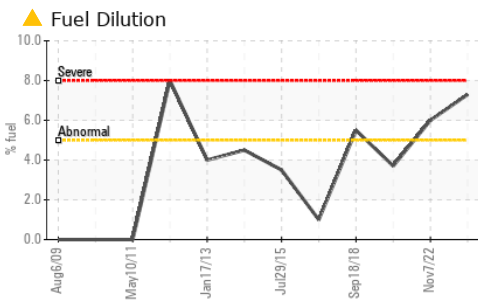

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0020836 **Received** : 17 Jun 2024
Lab Number : 02642267 **Tested** : 18 Jun 2024
Unique Number : 5799806 **Diagnosed** : 18 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: KV40, PercentFuel, VI, Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325