



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

BRADFORD PARAMEDIC [152227-1ST LOAD TEST]

Machine Id
22646546
Component
Diesel Engine
Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0022816	---	---
Sample Date		Client Info		13 Jun 2024	---	---
Machine Age	hrs	Client Info		13	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	5	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>2	<1	---	---
Titanium	ppm	ASTM D5185(m)	>2	0	---	---
Silver	ppm	ASTM D5185(m)	>2	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	0	---	---
Copper	ppm	ASTM D5185(m)	>330	7	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	19	---	---
Potassium	ppm	ASTM D5185(m)	>20	<1	---	---
Fuel		WC Method	>3.0	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>6	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.0	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	20.9	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		4	---	---
Boron	ppm	ASTM D5185(m)		42	---	---
Barium	ppm	ASTM D5185(m)		2	---	---
Molybdenum	ppm	ASTM D5185(m)		43	---	---
Manganese	ppm	ASTM D5185(m)		2	---	---
Magnesium	ppm	ASTM D5185(m)		719	---	---
Calcium	ppm	ASTM D5185(m)		1083	---	---
Phosphorus	ppm	ASTM D5185(m)		638	---	---
Zinc	ppm	ASTM D5185(m)		757	---	---
Sulfur	ppm	ASTM D5185(m)		1845	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	17.2	---	---
Visc @ 40°C	cSt	ASTM D7279(m)		104	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		14.1	---	---
Viscosity Index (VI)	Scale	ASTM D2270*		137	---	---

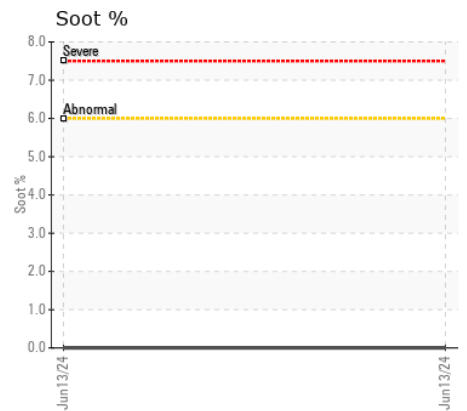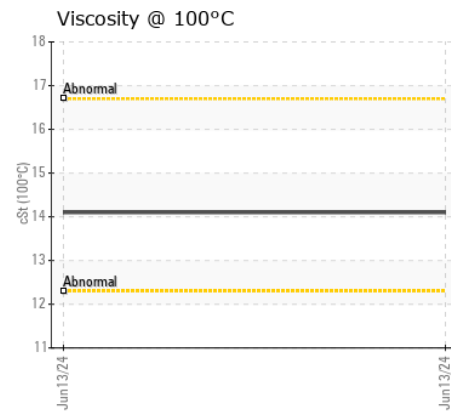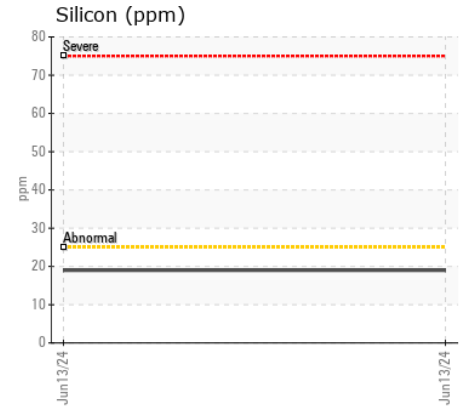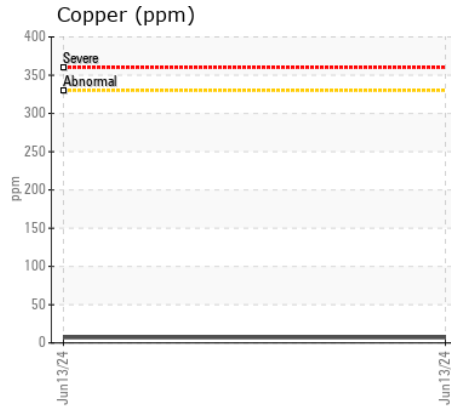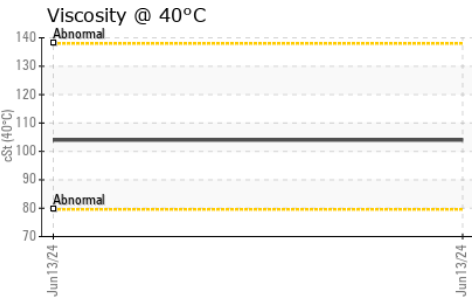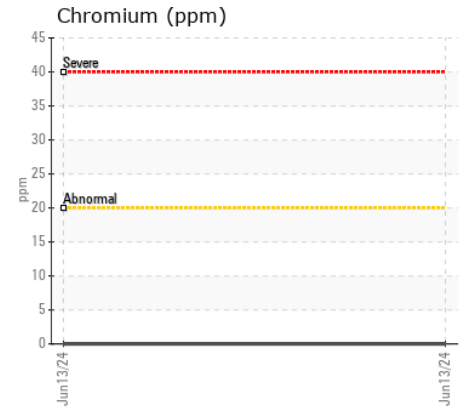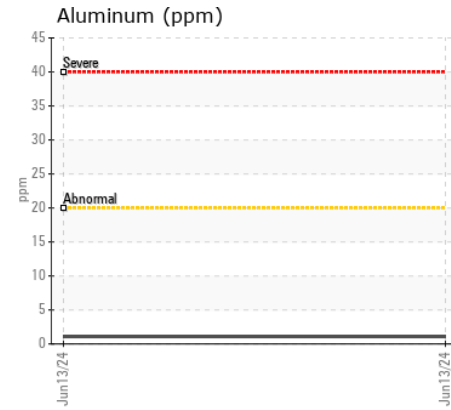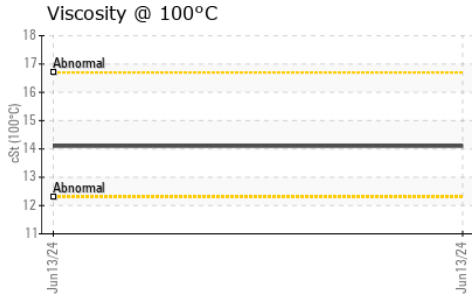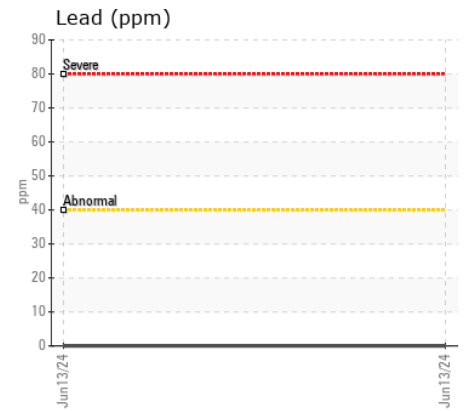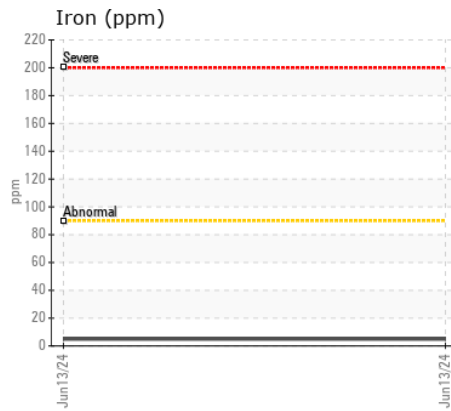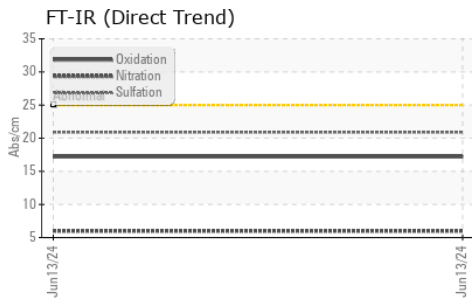

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0022816
Lab Number : 02642274
Unique Number : 5799813
Test Package : MOB 1 (Additional Tests: KV40, VI, Visual)

CUMMINS CANADA ULC - GENERATOR DIVISION
 7175 PACIFIC CIRCLE
 MISSISSAUGA, ON
 CA L5T 2A5
 Contact: Elisia Johnson
 elisia.johnson@cummins.com
 T: (905)795-0050
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.