



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**[6100302919]**  
Machine Id  
**NO UNIT WA0019457**  
Component  
**Diesel Engine**  
Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Veuillez préciser la marque et le modèle du composant lors du prochain échantillon. Veuillez préciser la marque, le type et la viscosité de l'huile lors de votre prochain échantillon.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WA0019457</b>	---	---
Sample Date		Client Info		<b>13 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>N/A</b>	---	---
Filter Changed		Client Info		<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

**WEAR**

Les taux d'usure de tous les composants sont normaux.

Iron	ppm	ASTM D5185(m)	>100	<b>4</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>2</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
White Metal	scalar	Visual*	NONE	<b>LIGHT</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

**CONTAMINATION**














Il n'y a aucun indice de contamination dans l'huile.

Silicon	ppm	ASTM D5185(m)	>25	<b>6</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Fuel		WC Method	>5	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>6.6</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>19.0</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

**FLUID CONDITION**

Le résultat pour le BN indique que la réserve d'alcalinité est acceptable pour l'huile. Le AN est acceptable pour ce fluide. L'état de l'huile permet d'en prolonger l'utilisation.

Sodium	ppm	ASTM D5185(m)		<b>4</b>	---	---
Boron	ppm	ASTM D5185(m)		<b>57</b>	---	---
Barium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>54</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)		<b>981</b>	---	---
Calcium	ppm	ASTM D5185(m)		<b>829</b>	---	---
Phosphorus	ppm	ASTM D5185(m)		<b>932</b>	---	---
Zinc	ppm	ASTM D5185(m)		<b>1091</b>	---	---
Sulfur	ppm	ASTM D5185(m)		<b>2679</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>16.1</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>2.36</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896*		<b>9.87</b>	---	---
Visc @ 40°C	cSt	ASTM D7279(m)		<b>82.5</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		<b>13.5</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270*		<b>166</b>	---	---

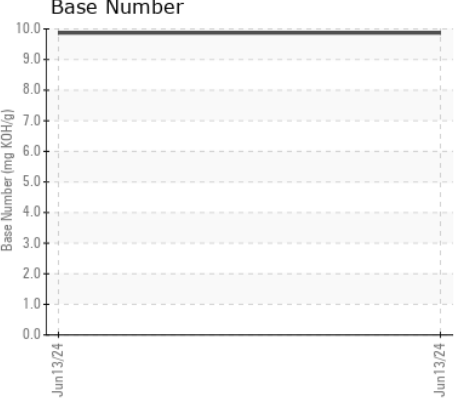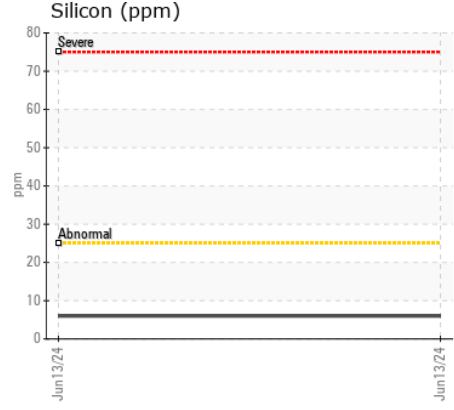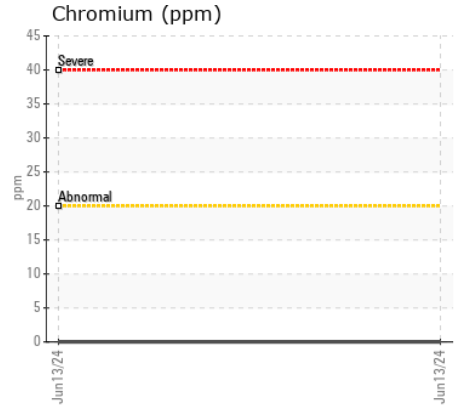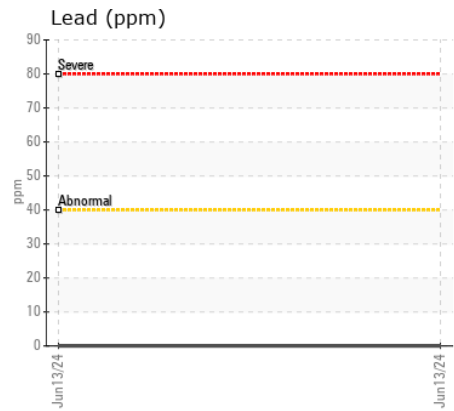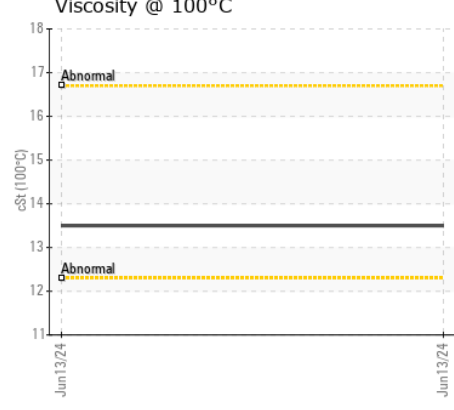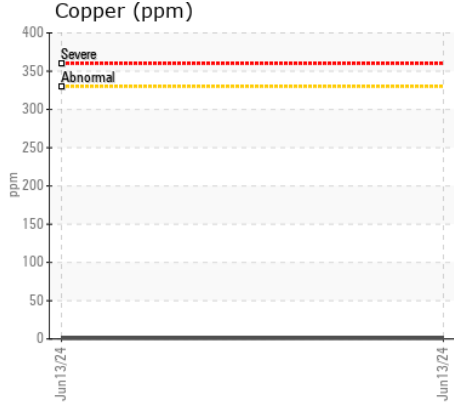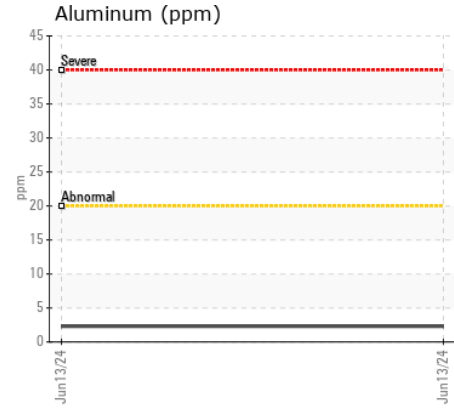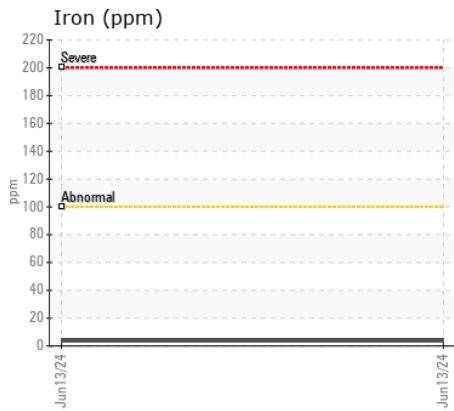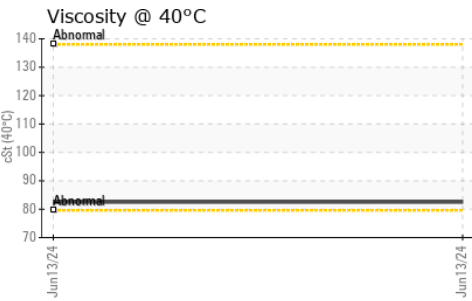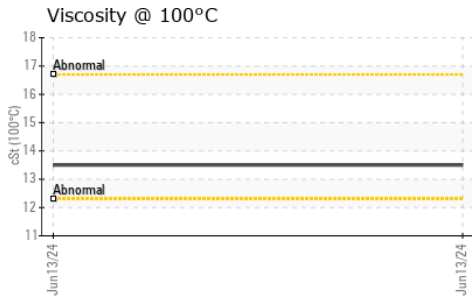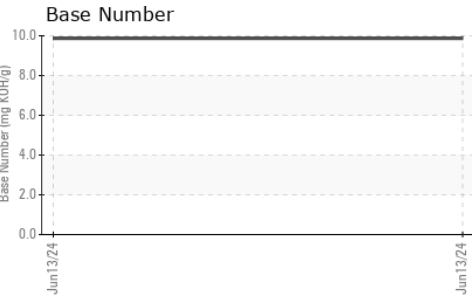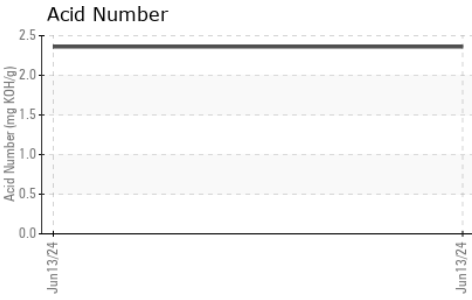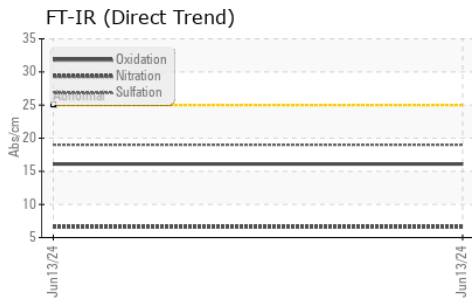

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0019457 **Received** : 17 Jun 2024  
**Lab Number** : 02642305 **Tested** : 18 Jun 2024  
**Unique Number** : 5799844 **Diagnosed** : 18 Jun 2024 - Wes Davis  
**Test Package** : MOB 2 ( Additional Tests: KV40, TAN Auto, TAN Man, VI, Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Limited**  
 2997 AV. WATT  
 Quebec, QC  
 CA G1X 3W1  
 Contact: Steve Racine  
 sracine@wajax.com  
 T:  
 F: (418)651-4448