



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
10 REGIONAL RD 21
 Component
Diesel Engine
 Fluid
PETRO CANADA XR 4 SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0940200	WC0849158	WC0817460
Sample Date		Client Info		11 Jun 2024	25 Jan 2024	31 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	5	7	15
Chromium	ppm	ASTM D5185(m)	>20	0	<1	<1
Nickel	ppm	ASTM D5185(m)	>4	<1	<1	0
Titanium	ppm	ASTM D5185(m)		<1	0	<1
Silver	ppm	ASTM D5185(m)	>3	<1	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	2	2
Lead	ppm	ASTM D5185(m)	>40	<1	1	1
Copper	ppm	ASTM D5185(m)	>330	2	4	6
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0

CONTAMINATION













There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	4	6	10
Potassium	ppm	ASTM D5185(m)	>20	24	2	4
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol	%	ASTM D7922*		0.0	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.6	5.0	5.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.7	20.0	19.9
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		9	2	4
Boron	ppm	ASTM D5185(m)	1	8	19	38
Barium	ppm	ASTM D5185(m)	1	<1	0	<1
Molybdenum	ppm	ASTM D5185(m)	1	57	52	50
Manganese	ppm	ASTM D5185(m)		<1	0	<1
Magnesium	ppm	ASTM D5185(m)	10	865	646	394
Calcium	ppm	ASTM D5185(m)	3032	1152	1500	2026
Phosphorus	ppm	ASTM D5185(m)	1054	985	988	1095
Zinc	ppm	ASTM D5185(m)	1332	1117	1095	1185
Sulfur	ppm	ASTM D5185(m)	3985	2728	2920	2968
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.7	16.3	14.6
Visc @ 40°C	cSt	ASTM D7279(m)	117.7	99.6	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.4	13.5	13.5
Viscosity Index (VI)	Scale	ASTM D2270*	138	133	---	---

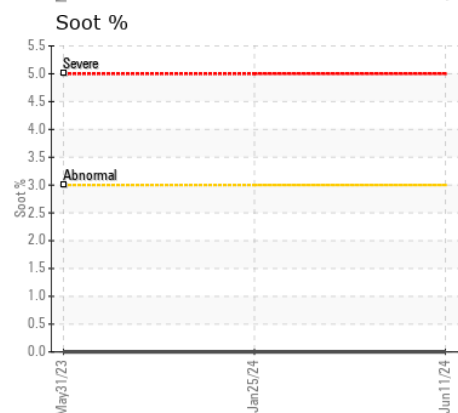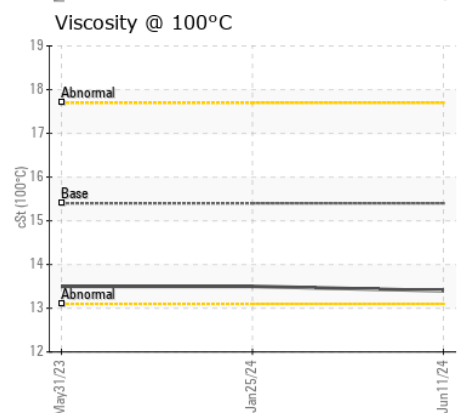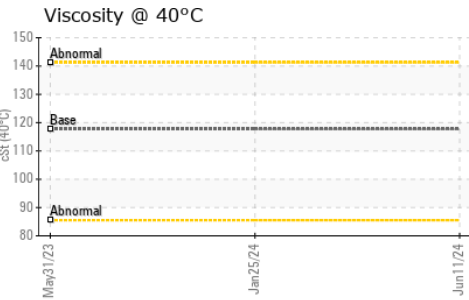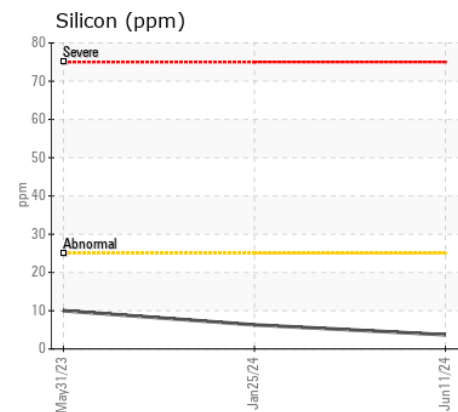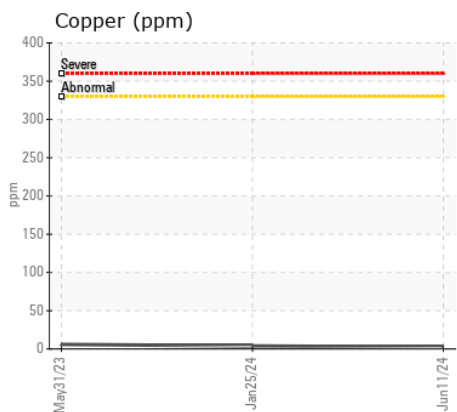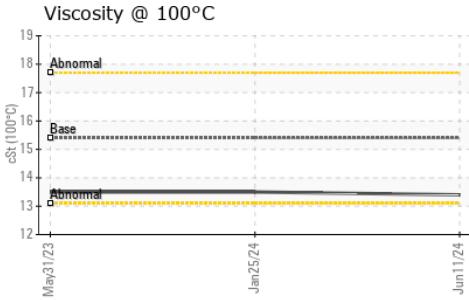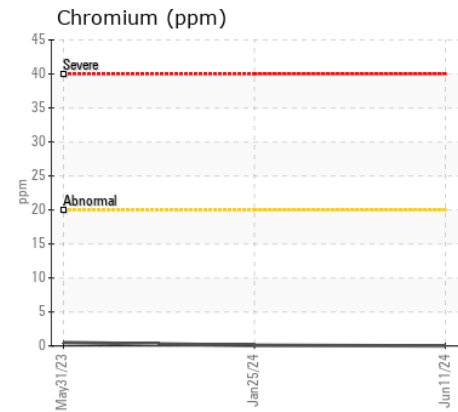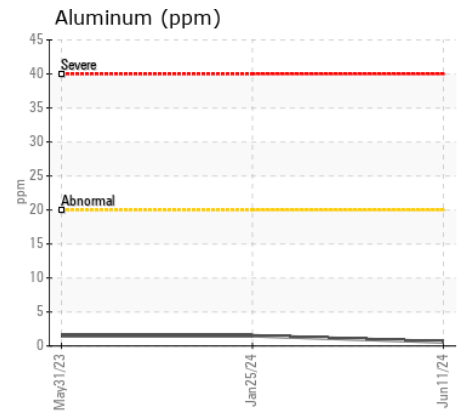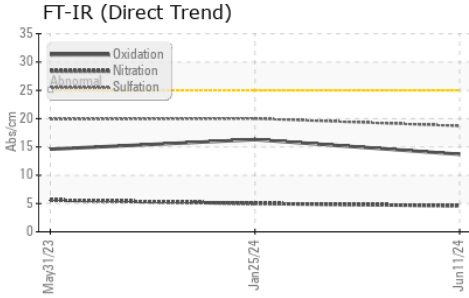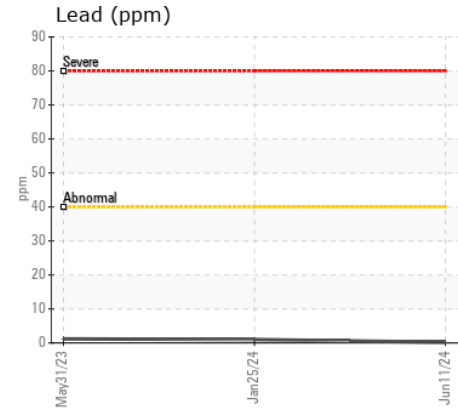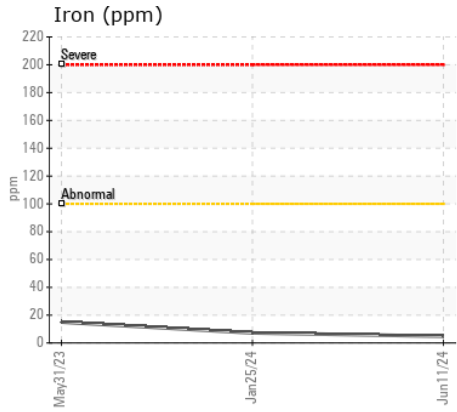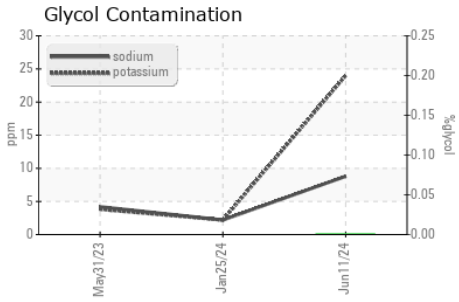

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0940200
Lab Number : 02643121
Unique Number : 5800660
Test Package : MOB 1 (Additional Tests: Glycol, KV40, VI)

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5
 Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*