



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
51050 DURHAM RD
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0914902	WC0810830	---
Sample Date		Client Info		14 May 2024	06 Jun 2023	---
Machine Age	hrs	Client Info		0	120	---
Oil Age	hrs	Client Info		0	0	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		N/A	N/A	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	4	2	---
Chromium	ppm	ASTM D5185(m)	>20	0	0	---
Nickel	ppm	ASTM D5185(m)	>4	0	0	---
Titanium	ppm	ASTM D5185(m)		0	<1	---
Silver	ppm	ASTM D5185(m)	>3	0	0	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	1	---
Lead	ppm	ASTM D5185(m)	>40	0	<1	---
Copper	ppm	ASTM D5185(m)	>330	2	1	---
Tin	ppm	ASTM D5185(m)	>15	0	0	---
Vanadium	ppm	ASTM D5185(m)		0	0	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	9	6	---
Potassium	ppm	ASTM D5185(m)	>20	0	<1	---
Fuel		WC Method	>5	<1.0	<1.0	---
Water		WC Method	>0.2	NEG	NEG	---
Glycol		WC Method		NEG	NEG	---
Soot %	%	ASTM D7844*	>3	0	0	---
Nitration	Abs/cm	ASTM D7624*	>20	5.0	4.7	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.5	18.2	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>216	1	1	---
Boron	ppm	ASTM D5185(m)	250	1	2	---
Barium	ppm	ASTM D5185(m)	10	<1	0	---
Molybdenum	ppm	ASTM D5185(m)	100	58	57	---
Manganese	ppm	ASTM D5185(m)		<1	<1	---
Magnesium	ppm	ASTM D5185(m)	450	970	950	---
Calcium	ppm	ASTM D5185(m)	3000	1031	1085	---
Phosphorus	ppm	ASTM D5185(m)	1150	1007	1079	---
Zinc	ppm	ASTM D5185(m)	1350	1190	1169	---
Sulfur	ppm	ASTM D5185(m)	4250	2749	2704	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.2	13.8	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	13.3	14.1	---

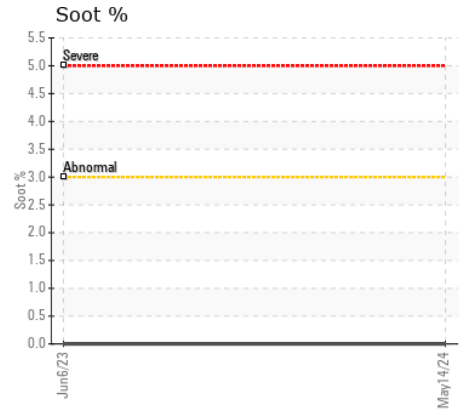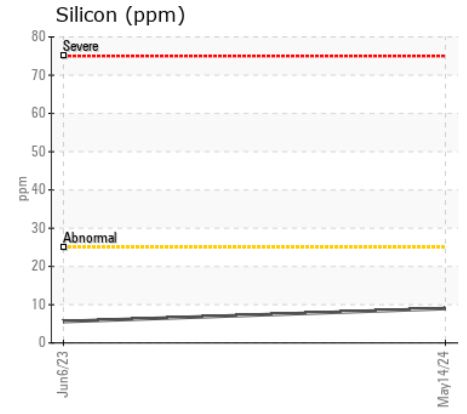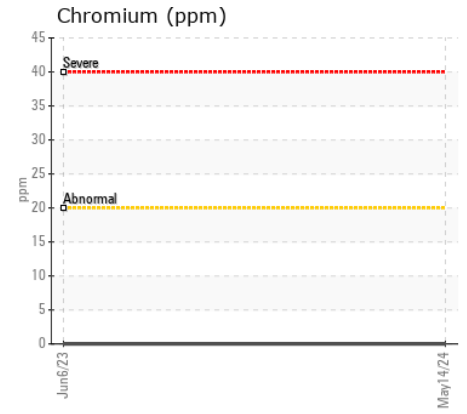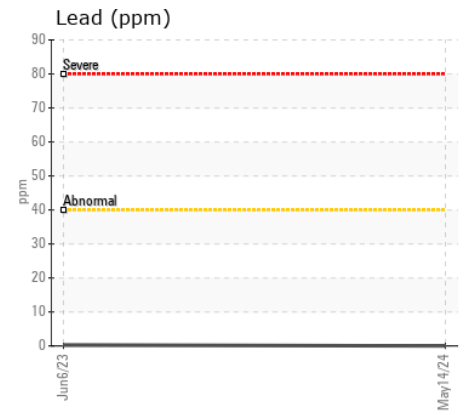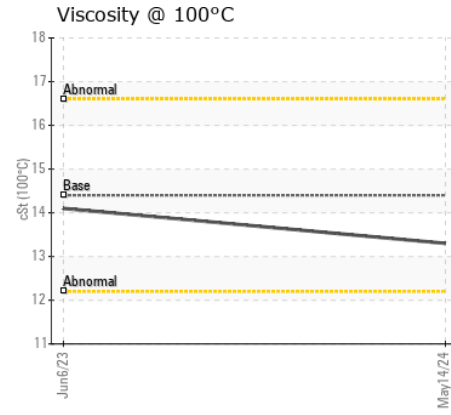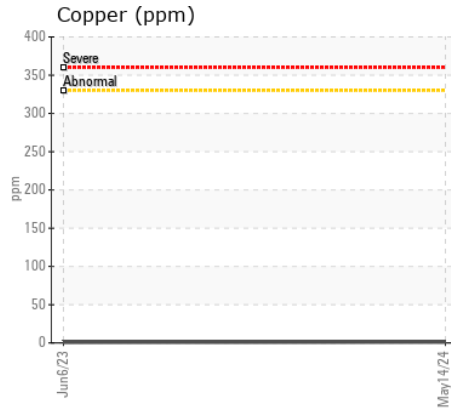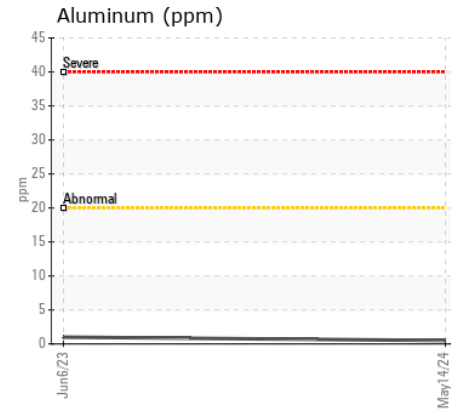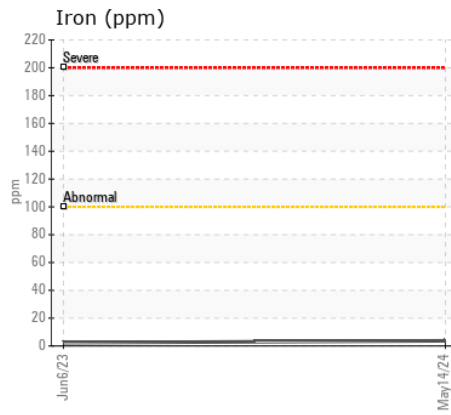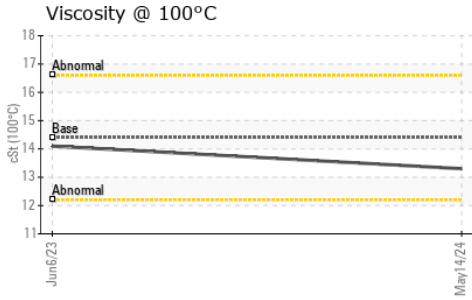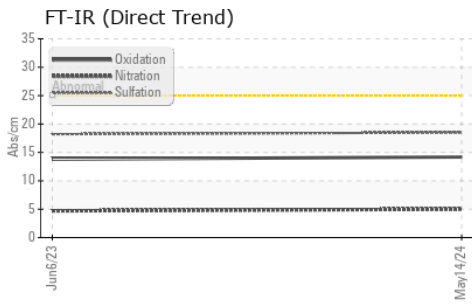

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0914902
Lab Number : 02643131
Unique Number : 5800670
Test Package : MOB 1
Received : 20 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 20 Jun 2024 - Wes Davis

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5
 Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.