



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
UNASSIGNED
Machine Id
299 CAMPBELL
Component
Diesel Engine
Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0914904	---	---
Sample Date		Client Info		17 May 2024	---	---
Machine Age	hrs	Client Info		18	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	4	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	<1	---	---
Aluminum	ppm	ASTM D5185(m)	>20	2	---	---
Lead	ppm	ASTM D5185(m)	>40	3	---	---
Copper	ppm	ASTM D5185(m)	>330	23	---	---
Tin	ppm	ASTM D5185(m)	>15	<1	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	28	---	---
Potassium	ppm	ASTM D5185(m)	>20	2	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.9	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.2	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	VLITE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		13	---	---
Boron	ppm	ASTM D5185(m)		75	---	---
Barium	ppm	ASTM D5185(m)		11	---	---
Molybdenum	ppm	ASTM D5185(m)		46	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)		33	---	---
Calcium	ppm	ASTM D5185(m)		1644	---	---
Phosphorus	ppm	ASTM D5185(m)		762	---	---
Zinc	ppm	ASTM D5185(m)		901	---	---
Sulfur	ppm	ASTM D5185(m)		2376	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	10.5	---	---
Visc @ 40°C	cSt	ASTM D7279(m)		99.1	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		13.8	---	---
Viscosity Index (VI)	Scale	ASTM D2270*		140	---	---

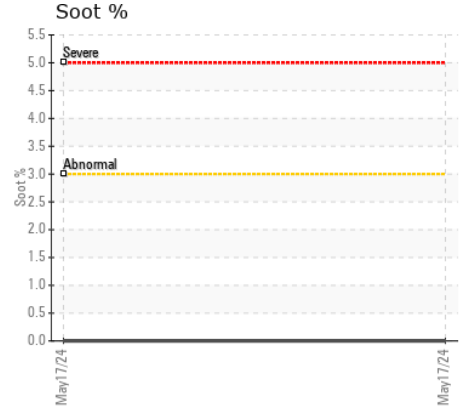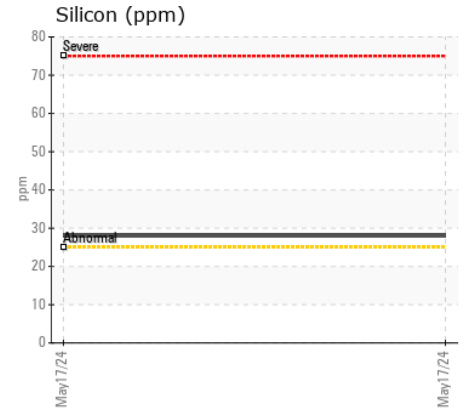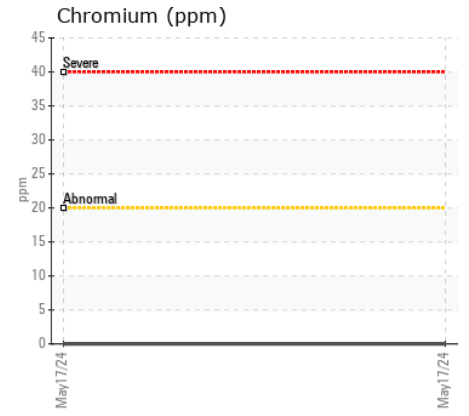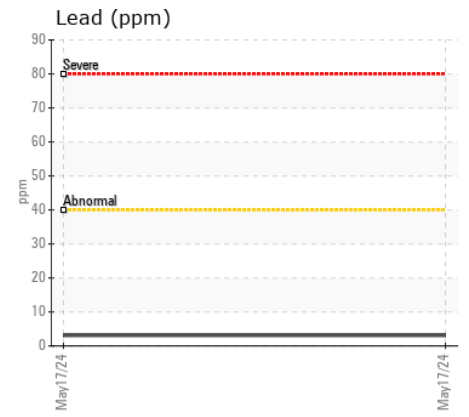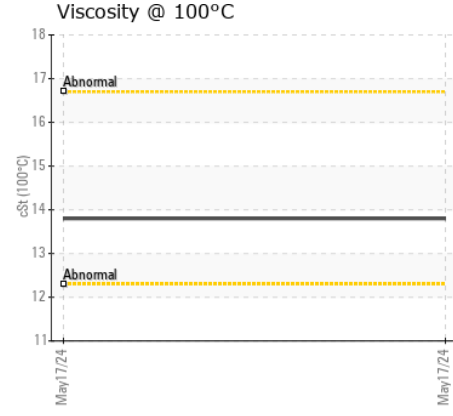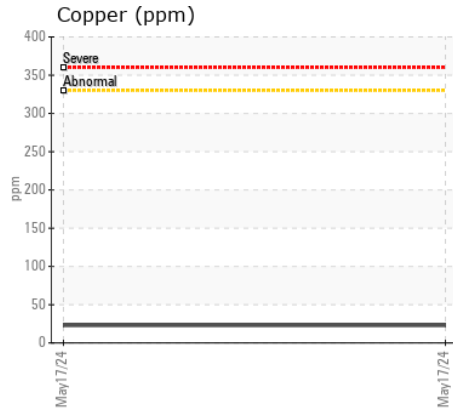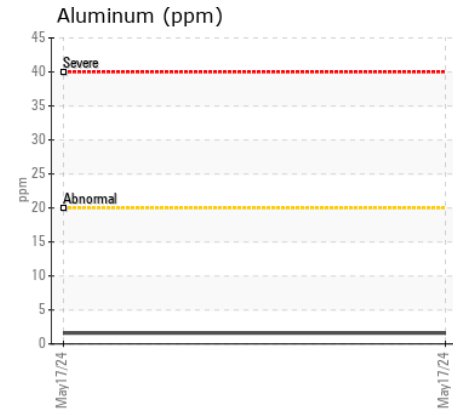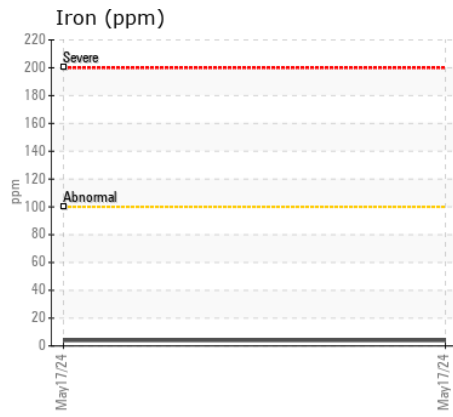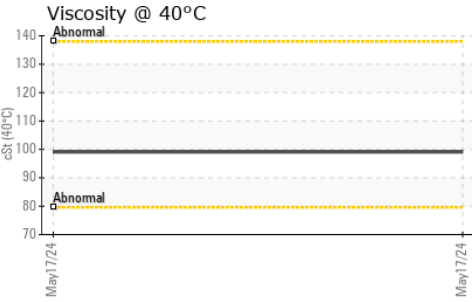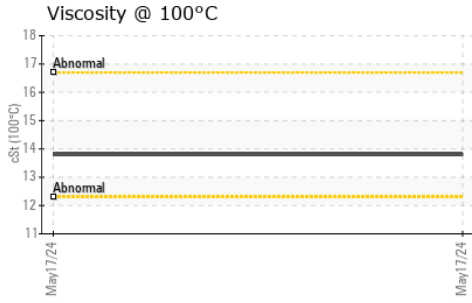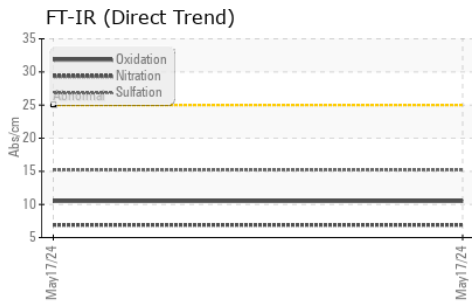

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0914904
Lab Number : 02643163
Unique Number : 5800702
Test Package : MOB 1 (Additional Tests: KV40, VI, Visual)

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE,, UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5
 Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.