



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
UNASSIGNED
Machine Id
292 OAKDALE RD
Component
Diesel Engine
Fluid
PETRO CANADA XR 4 SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0910658	---	---
Sample Date		Client Info		10 May 2024	---	---
Machine Age	hrs	Client Info		6200	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>100	4	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	<1	---	---
Titanium	ppm	ASTM D5185(m)		0	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<1	---	---
Lead	ppm	ASTM D5185(m)	>40	<1	---	---
Copper	ppm	ASTM D5185(m)	>330	<1	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		0	---	---
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION













Tests indicate that there is no fuel present in the oil. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
Fuel	%	ASTM D7593*	>5	0.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	5.0	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.0	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		1	---	---
Boron	ppm	ASTM D5185(m)	1	3	---	---
Barium	ppm	ASTM D5185(m)	1	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	1	58	---	---
Manganese	ppm	ASTM D5185(m)		<1	---	---
Magnesium	ppm	ASTM D5185(m)	10	954	---	---
Calcium	ppm	ASTM D5185(m)	3032	1034	---	---
Phosphorus	ppm	ASTM D5185(m)	1054	975	---	---
Zinc	ppm	ASTM D5185(m)	1332	1170	---	---
Sulfur	ppm	ASTM D5185(m)	3985	2586	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.5	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	117.7	88.3	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	12.6	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	138	139	---	---

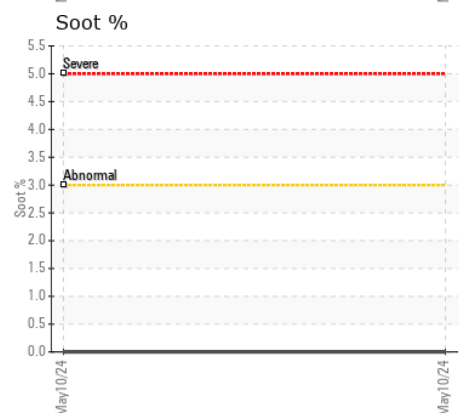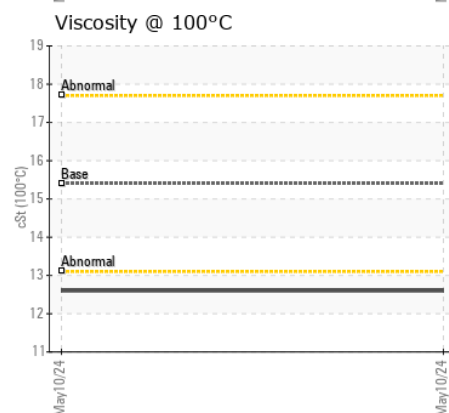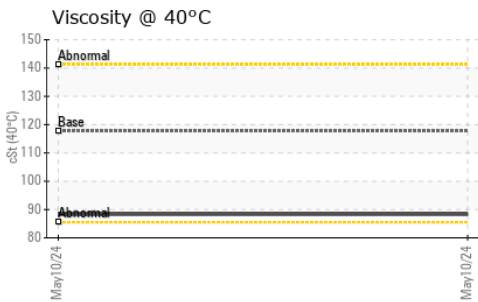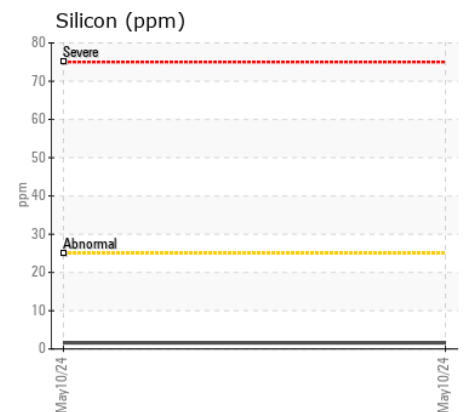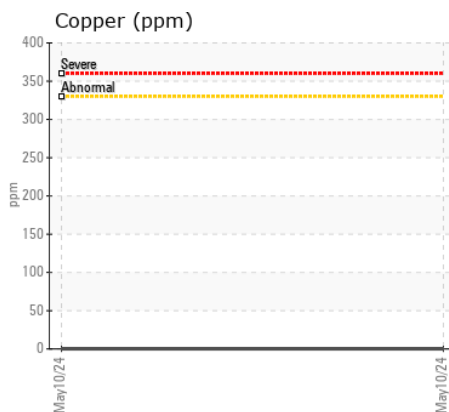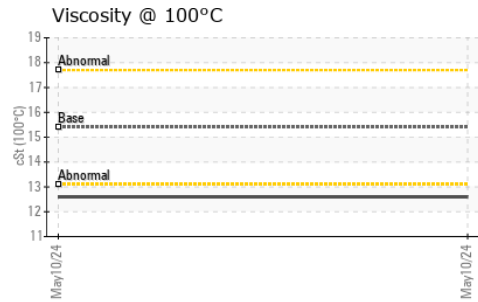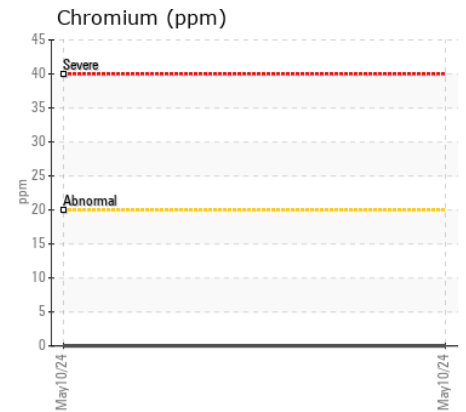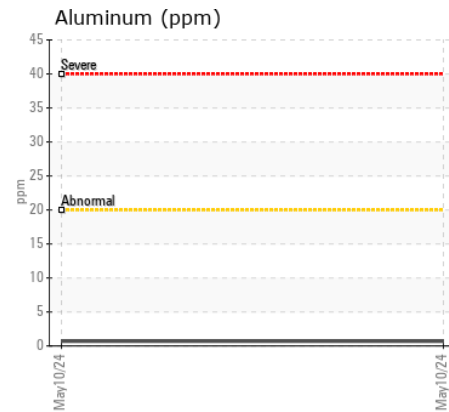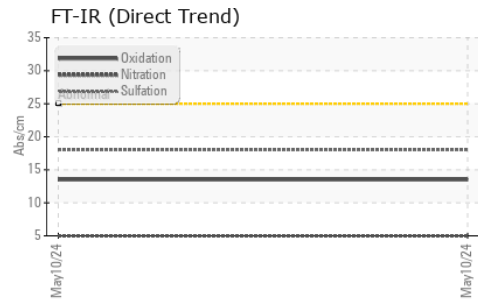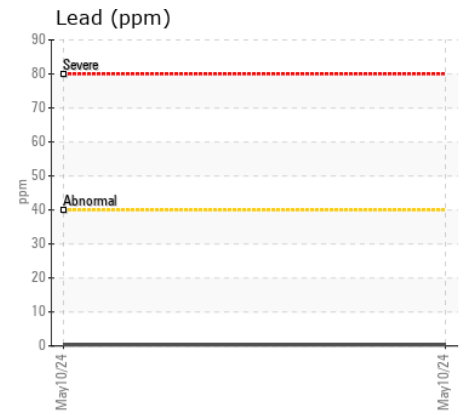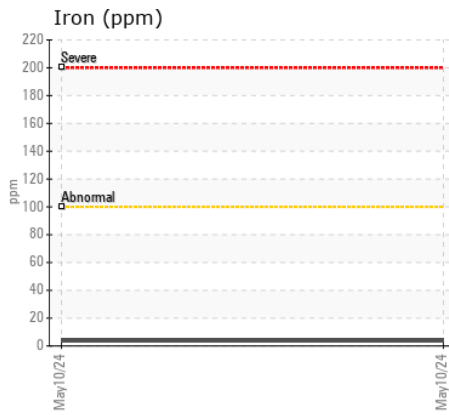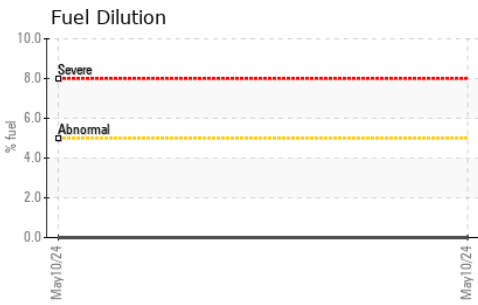

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WC0910658
Lab Number : 02643169
Unique Number : 5800708
Test Package : MOB 1 (Additional Tests: FuelDilution, KV40, PercentFuel, VI, Visual)

NORTHERN GENERATOR CO. LTD.
 80 ASHBRIDGE CIRCLE., UNIT #1 & 2
 WOODBRIDGE, ON
 CA L4L 3R5
 Contact: Selome Afework
 selome@northerngenerator.com
 T: (905)264-9744
 F: (905)264-9714

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.