



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area  
**CFR#41916**  
 Machine Id  
**06D0309701**  
 Component  
**Diesel Engine**  
 Fluid  
**MOBIL DELVAC 1300 SUPER15W40 (--- LTR)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC877040</b>	WC876038	WC874044
Sample Date		Client Info		<b>14 Jun 2024</b>	15 Dec 2020	27 Jan 2014
Machine Age	kms	Client Info		<b>3924</b>	0	426
Oil Age	kms	Client Info		<b>1947</b>	758	0
Filter Age	kms	Client Info		<b>1947</b>	758	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>101	<b>182</b>	53	15
Chromium	ppm	ASTM D5185(m)	>16	<b>5</b>	2	<1
Nickel	ppm	ASTM D5185(m)	>6	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185(m)	>2	<b>2</b>	15	0
Silver	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>21	<b>2</b>	2	2
Lead	ppm	ASTM D5185(m)	>41	<b>5</b>	6	7
Copper	ppm	ASTM D5185(m)	>21	<b>36</b>	24	15
Tin	ppm	ASTM D5185(m)	>13	<b>15</b>	4	24
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	<1	<1

## CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>16	<b>16</b>	11	23
Potassium	ppm	ASTM D5185(m)	>20	<b>3</b>	2	4
Fuel		WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>0.8	<b>1.1</b>	0.2	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>7.7</b>	5.0	5.7
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>19.7</b>	17.2	19.6
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

## FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		<b>11</b>	12	16
Boron	ppm	ASTM D5185(m)	0	<b>27</b>	18	2
Barium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185(m)	0	<b>56</b>	46	<1
Manganese	ppm	ASTM D5185(m)		<b>2</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	0	<b>695</b>	771	601
Calcium	ppm	ASTM D5185(m)		<b>1399</b>	1240	1417
Phosphorus	ppm	ASTM D5185(m)		<b>966</b>	995	949
Zinc	ppm	ASTM D5185(m)		<b>1178</b>	1195	1153
Sulfur	ppm	ASTM D5185(m)		<b>2610</b>	2876	3597
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.5</b>	12.8	12.3
Visc @ 100°C	cSt	ASTM D7279(m)	15.0	<b>13.6</b>	13.2	13.3

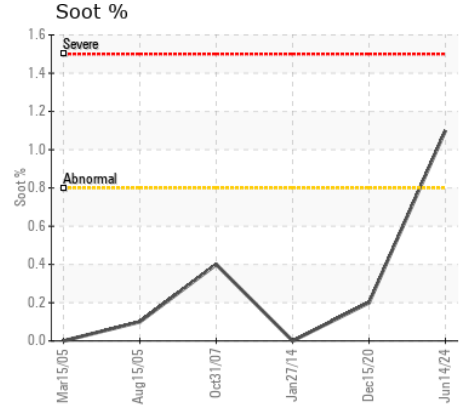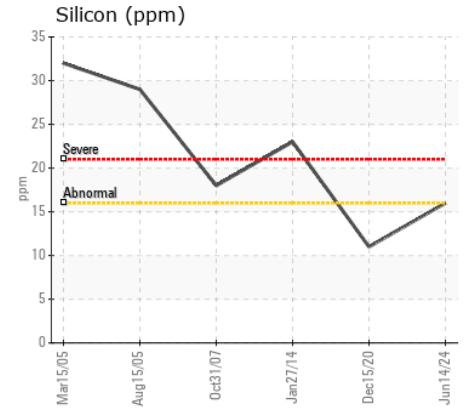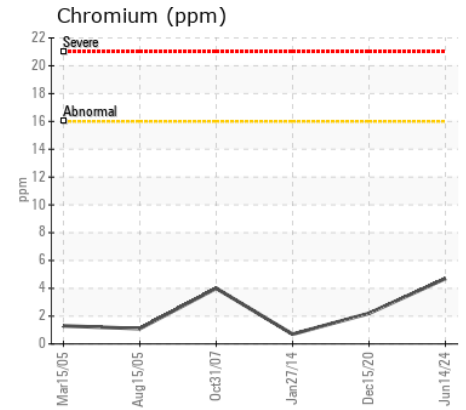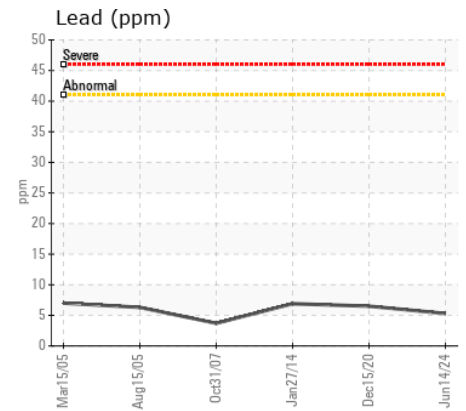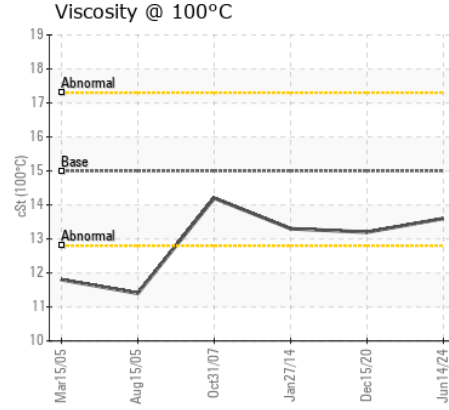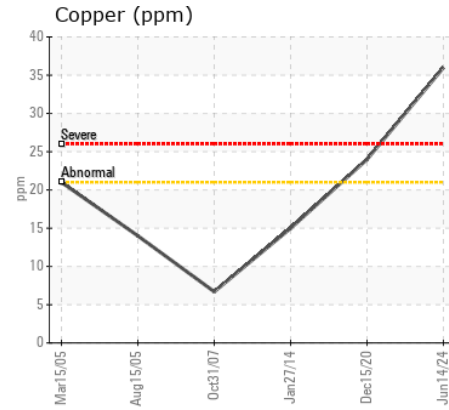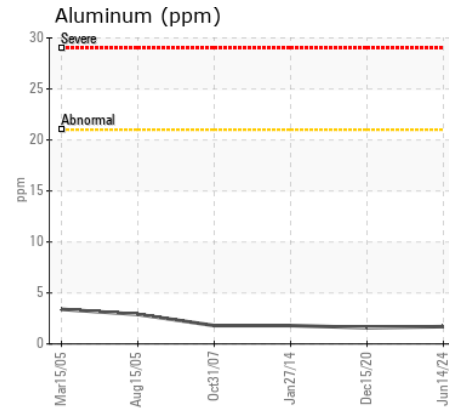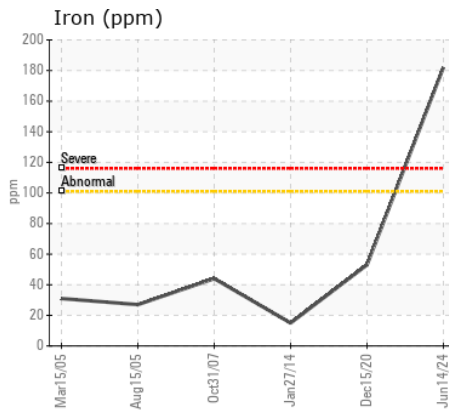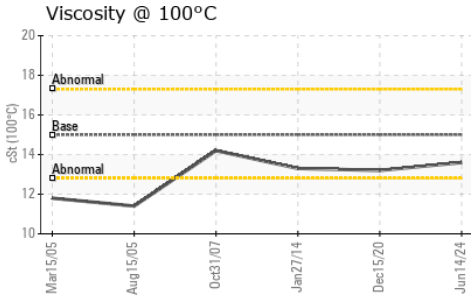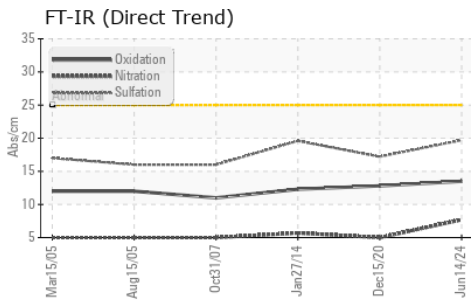

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC877040  
**Lab Number** : 02643335  
**Unique Number** : 5800874  
**Test Package** : MOB 1

**Received** : 21 Jun 2024  
**Tested** : 21 Jun 2024  
**Diagnosed** : 21 Jun 2024 - Kevin Marson

**DEPARTMENT OF NATIONAL DEFENSE**  
 MGEN.GEORGE R.PEARKE'S BUILDING  
 OTTAWA, ON  
 CA K1A 0K2  
 Contact: Jean-Marc Beaudoin  
 JEAN-MARC.BEAUDOIN@Forces.gc.ca  
 T: (819)993-0911  
 F: (819)997-9989

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.