



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
SUNGUARD [156134]
 Machine Id
G080198124 (S/N G08019B124)
 Component
Diesel Engine
 Fluid
VALVOLINE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CU0023716	---	---
Sample Date		Client Info		18 Jun 2024	---	---
Machine Age	hrs	Client Info		239	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Chngd	---	---
Filter Changed		Client Info		Not Chngd	---	---
Sample Status				NORMAL	---	---

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	3	---	---
Chromium	ppm	ASTM D5185(m)	>20	0	---	---
Nickel	ppm	ASTM D5185(m)	>4	0	---	---
Titanium	ppm	ASTM D5185(m)		21	---	---
Silver	ppm	ASTM D5185(m)	>3	0	---	---
Aluminum	ppm	ASTM D5185(m)	>20	1	---	---
Lead	ppm	ASTM D5185(m)	>40	2	---	---
Copper	ppm	ASTM D5185(m)	>330	6	---	---
Tin	ppm	ASTM D5185(m)	>15	0	---	---
Vanadium	ppm	ASTM D5185(m)		<1	---	---
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	---	---
Potassium	ppm	ASTM D5185(m)	>20	0	---	---
Fuel		WC Method	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	ASTM D7844*	>3	0	---	---
Nitration	Abs/cm	ASTM D7624*	>20	6.1	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	15.4	---	---
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	---	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---	---

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		3	---	---
Boron	ppm	ASTM D5185(m)	39	4	---	---
Barium	ppm	ASTM D5185(m)	1	<1	---	---
Molybdenum	ppm	ASTM D5185(m)	49	44	---	---
Manganese	ppm	ASTM D5185(m)	1	<1	---	---
Magnesium	ppm	ASTM D5185(m)	616	907	---	---
Calcium	ppm	ASTM D5185(m)	1554	1262	---	---
Phosphorus	ppm	ASTM D5185(m)	899	983	---	---
Zinc	ppm	ASTM D5185(m)	1069	1192	---	---
Sulfur	ppm	ASTM D5185(m)	2624	2831	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	11.8	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	90.6	95.9	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	13.6	13.1	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	136	134	---	---

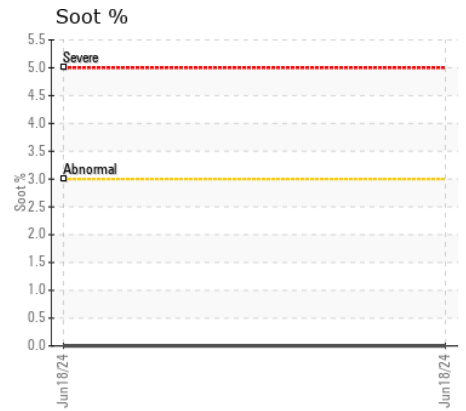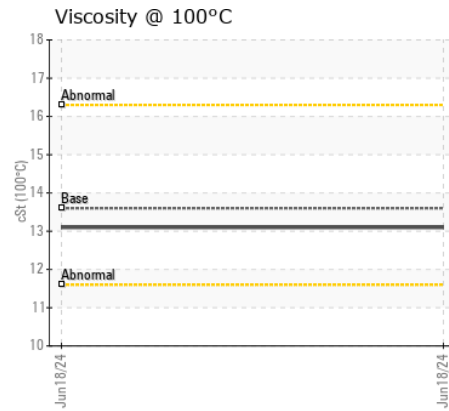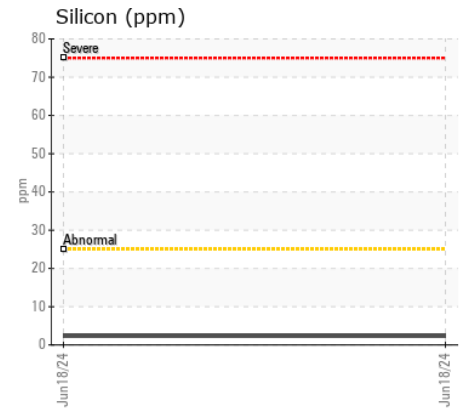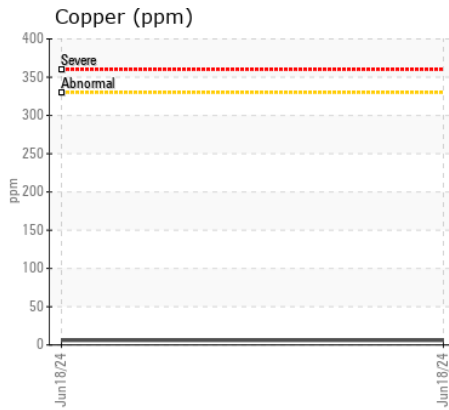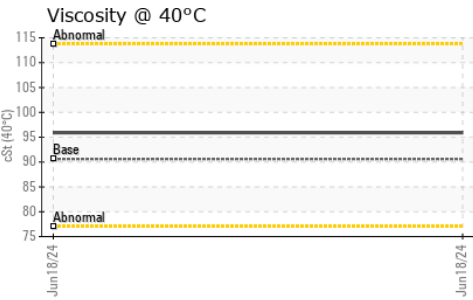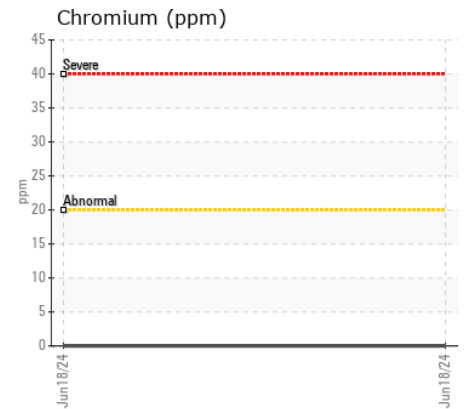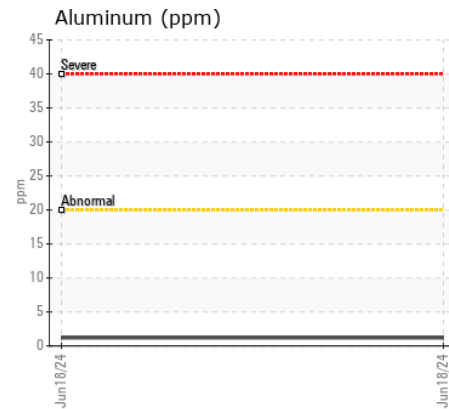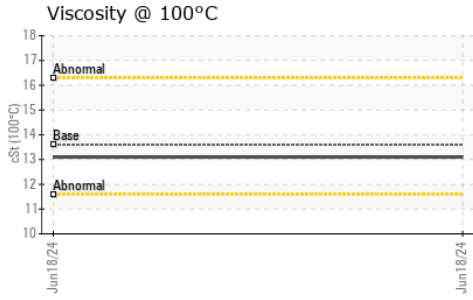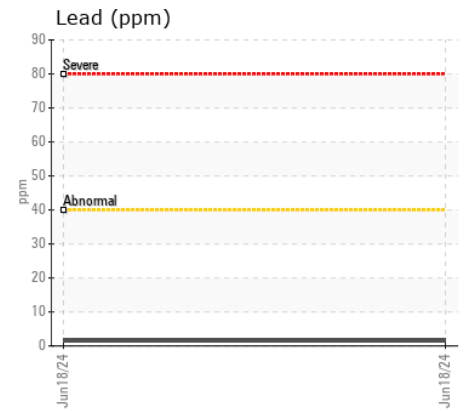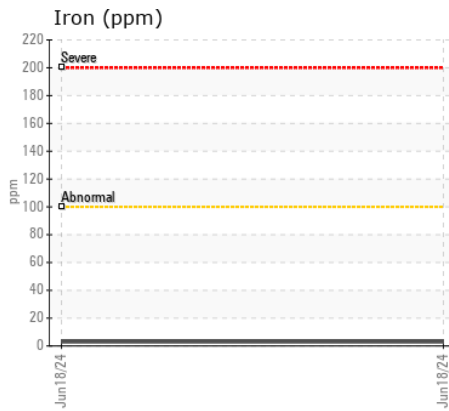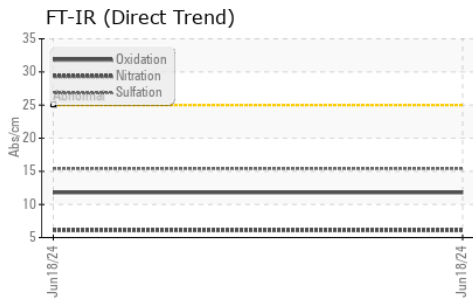

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : CU0023716 **Received** : 21 Jun 2024
Lab Number : 02643352 **Tested** : 25 Jun 2024
Unique Number : 5800891 **Diagnosed** : 25 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: KV40, VI, Visual)

CUMMINS CANADA ULC - GENERATOR DIVISION
 7175 PACIFIC CIRCLE
 MISSISSAUGA, ON
 CA L5T 2A5
 Contact: Elisia Johnson
 elisia.johnson@cummins.com
 T: (905)795-0050
 F: (905)795-9252

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.