



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Area
GFL218
Machine Id
833057
Component
Natural Gas Engine
Fluid
NOT GIVEN (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		GFL0126612	GFL0116354	GFL0107852
Sample Date		Client Info		19 Jun 2024	03 Apr 2024	26 Dec 2023
Machine Age	hrs	Client Info		16231	13296	0
Oil Age	hrs	Client Info		2210	0	0
Filter Age	hrs	Client Info		2210	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185(m)	>50	6	9	14
Chromium	ppm	ASTM D5185(m)	>4	0	0	<1
Nickel	ppm	ASTM D5185(m)	>2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>9	1	1	2
Lead	ppm	ASTM D5185(m)	>30	0	0	<1
Copper	ppm	ASTM D5185(m)	>35	<1	2	4
Tin	ppm	ASTM D5185(m)	>4	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>+100	3	3	8
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0
Water		WC Method	>0.1	NEG	NEG	NEG
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.7	10.9	11.1
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.3	21.4	21.8
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		5	7	7
Boron	ppm	ASTM D5185(m)		32	7	7
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		44	50	55
Manganese	ppm	ASTM D5185(m)		<1	0	1
Magnesium	ppm	ASTM D5185(m)		551	546	510
Calcium	ppm	ASTM D5185(m)		1442	1477	1475
Phosphorus	ppm	ASTM D5185(m)		727	636	625
Zinc	ppm	ASTM D5185(m)		858	891	811
Sulfur	ppm	ASTM D5185(m)		2018	1933	2027
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.5	17.7	18.3
Visc @ 100°C	cSt	ASTM D7279(m)		14.4	14.4	14.4

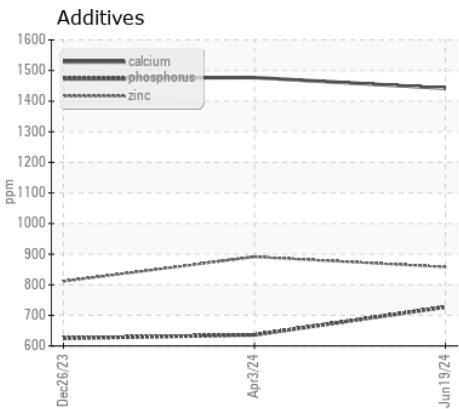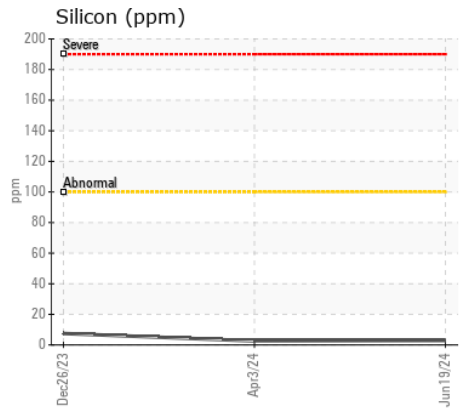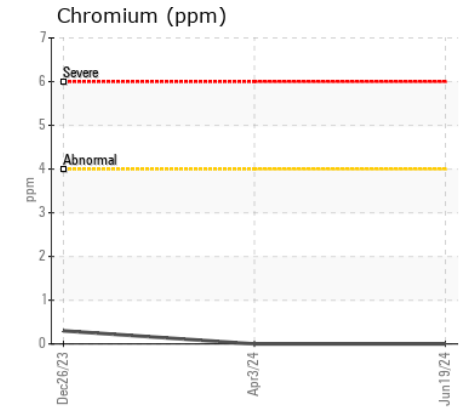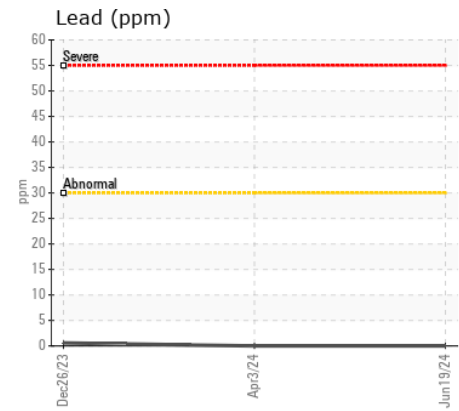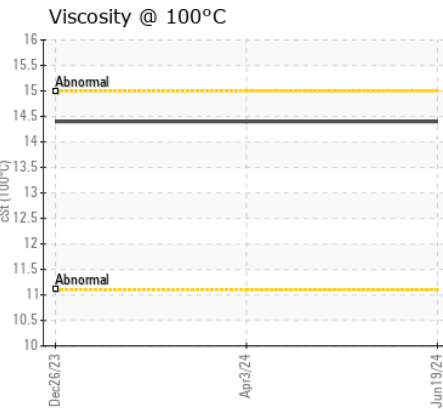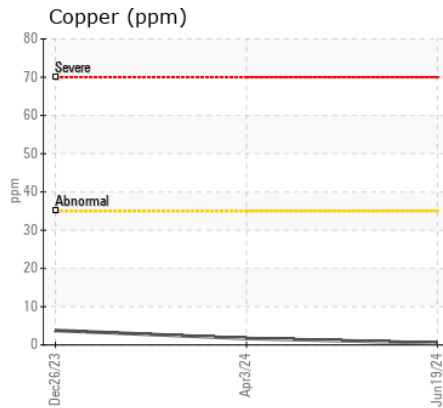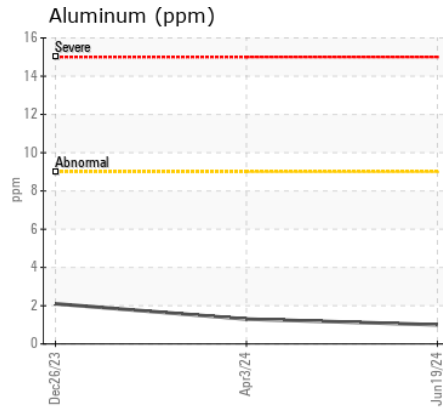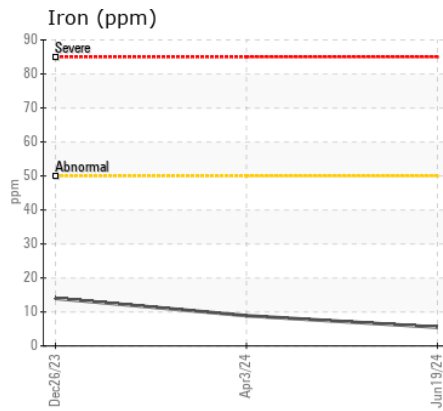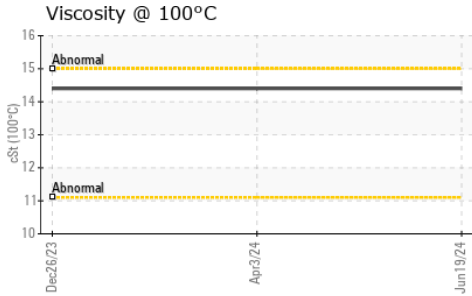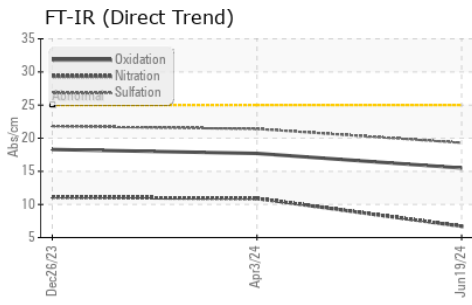

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0126612
Lab Number : 02643360
Unique Number : 5800899
Test Package : MOB 1 (Additional Tests: Visual)

GFL Environmental - 225 - COT(D2)
 20 Brydon Drive
 Etobicoke, ON
 CA M9W 5R6
 Contact: Rick Philip
 rphilip@gflenv.com
 T: (416)745-8080
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.