



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

**OIL ANALYSIS REPORT**

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area

**[6100312836]**

Machine Id

**TYNE VALLEY**

Component

**Diesel Engine**

Fluid

**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) DIESEL ENGINE OIL SAE 15W40. Please confirm.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WA0021758</b>	---	---
Sample Date		Client Info		<b>19 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>213</b>	---	---
Oil Age	hrs	Client Info		<b>17</b>	---	---
Filter Age	hrs	Client Info		<b>17</b>	---	---
Oil Changed		Client Info		<b>Changed</b>	---	---
Filter Changed		Client Info		<b>Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	<b>1</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>1</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

**CONTAMINATION**












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	---	---
Fuel		WC Method	>5	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.0</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.4</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>158	<b>1</b>	---	---
Boron	ppm	ASTM D5185(m)	250	<b>3</b>	---	---
Barium	ppm	ASTM D5185(m)	10	<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185(m)	100	<b>17</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185(m)	450	<b>259</b>	---	---
Calcium	ppm	ASTM D5185(m)	3000	<b>1921</b>	---	---
Phosphorus	ppm	ASTM D5185(m)	1150	<b>896</b>	---	---
Zinc	ppm	ASTM D5185(m)	1350	<b>1032</b>	---	---
Sulfur	ppm	ASTM D5185(m)	4250	<b>2923</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>9.9</b>	---	---
Visc @ 40°C	cSt	ASTM D7279(m)	115	<b>109</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.4	<b>14.5</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270*	126	<b>136</b>	---	---

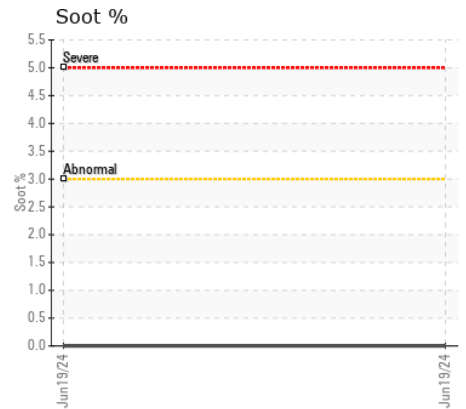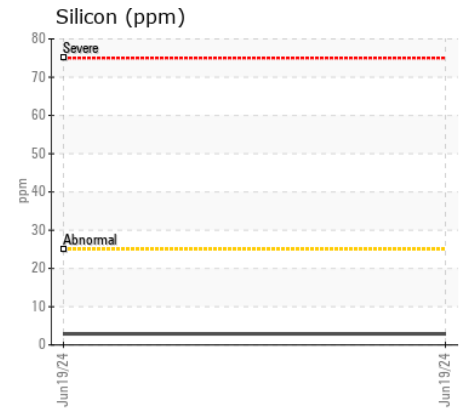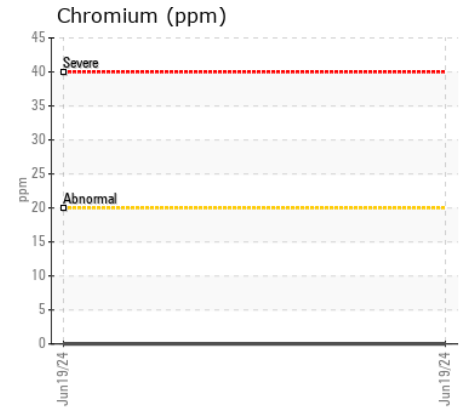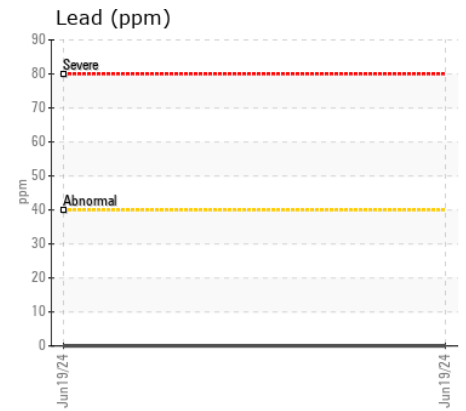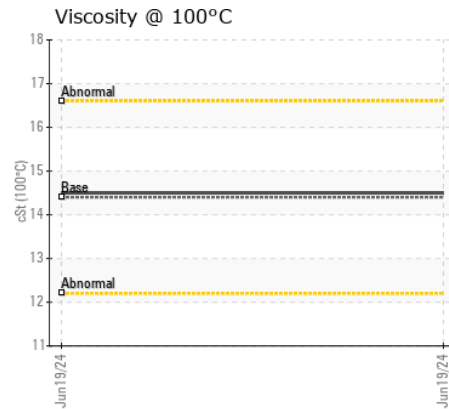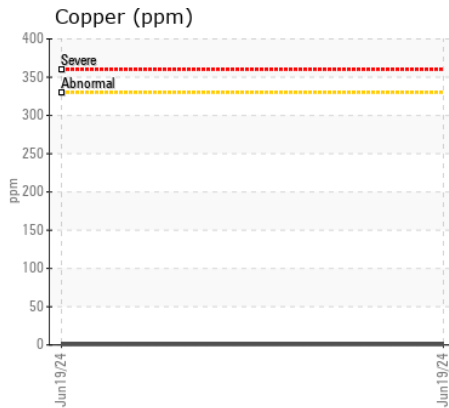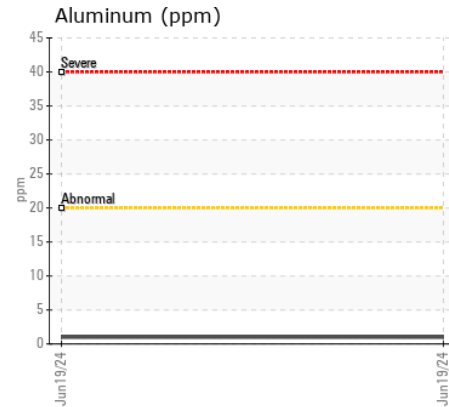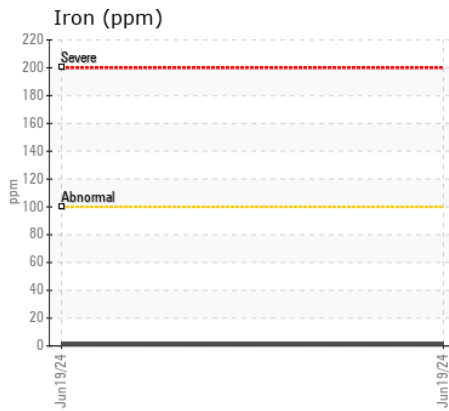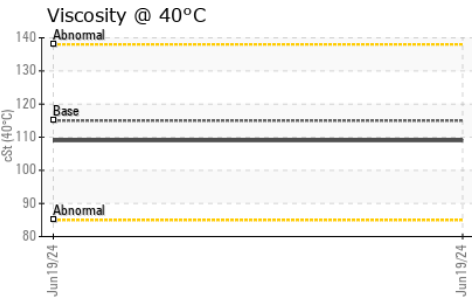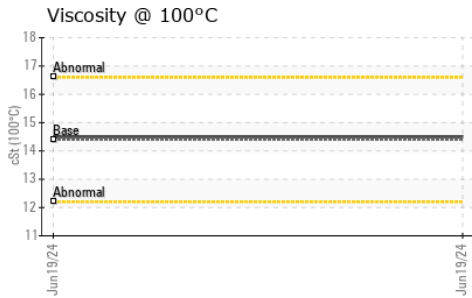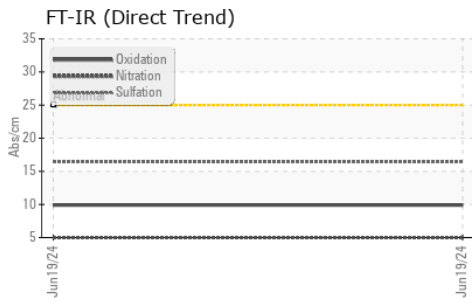

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0021758 **Received** : 21 Jun 2024  
**Lab Number** : 02643368 **Tested** : 21 Jun 2024  
**Unique Number** : 5800907 **Diagnosed** : 21 Jun 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: KV40, VI, Visual )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Wajax Power Systems**  
 485 VENTURE DR  
 MONCTON, NB  
 CA E1H 2P4  
 Contact: Doug Balsler  
 dbalsler@wajax.com  
 T: (506)855-5371  
 F: (506)870-4448