



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Area
[6100291273]

Machine Id
NB POWER BOUCTOUCHE

Component
Diesel Engine

Fluid
SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|----------|----------|
| Sample Number | | Client Info | | WA0021545 | --- | --- |
| Sample Date | | Client Info | | 14 Jun 2024 | --- | --- |
| Machine Age | hrs | Client Info | | 188 | --- | --- |
| Oil Age | hrs | Client Info | | 60 | --- | --- |
| Filter Age | hrs | Client Info | | 60 | --- | --- |
| Oil Changed | | Client Info | | Changed | --- | --- |
| Filter Changed | | Client Info | | Changed | --- | --- |
| Sample Status | | | | NORMAL | --- | --- |

WEAR

Metal levels are typical for a new component breaking in.

| | | | | | | |
|--------------|--------|---------------|------|--------------|-----|-----|
| Iron | ppm | ASTM D5185(m) | >100 | 4 | --- | --- |
| Chromium | ppm | ASTM D5185(m) | >20 | <1 | --- | --- |
| Nickel | ppm | ASTM D5185(m) | >4 | <1 | --- | --- |
| Titanium | ppm | ASTM D5185(m) | | <1 | --- | --- |
| Silver | ppm | ASTM D5185(m) | >3 | <1 | --- | --- |
| Aluminum | ppm | ASTM D5185(m) | >20 | 16 | --- | --- |
| Lead | ppm | ASTM D5185(m) | >40 | 1 | --- | --- |
| Copper | ppm | ASTM D5185(m) | >330 | 3 | --- | --- |
| Tin | ppm | ASTM D5185(m) | >15 | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| White Metal | scalar | Visual* | NONE | NONE | --- | --- |
| Yellow Metal | scalar | Visual* | NONE | VLITE | --- | --- |

CONTAMINATION












Elevated aluminum (Al) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|---------------|-------|----------------|-----|-----|
| Silicon | ppm | ASTM D5185(m) | >25 | 3 | --- | --- |
| Potassium | ppm | ASTM D5185(m) | >20 | 45 | --- | --- |
| Fuel | | WC Method | >5 | <1.0 | --- | --- |
| Water | | WC Method | >0.2 | NEG | --- | --- |
| Glycol | | WC Method | | NEG | --- | --- |
| Soot % | % | ASTM D7844* | >3 | 0 | --- | --- |
| Nitration | Abs/cm | ASTM D7624* | >20 | 4.7 | --- | --- |
| Sulfation | Abs/.1mm | ASTM D7415* | >30 | 18.2 | --- | --- |
| Silt | scalar | Visual* | NONE | NONE | --- | --- |
| Debris | scalar | Visual* | NONE | NONE | --- | --- |
| Sand/Dirt | scalar | Visual* | NONE | NONE | --- | --- |
| Appearance | scalar | Visual* | NORML | NORML | --- | --- |
| Odor | scalar | Visual* | NORML | NORML | --- | --- |
| Emulsified Water | scalar | Visual* | >0.2 | NEG | --- | --- |

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

| | | | | | | |
|----------------------|----------|---------------|------|--------------|-----|-----|
| Sodium | ppm | ASTM D5185(m) | >57 | 5 | --- | --- |
| Boron | ppm | ASTM D5185(m) | | 6 | --- | --- |
| Barium | ppm | ASTM D5185(m) | | <1 | --- | --- |
| Molybdenum | ppm | ASTM D5185(m) | | 57 | --- | --- |
| Manganese | ppm | ASTM D5185(m) | | <1 | --- | --- |
| Magnesium | ppm | ASTM D5185(m) | | 911 | --- | --- |
| Calcium | ppm | ASTM D5185(m) | | 1024 | --- | --- |
| Phosphorus | ppm | ASTM D5185(m) | | 963 | --- | --- |
| Zinc | ppm | ASTM D5185(m) | | 1070 | --- | --- |
| Sulfur | ppm | ASTM D5185(m) | | 2495 | --- | --- |
| Oxidation | Abs/.1mm | ASTM D7414* | >25 | 12.8 | --- | --- |
| Visc @ 40°C | cSt | ASTM D7279(m) | 115 | 109 | --- | --- |
| Visc @ 100°C | cSt | ASTM D7279(m) | 14.5 | 14.5 | --- | --- |
| Viscosity Index (VI) | Scale | ASTM D2270* | 128 | 136 | --- | --- |

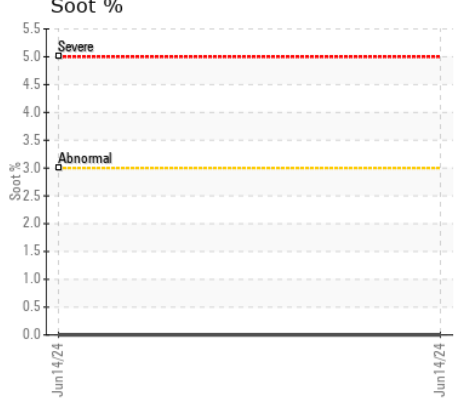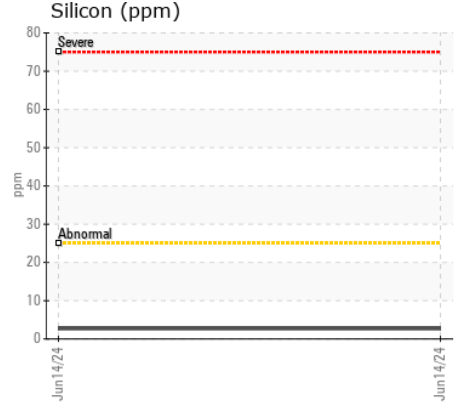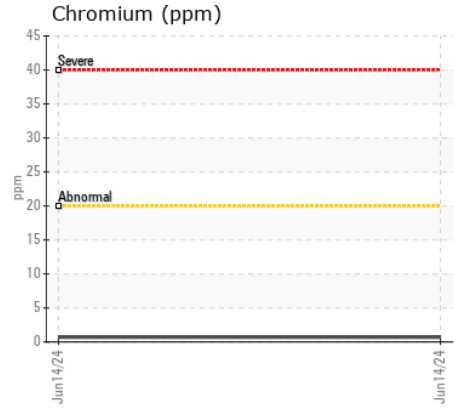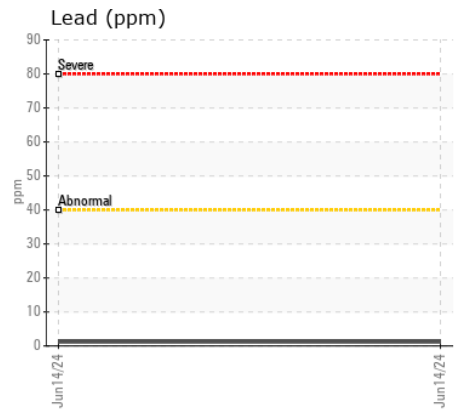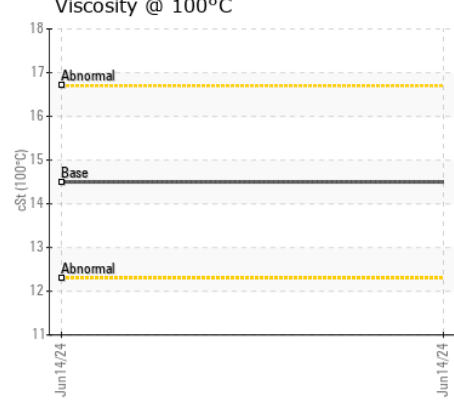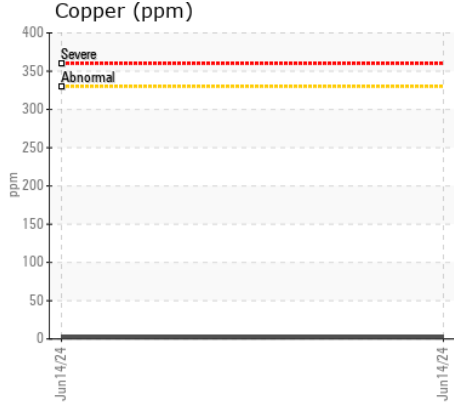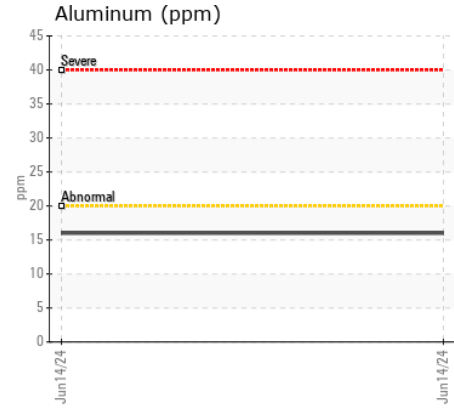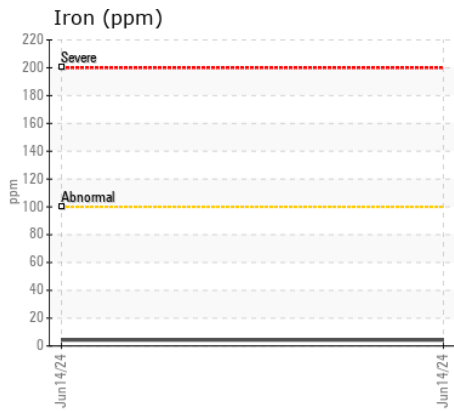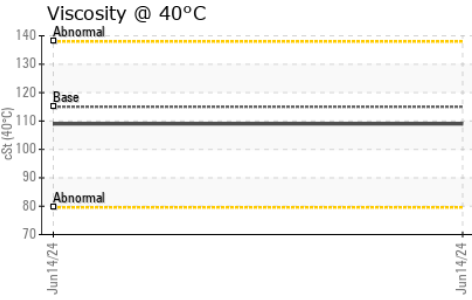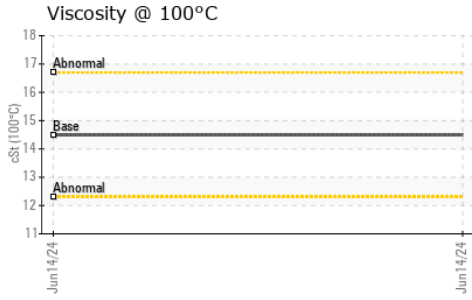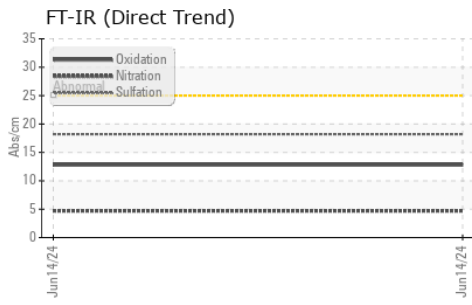

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021545 **Received** : 21 Jun 2024
Lab Number : 02643369 **Tested** : 25 Jun 2024
Unique Number : 5800908 **Diagnosed** : 25 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: KV40, VI, Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 485 VENTURE DR
 MONCTON, NB
 CA E1H 2P4
 Contact: Doug Balsler
 dbalsler@wajax.com
 T: (506)855-5371
 F: (506)870-4448