



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**4280 HARVESTER ROAD BURLINGTON CMS ELECTRICAL 35266856**

Component  
**Right Diesel Engine**

Fluid  
**ESSO XD-3 EXTRA 15W40 (40 LTR)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0006205</b>	PN0004885	PN0003466
Sample Date		Client Info		<b>16 May 2024</b>	09 Jun 2023	16 May 2022
Machine Age	hrs	Client Info		<b>116</b>	98	0
Oil Age	hrs	Client Info		<b>18</b>	0	0
Filter Age	hrs	Client Info		<b>18</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Not Changd
Filter Changed		Client Info		<b>Changed</b>	Changed	Not Changd
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>90	<b>2</b>	1	1
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)	>2	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	>2	<b>2</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	2	2
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185(m)	>330	<b>2</b>	2	2
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---

**CONTAMINATION**











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	9	4
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	<1	<1
Fuel		WC Method	>3.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	ASTM D7844*	>6	<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>5.4</b>	7.7	7.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>17.5</b>	16.7	24.8
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	<b>2</b>	2	4
Boron	ppm	ASTM D5185(m)		<b>14</b>	73	69
Barium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>62</b>	87	77
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>777</b>	35	82
Calcium	ppm	ASTM D5185(m)	3780	<b>1209</b>	2089	2000
Phosphorus	ppm	ASTM D5185(m)	1370	<b>982</b>	1093	910
Zinc	ppm	ASTM D5185(m)	1500	<b>1136</b>	1121	1153
Sulfur	ppm	ASTM D5185(m)	3800	<b>2657</b>	3180	2991
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>13.3</b>	12.9	21.7
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	<b>14.6</b>	14.2	14.3

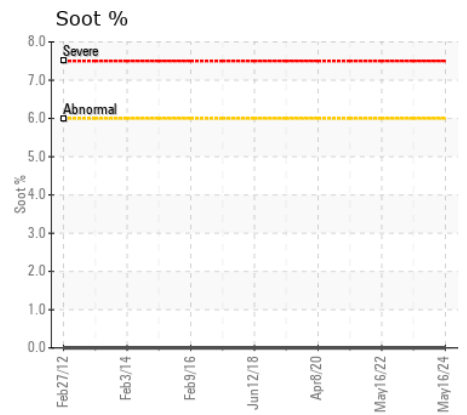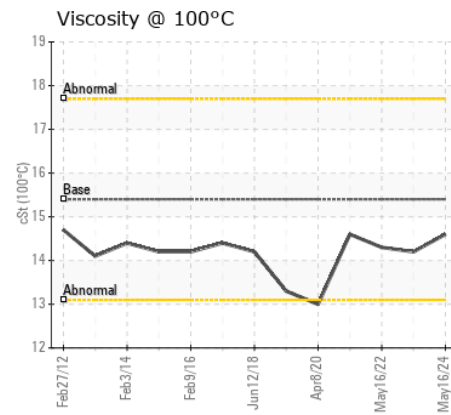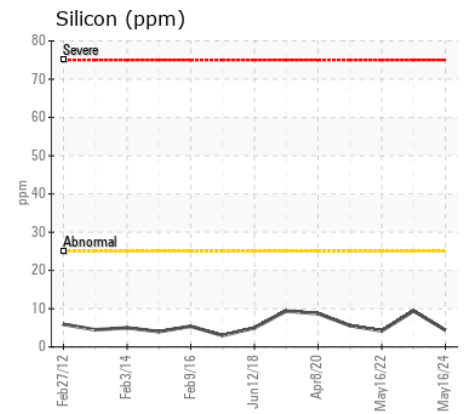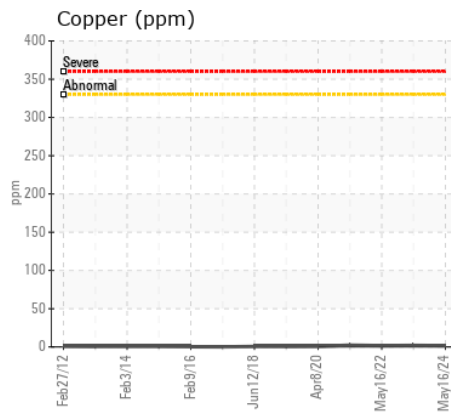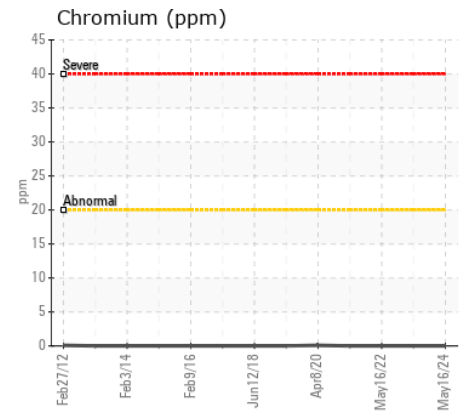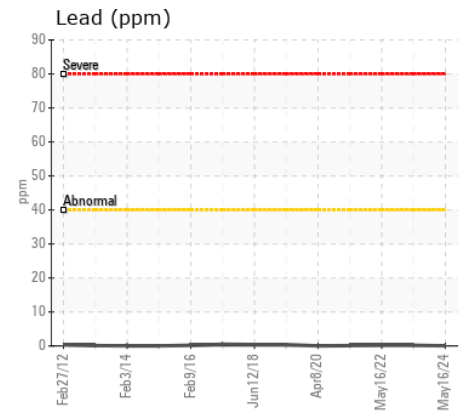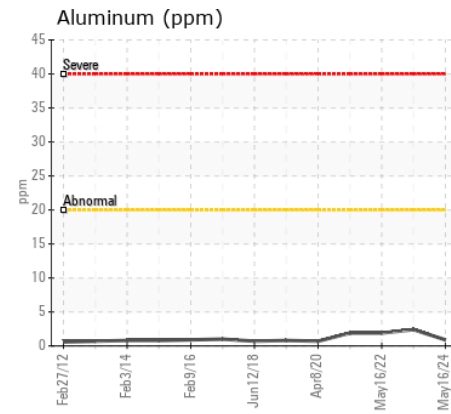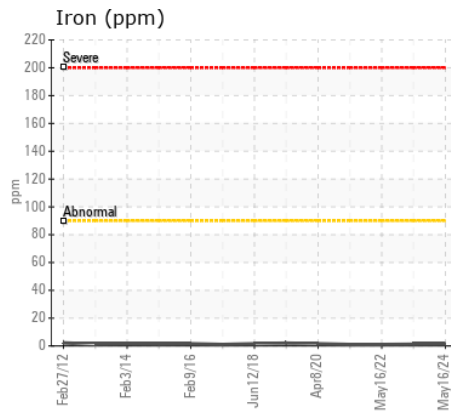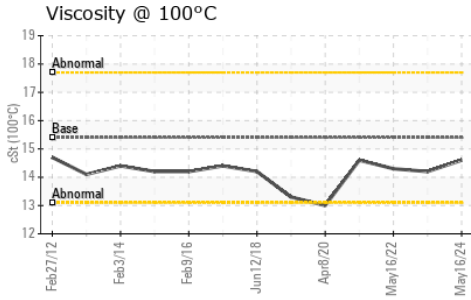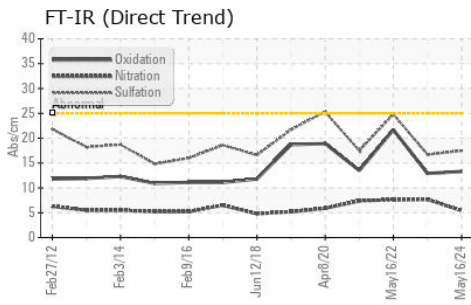

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0006205 **Received** : 24 Jun 2024  
**Lab Number** : 02643641 **Tested** : 24 Jun 2024  
**Unique Number** : 5801180 **Diagnosed** : 24 Jun 2024 - Wes Davis  
**Test Package** : MOB 1 ( Additional Tests: Visual )

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Ryan Udall  
 rudall@pwrstn.com  
 T: (905)565-1621  
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.