



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[87064]
 Machine Id
30 QUEENSWAY TORONTO UNITY HEALTH UNITY HEALTH
 Component
Rear Diesel Engine
 Fluid
ESSO XD-3 EXTRA 15W40 (100 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006209	PN0004985	PN0003628
Sample Date		Client Info		10 Jun 2024	21 Jun 2023	21 Jun 2022
Machine Age	hrs	Client Info		578	555	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ABNORMAL	ABNORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	2	2	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>4	0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	2	<1
Lead	ppm	ASTM D5185(m)	>40	0	<1	<1
Copper	ppm	ASTM D5185(m)	>330	1	1	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	3	6	6
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>5	<1.0	▲ 2.4	1.7
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	5.8	7.1	5.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	18.0	17.3	21.5
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	1	1	2
Boron	ppm	ASTM D5185(m)		12	67	48
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		48	12	40
Manganese	ppm	ASTM D5185(m)		0	0	<1
Magnesium	ppm	ASTM D5185(m)		779	146	559
Calcium	ppm	ASTM D5185(m)	3780	1187	1980	1605
Phosphorus	ppm	ASTM D5185(m)	1370	953	1054	909
Zinc	ppm	ASTM D5185(m)	1500	1129	1137	1050
Sulfur	ppm	ASTM D5185(m)	3800	2569	3141	2523
Oxidation	Abs/.1mm	ASTM D7414*	>25	13.7	13.6	18.5
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	13.5	▲ 12.7	▲ 11.4

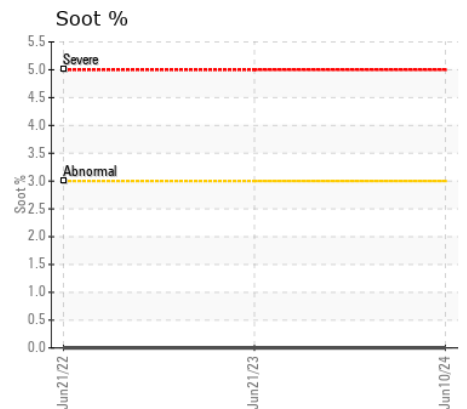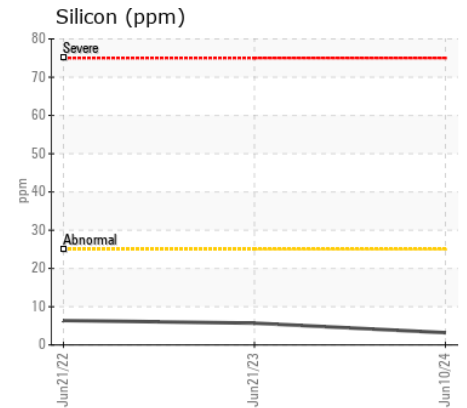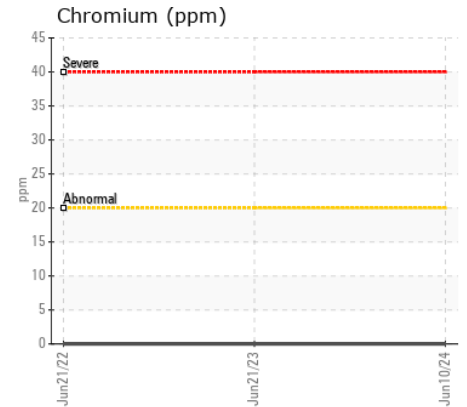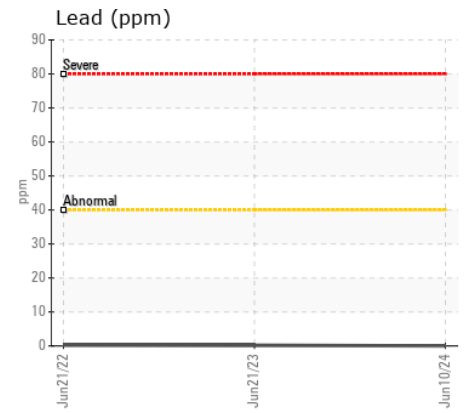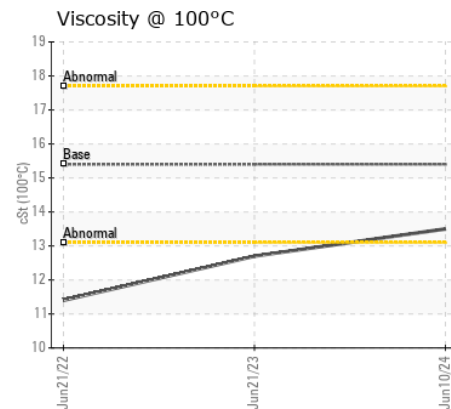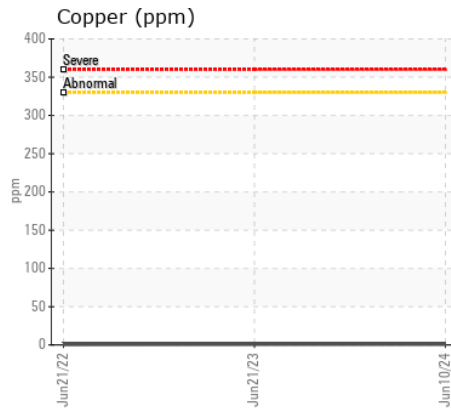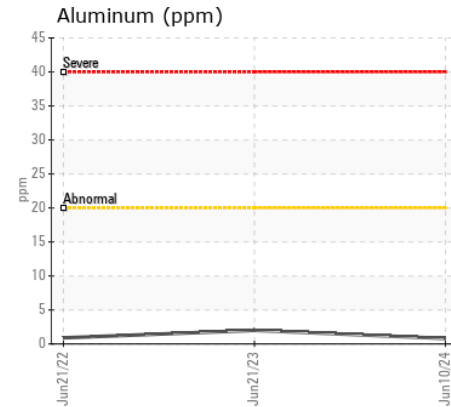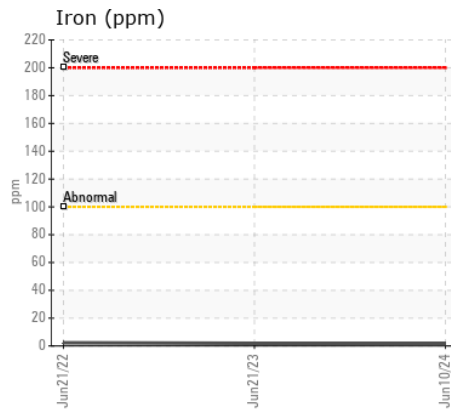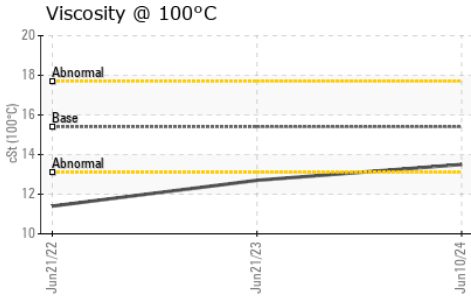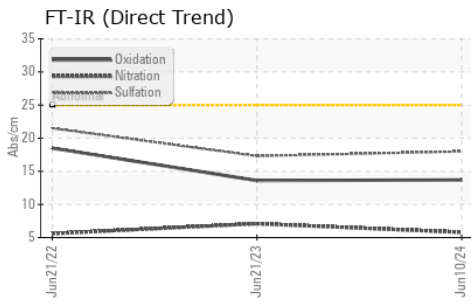

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006209 **Received** : 25 Jun 2024
Lab Number : 02643944 **Tested** : 25 Jun 2024
Unique Number : 5801483 **Diagnosed** : 25 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Brett Kinkley
 Bkinkley@pwrstn.com
 T:
 F: (905)565-8544