



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
[87022]

Machine Id
701 SHEPPARD AVE W NORTH YORK GOLDVIEW PROPERTIES GOLDVIEW PROPERTIES

Component
Left Diesel Engine

Fluid
ESSO XD-3 EXTRA 15W40 (15 LTR)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PN0006206	PN0004756	PN0002901
Sample Date		Client Info		18 Jun 2024	01 May 2023	18 Mar 2022
Machine Age	hrs	Client Info		325	303	279
Oil Age	hrs	Client Info		22	0	22
Filter Age	hrs	Client Info		22	0	22
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Not Chngd	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	6	5	6
Chromium	ppm	ASTM D5185(m)	>20	0	0	<1
Nickel	ppm	ASTM D5185(m)	>4	0	<1	<1
Titanium	ppm	ASTM D5185(m)		0	<1	0
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	1	4	2
Lead	ppm	ASTM D5185(m)	>40	0	0	0
Copper	ppm	ASTM D5185(m)	>330	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	VLITE	---	---
Yellow Metal	scalar	Visual*	NONE	NONE	---	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	4	8	8
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	6.2	8.3	7.4
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.4	19.3	22.8
Silt	scalar	Visual*	NONE	NONE	---	---
Debris	scalar	Visual*	NONE	NONE	---	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---	---
Appearance	scalar	Visual*	NORML	NORML	---	---
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)	>192	2	3	3
Boron	ppm	ASTM D5185(m)		12	63	62
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		66	91	61
Manganese	ppm	ASTM D5185(m)		<1	<1	<1
Magnesium	ppm	ASTM D5185(m)		860	71	368
Calcium	ppm	ASTM D5185(m)	3780	1312	2450	2007
Phosphorus	ppm	ASTM D5185(m)	1370	1008	1143	919
Zinc	ppm	ASTM D5185(m)	1500	1225	1234	1049
Sulfur	ppm	ASTM D5185(m)	3800	2592	3225	2497
Oxidation	Abs/.1mm	ASTM D7414*	>25	14.5	14.8	18.6
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	15.4	14.8	14.5

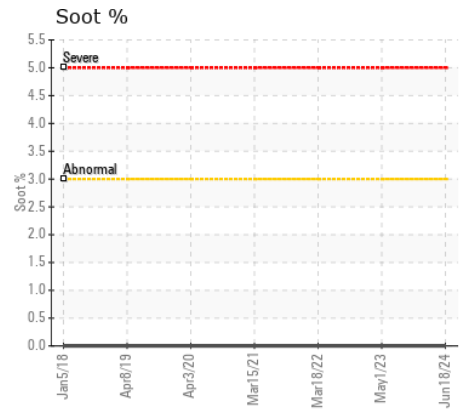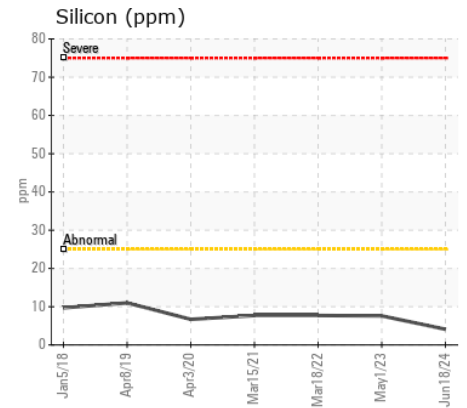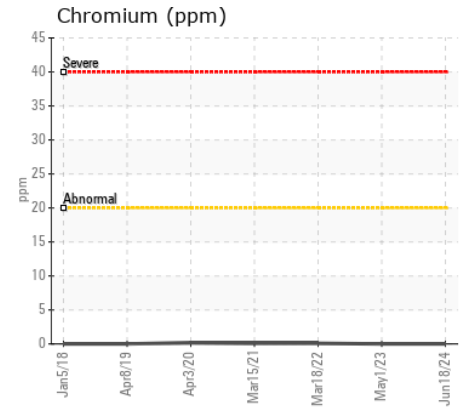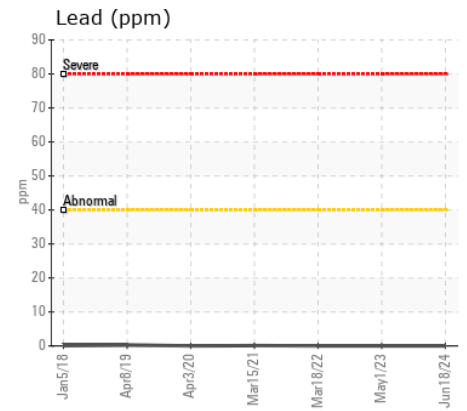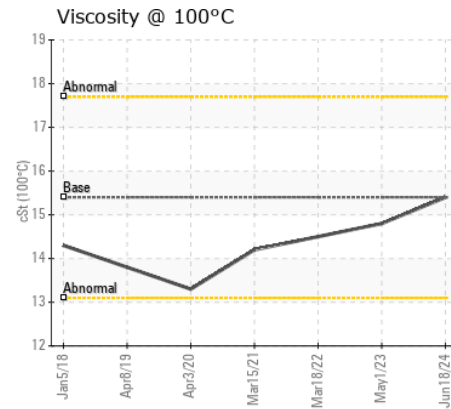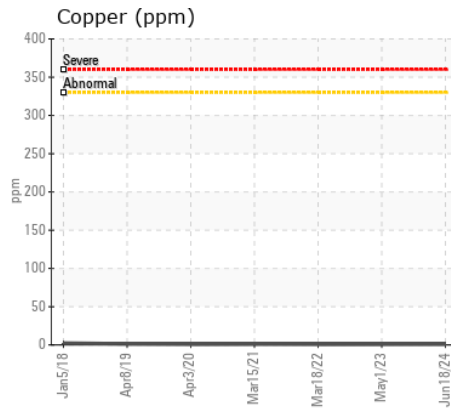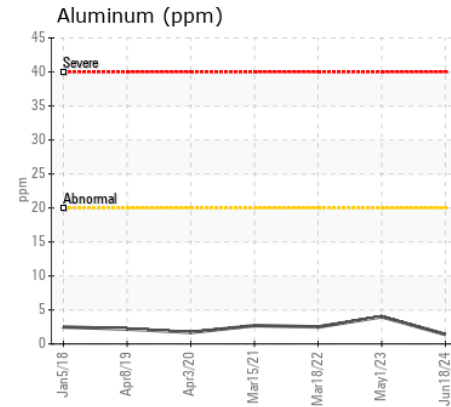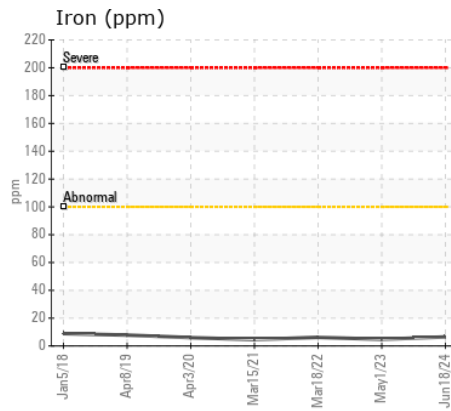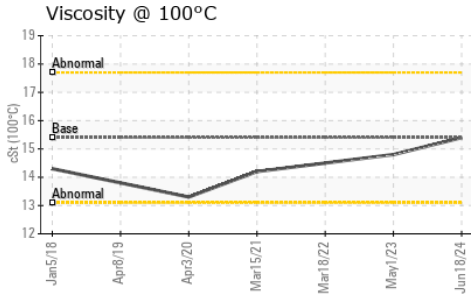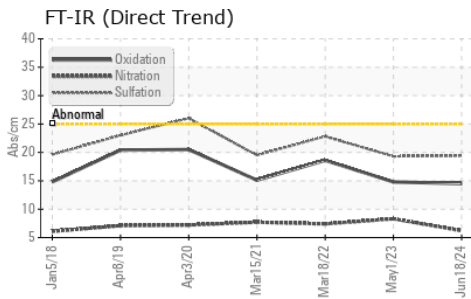

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PN0006206 **Received** : 25 Jun 2024
Lab Number : 02643959 **Tested** : 25 Jun 2024
Unique Number : 5801498 **Diagnosed** : 25 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

POWER STATION INC.
 1050 JAYSON COURT
 MISSISSAUGA, ON
 CA L4W 2V5
 Contact: Ryan Udall
 rudall@pwrstn.com
 T: (905)565-1621
 F: (905)629-1499

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.