



Area  
**DREAM REALTY**  
 Machine Id  
**330 BAY ST TORONTO DREAM REALTY DREAM REALTY**

Component  
**Rear Coolant**  
 Fluid  
**{not provided} (--- LTR)**

**RECOMMENDATION**

The fluid is suitable for further service. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PN0006279</b>	---	---
Sample Date		Client Info		<b>01 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>229</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>Not Chngd</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

**CORROSION**

All metal levels are normal indicating no corrosion in the cooling system.

Iron	ppm	ASTM D5185(m)	>15	<b>3</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Lead	ppm	ASTM D5185(m)	>10	<b>7</b>	---	---
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>10	<b>0</b>	---	---
Zinc	ppm	ASTM D5185(m)	>10	<b>&lt;1</b>	---	---

**CONTAMINANTS**








There is no indication of any contamination in the coolant.

Calcium	ppm	ASTM D5185(m)	>100	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Coolant Appearance		Visual*	Clear	<b>Cloudy</b>	---	---

**COOLANT CONDITION**

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits.

Boiling Point	°C	WC Method*		<b>107</b>	---	---
Specific Gravity		ASTM D1298*		<b>1.064</b>	---	---
pH	Scale 0-14	ASTM D1287*		<b>9.41</b>	---	---
Nitrites	ppm	Alcan Test Kit*		<b>1160</b>	---	---
Reserve Alkalinity	Scale 0-20	ASTM D1121*		<b>3.5</b>	---	---
Percentage Glycol	%	ASTM D3321*		<b>47.4</b>	---	---
Freezing Point	°C	ASTM D3321*		<b>-33</b>	---	---
Carboxylate				<b>---</b>	---	---
Silicon	ppm	ASTM D5185(m)		<b>26</b>	---	---
Phosphorus	ppm	ASTM D5185(m)		<b>39</b>	---	---
Boron	ppm	ASTM D5185(m)		<b>266</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>14</b>	---	---
Sodium	ppm	ASTM D5185(m)		<b>1875</b>	---	---
Potassium	ppm	ASTM D5185(m)		<b>319</b>	---	---
Coolant Color		Visual*		<b>Grn/Yellow</b>	---	---

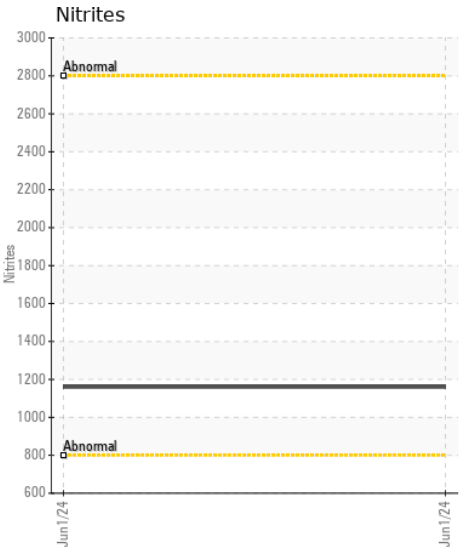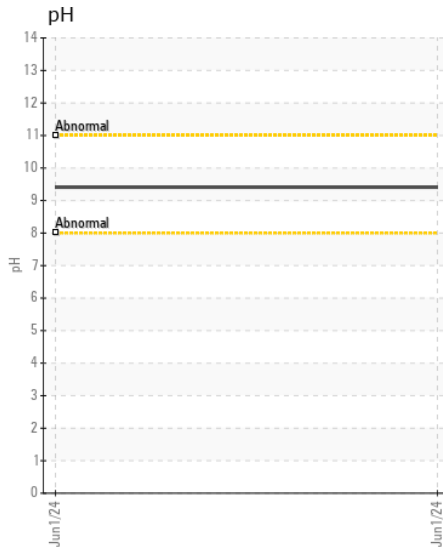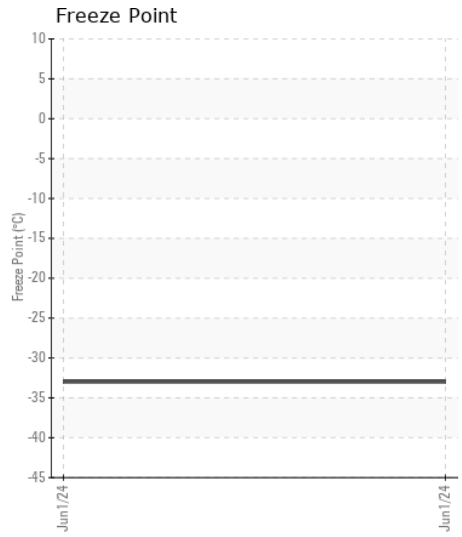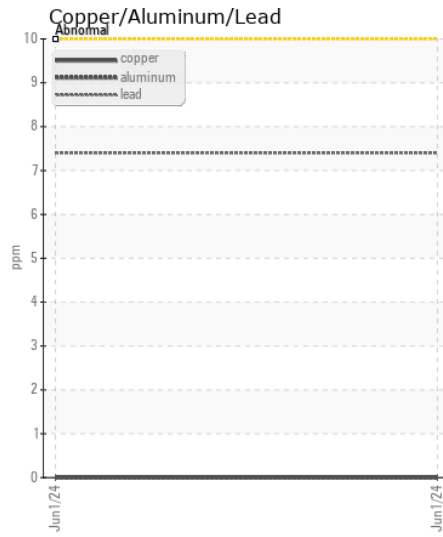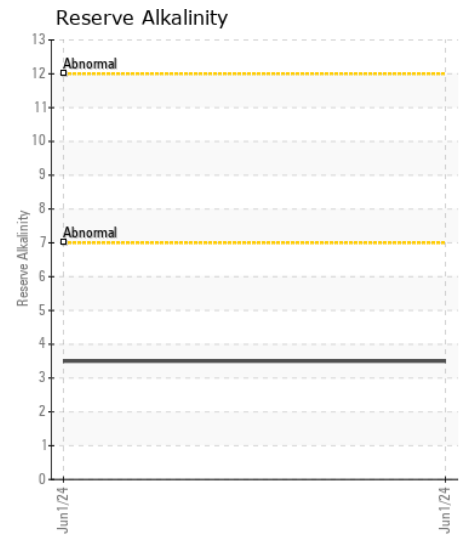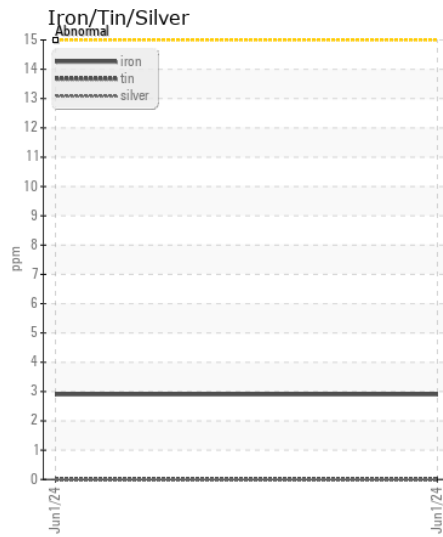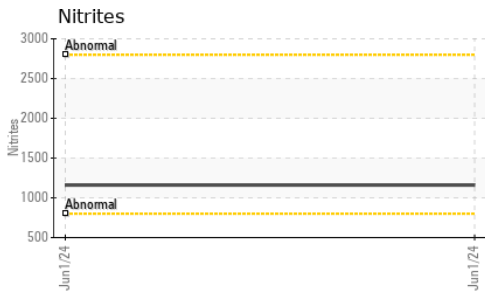

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PN0006279 **Received** : 25 Jun 2024  
**Lab Number** : 02644072 **Tested** : 26 Jun 2024  
**Unique Number** : 5801611 **Diagnosed** : 27 Jun 2024 - Kevin Marson  
**Test Package** : COOL ( Additional Tests: GlycolType )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**POWER STATION INC.**  
 1050 JAYSON COURT  
 MISSISSAUGA, ON  
 CA L4W 2V5  
 Contact: Brett Kinkley  
 Bkinkley@pwrstn.com  
 T:  
 F: (905)665-8544