



POWER SYSTEMS
SYSTÈMES DE PUISSANCE

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

[6100299030]

Machine Id

G6B11381

Component

Diesel Engine

Fluid

PETRO CANADA DURON SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WA0021461	WA0007635	WA0008209
Sample Date		Client Info		18 Jun 2024	12 Jan 2017	17 Nov 2015
Machine Age	hrs	Client Info		454	161	148
Oil Age	hrs	Client Info		0	20	0
Filter Age	hrs	Client Info		0	20	0
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

Metal levels are typical for a new component breaking in.

Iron	ppm	ASTM D5185(m)	>100	1	2	2
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>2	0	0	0
Titanium	ppm	ASTM D5185(m)	>2	0	0	<1
Silver	ppm	ASTM D5185(m)	>2	<1	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<1	2	2
Lead	ppm	ASTM D5185(m)	>40	0	<1	<1
Copper	ppm	ASTM D5185(m)	>330	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
White Metal	scalar	Visual*	NONE	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	---

CONTAMINATION











There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185(m)	>25	2	2	3
Potassium	ppm	ASTM D5185(m)	>20	0	1	<1
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	ASTM D7844*	>3	0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	4.4	5.2	4.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	17.3	20.4	18.6
Silt	scalar	Visual*	NONE	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	VLITE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185(m)		1	4	2
Boron	ppm	ASTM D5185(m)	1	4	51	48
Barium	ppm	ASTM D5185(m)	1	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	60	56	2	<1
Manganese	ppm	ASTM D5185(m)	1	0	<1	<1
Magnesium	ppm	ASTM D5185(m)	1010	916	10	10
Calcium	ppm	ASTM D5185(m)	1070	983	2198	2185
Phosphorus	ppm	ASTM D5185(m)	1150	943	941	952
Zinc	ppm	ASTM D5185(m)	1270	1120	1091	1111
Sulfur	ppm	ASTM D5185(m)	2060	2504	3300	3610
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.5	13.9	13.6
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	13.5	13.6	14.2

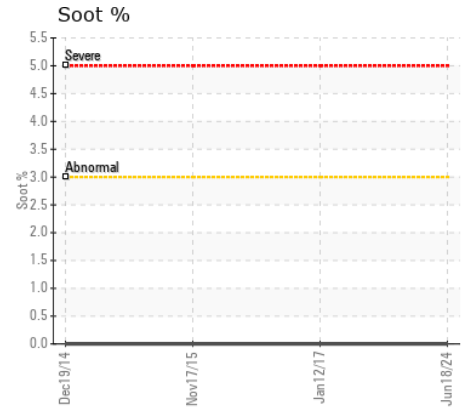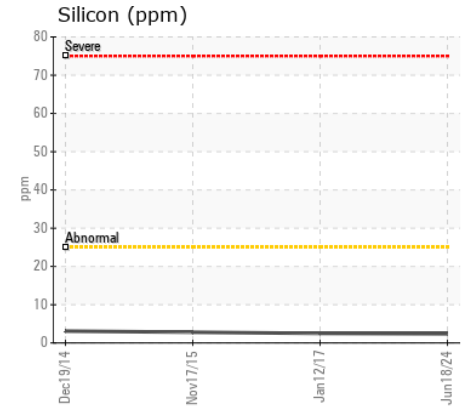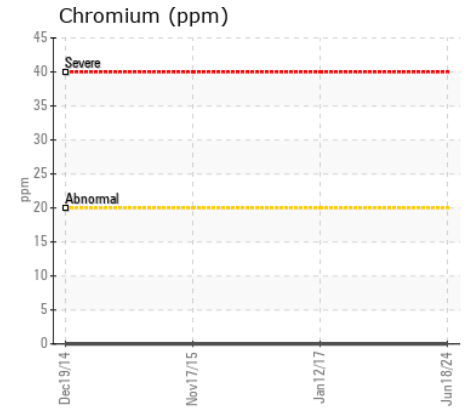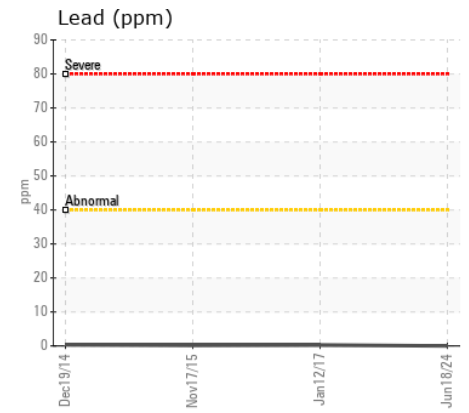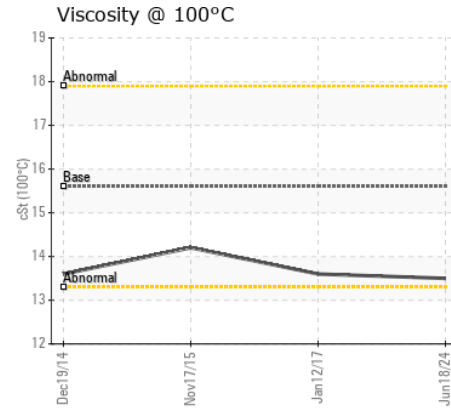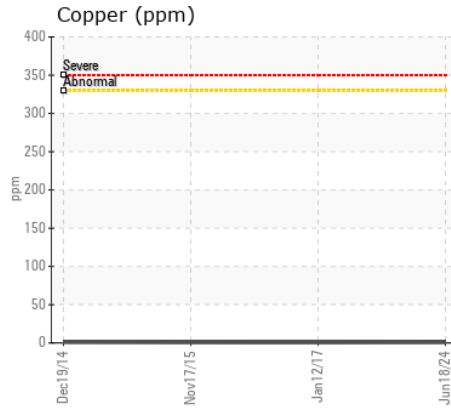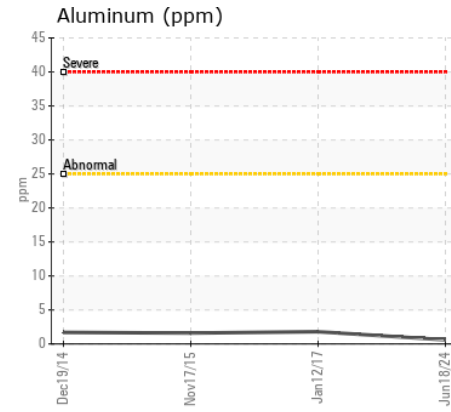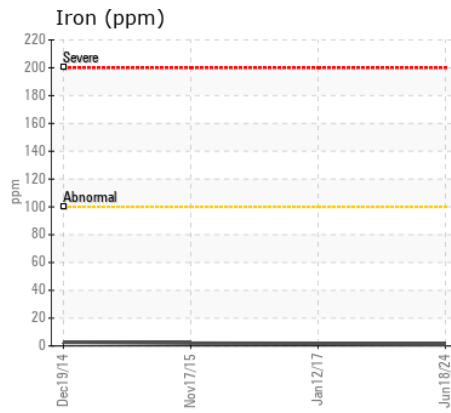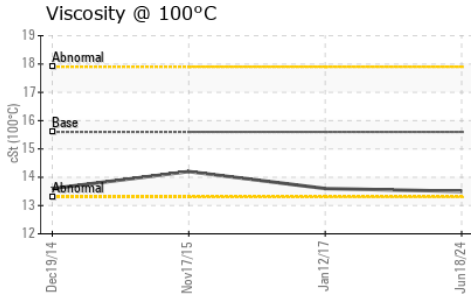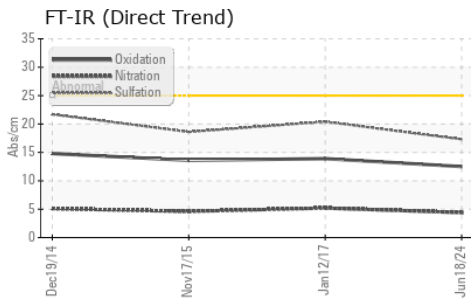

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : WA0021461 **Received** : 26 Jun 2024
Lab Number : 02644087 **Tested** : 26 Jun 2024
Unique Number : 5801626 **Diagnosed** : 26 Jun 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: Visual)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Wajax Power Systems
 70 Raddall Avenue
 Dartmouth, NS
 CA B3B 1T7
 Contact: Danelle Hoffman
 dhoffman@wajax.com
 T: (902)468-6200
 F: (902)468-3325