



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**GENERATOR LUBE OIL**  
 Component  
**Diesel Engine**  
 Fluid  
**FUCHS/TITAN CARGO 10W40 (79 GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MOB 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. this testkit includes BN to determine the suitability of the oil for continued use.

## WEAR

Metal levels are typical for a components first oil change.












## CONTAMINATION

There is no indication of any contamination in the oil.

## FLUID CONDITION

Viscosity of sample indicates oil is within SAE 5W40 range, advise investigate. The condition of the oil is acceptable for the time in service (unconfirmed).

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC</b>	---	---
Sample Date		Client Info		<b>24 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>18</b>	---	---
Oil Age	hrs	Client Info		<b>18</b>	---	---
Filter Age	hrs	Client Info		<b>18</b>	---	---
Oil Changed		Client Info		<b>Not Changd</b>	---	---
Filter Changed		Client Info		<b>Not Changd</b>	---	---
Sample Status				<b>NORMAL</b>	---	---
<hr/>						
Iron	ppm	ASTM D5185(m)	>100	<b>3</b>	---	---
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185(m)		<b>0</b>	---	---
Silver	ppm	ASTM D5185(m)	>3	<b>&lt;1</b>	---	---
Aluminum	ppm	ASTM D5185(m)	>20	<b>2</b>	---	---
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185(m)	>330	<b>10</b>	---	---
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	---	---
White Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	---	---
<hr/>						
Silicon	ppm	ASTM D5185(m)	>25	<b>4</b>	---	---
Potassium	ppm	ASTM D5185(m)	>20	<b>1</b>	---	---
Fuel		WC Method	>5	<b>&lt;1.0</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	ASTM D7844*	>3	<b>0</b>	---	---
Nitration	Abs/cm	ASTM D7624*	>20	<b>7.9</b>	---	---
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>16.9</b>	---	---
Silt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Debris	scalar	Visual*	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	---	---
Appearance	scalar	Visual*	NORML	<b>NORML</b>	---	---
Odor	scalar	Visual*	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	---	---
<hr/>						
Sodium	ppm	ASTM D5185(m)		<b>1</b>	---	---
Boron	ppm	ASTM D5185(m)		<b>115</b>	---	---
Barium	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185(m)		<b>44</b>	---	---
Manganese	ppm	ASTM D5185(m)		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185(m)		<b>850</b>	---	---
Calcium	ppm	ASTM D5185(m)		<b>1262</b>	---	---
Phosphorus	ppm	ASTM D5185(m)		<b>677</b>	---	---
Zinc	ppm	ASTM D5185(m)		<b>807</b>	---	---
Sulfur	ppm	ASTM D5185(m)		<b>1982</b>	---	---
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>17.8</b>	---	---
Visc @ 40°C	cSt	ASTM D7279(m)		<b>92.6</b>	---	---
Visc @ 100°C	cSt	ASTM D7279(m)		<b>14.0</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270*		<b>154</b>	---	---

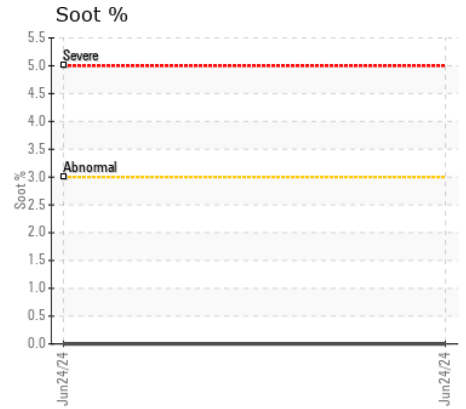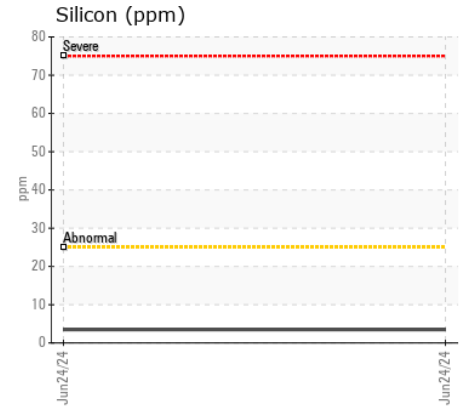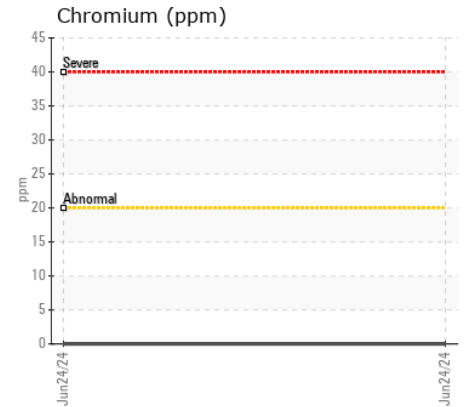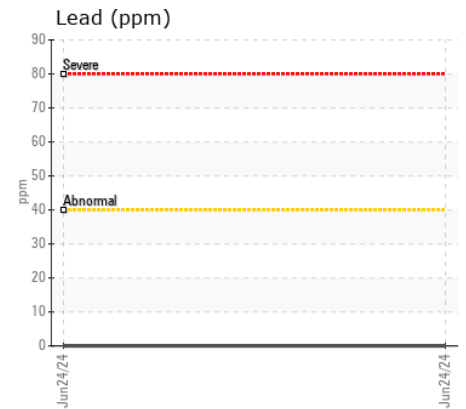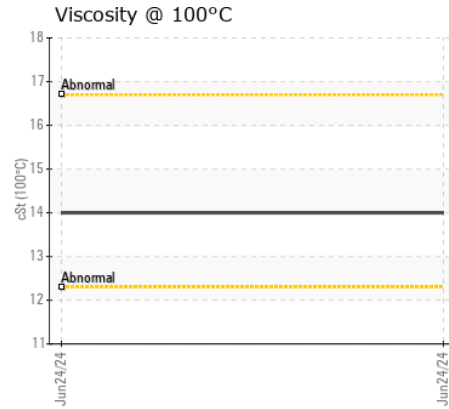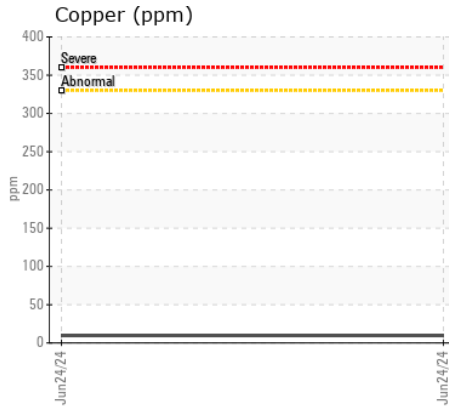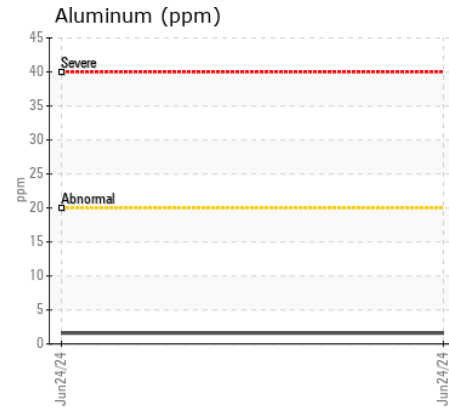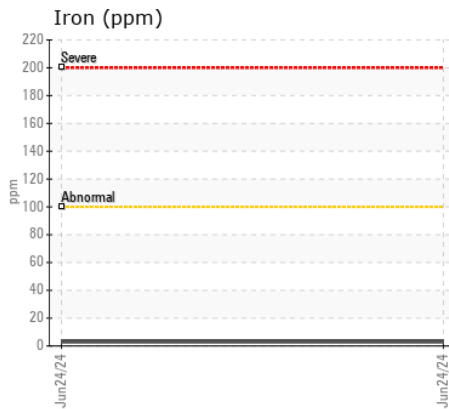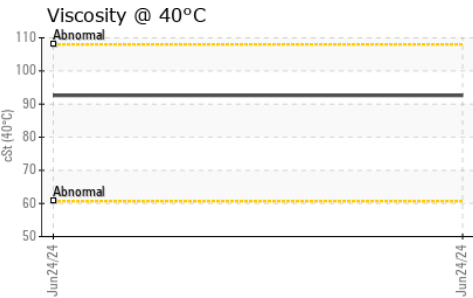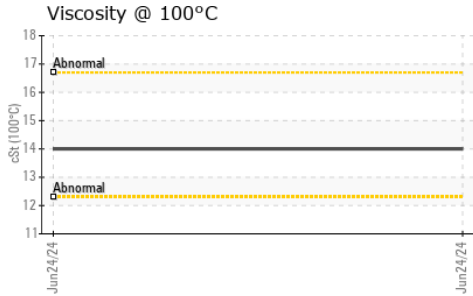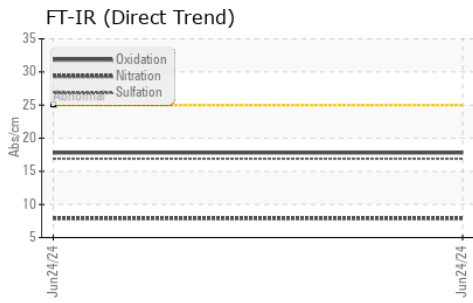

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WC  
**Lab Number** : 02645115  
**Unique Number** : 5802654  
**Test Package** : MOB 1 ( Additional Tests: KV40, VI, Visual )

**FORENSIC SCIENCE INTERNATIONAL GROUP**  
 17 RYAN CRESCENT  
 MARKHAM, ON  
 CA L6C 1A9  
 Contact: Helmut Brosz  
 hbrosz@forensicsig.org  
 T: (905)472-6660  
 F: (905)472-6665

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.