



**POWER SYSTEMS**  
**SYSTÈMES DE PUISSANCE**

**COOLANT REPORT**

**CORROSION**

**ABNORMAL**

**CONTAMINANTS**

**NORMAL**

**COOLANT CONDITION**

**NORMAL**

Area

**GBHS MEAFORD HOSPITAL [285519]**

Machine Id

**34703103**

Component

**Coolant**

Fluid

**CONVENTIONAL COOLANT (--- GAL)**

**RECOMMENDATION**

The coolant change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WA0021513</b>	WA0019516	WA0017663
Sample Date		Client Info		<b>06 Jun 2024</b>	04 May 2023	05 May 2022
Machine Age	hrs	Client Info		<b>1102</b>	1068	1039
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

**CORROSION**

Copper ppm levels are abnormal. The high metal levels indicate corrosion in the system.

Iron	ppm	ASTM D5185(m)	>15	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185(m)	>10	<b>2</b>	4	5
Copper	ppm	ASTM D5185(m)	>10	<b>▲ 18</b>	▲ 20	▲ 22
Lead	ppm	ASTM D5185(m)	>10	<b>0</b>	<1	1
Tin	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Silver	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1

**CONTAMINANTS**









There is no indication of any contamination in the coolant.

Calcium	ppm	ASTM D5185(m)	>100	<b>&lt;1</b>	2	2
Magnesium	ppm	ASTM D5185(m)	>40	<b>&lt;1</b>	<1	<1
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Coolant Appearance		Visual*	Clear	<b>Clear</b>	Clear	Clear

**COOLANT CONDITION**

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits.

Boiling Point	°C	WC Method*		<b>108</b>	---	---
Specific Gravity		ASTM D1298*		<b>1.072</b>	1.071	1.072
pH	Scale 0-14	ASTM D1287*	9.5	<b>8.56</b>	8.64	8.63
Nitrites	ppm	Alcan Test Kit*	1500	<b>1120</b>	1000	1320
Reserve Alkalinity	Scale 0-20	ASTM D1121*	8.5	<b>5.5</b>	5.8	5.6
Percentage Glycol	%	ASTM D3321*	50	<b>53.9</b>	53.3	54.0
Freezing Point	°C	ASTM D3321*	-40	<b>-42</b>	-43	-45
Carboxylate				<b>---</b>	---	---
Silicon	ppm	ASTM D5185(m)		<b>66</b>	65	65
Phosphorus	ppm	ASTM D5185(m)		<b>678</b>	685	693
Boron	ppm	ASTM D5185(m)		<b>257</b>	270	299
Molybdenum	ppm	ASTM D5185(m)		<b>369</b>	402	453
Sodium	ppm	ASTM D5185(m)		<b>1475</b>	1236	1244
Potassium	ppm	ASTM D5185(m)		<b>5455</b>	2804	2286
Coolant Color		Visual*	Green	<b>Green</b>	Green	Green

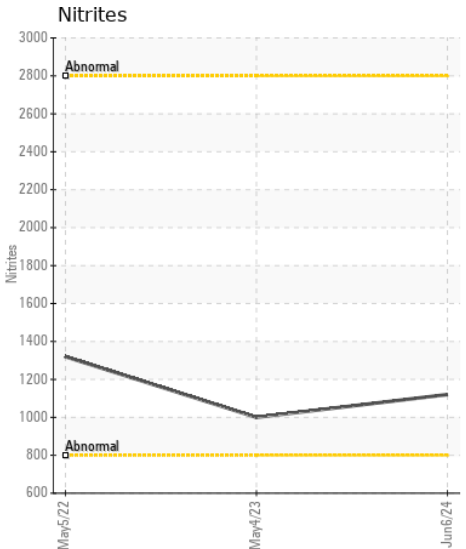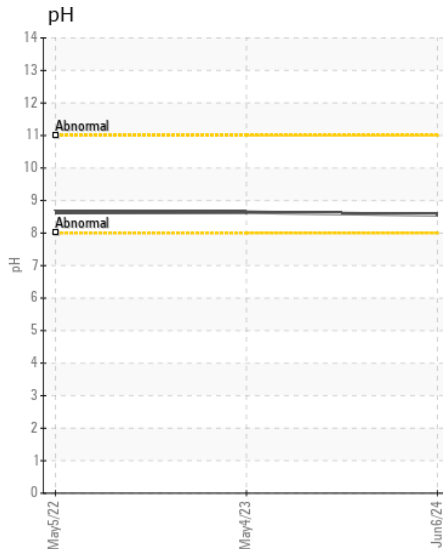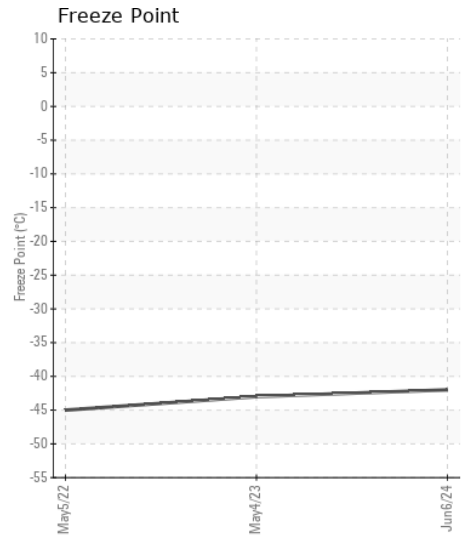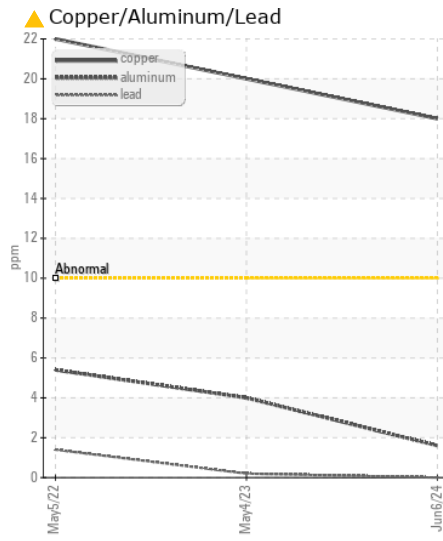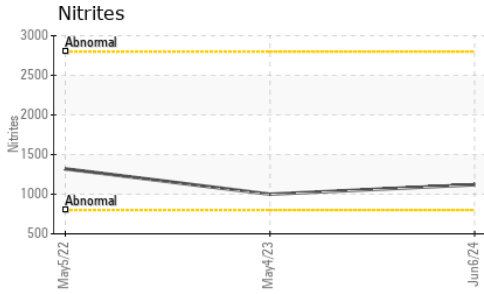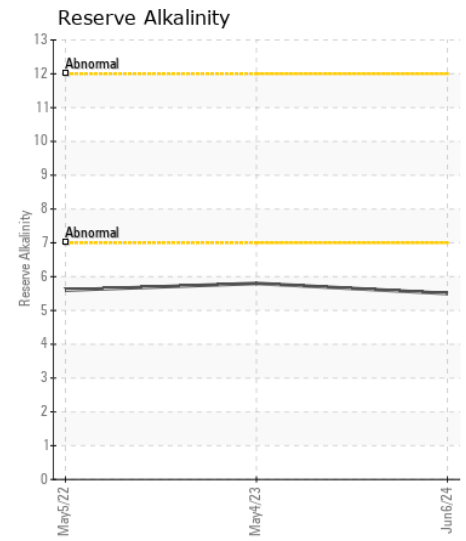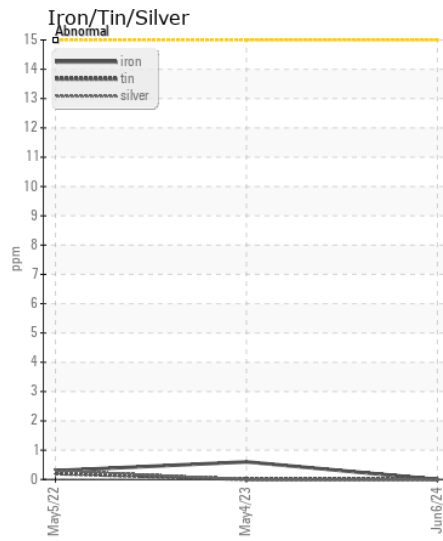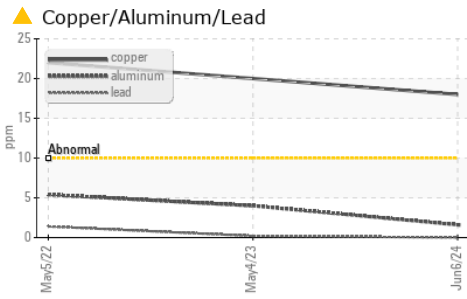

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : WA0021513 **Received** : 03 Jul 2024  
**Lab Number** : 02645321 **Tested** : 04 Jul 2024  
**Unique Number** : 5802860 **Diagnosed** : 04 Jul 2024 - Kevin Marson  
**Test Package** : COOL ( Additional Tests: GlycolType )

**Wajax Power Systems**  
 10 Diesel Drive  
 Toronto, ON  
 CA M8W 2T8  
 Contact: David Gilkes  
 dgilkes@wajax.com  
 T: (416)259-3281  
 F: (416)251-6191

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.