

[6100317657] WATER TOWER GEN

Diesel Engine

DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		WA0021764	WA0021749	
	Sample Date		Client Info		03 Jul 2024	29 May 2024	
	Machine Age	hrs	Client Info		520	192	
	Oil Age	hrs	Client Info		43	0	
	Filter Age	hrs	Client Info		43	0	
	Oil Changed		Client Info		Changed	Changed	
	Filter Changed		Client Info		Changed	Changed	
	Sample Status				NORMAL	NORMAL	
WEAR	Iron	ppm	ASTM D5185(m)	>51	2	1	
	Chromium	ppm	ASTM D5185(m)		0	0	
Metal levels are typical for a new component breaking in.	Nickel	ppm	ASTM D5185(m)		0	0	
	Titanium	ppm	ASTM D5185(m)		<1	<1	
	Silver	ppm	ASTM D5185(m)	>3	0	0	
	Aluminum	ppm	ASTM D5185(m)	>31	<1	<1	
	Lead	ppm	ASTM D5185(m)	>26	0	0	
	Copper	ppm	ASTM D5185(m)	>26	<1	<1	
	Tin	ppm	ASTM D5185(m)	>4	0	0	
	Vanadium	ppm	ASTM D5185(m)		0	0	
CONTAMINATION	Silicon	ppm	ASTM D5185(m)	>22	2	2	
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185(m)	>20	0	0	
	Fuel		WC Method	>2.1	<1.0	<1.0	
	Water		WC Method	>0.21	NEG	NEG	
	Glycol		WC Method		NEG	NEG	
	Soot %	%	ASTM D7844*	>3	0	0	
	Nitration	Abs/cm	ASTM D7624*	>20	4.5	4.3	
	Sulfation	Abs/.1mm	ASTM D7415*	>30	17.6	17.9	
	Emulsified Water	scalar	Visual*	>0.21	NEG	NEG	
FLUID CONDITION	Sodium	ppm	ASTM D5185(m)	>158	1	<1	
The condition of the oil is acceptable for the time in service.	Boron	ppm	ASTM D5185(m)	250	4	3	
	Barium	ppm	ASTM D5185(m)		0	0	
	Molybdenum	ppm	ASTM D5185(m)	100	54	56	
	Manganese	ppm	ASTM D5185(m)		<1	0	
	Magnesium	ppm	ASTM D5185(m)	450	867	946	
	Calcium	ppm	ASTM D5185(m)	3000	1101	1006	
	Phosphorus	ppm	ASTM D5185(m)	1150	974	971	
	Zinc	ppm	ASTM D5185(m)	1350	1126	1115	

ppm

Abs/.1mm

ASTM D5185(m)

ASTM D7414*

ASTM D7279(m) 14.4

4250

>25

Sulfur

Oxidation

Visc @ 100°C cSt

Contact/Location: Doug Balser - DDAMON

2499

12.9


14.9


2559

12.7

14.8

NORMAL WEAR NORMAL CONTAMINATION **FLUID CONDITION** NORMAL

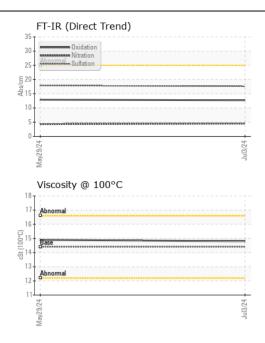

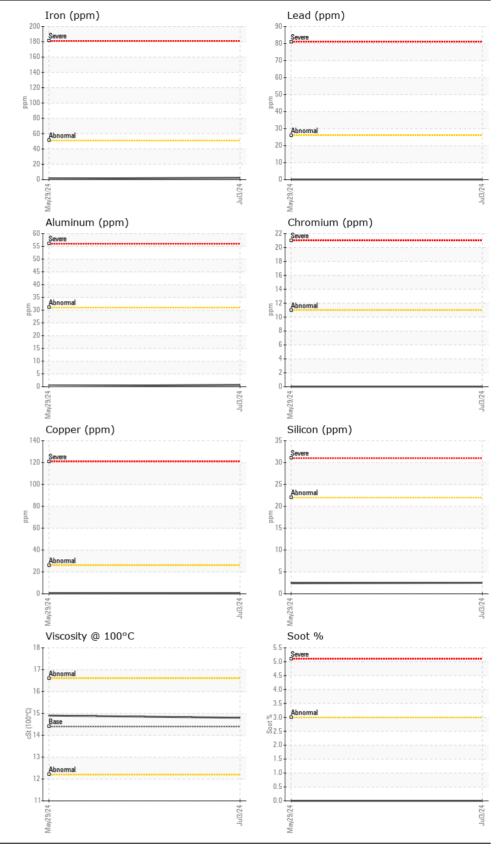

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Wajax Power Systems CALA . Sample No. Received : 05 Jul 2024 485 VENTURE DR : WA0021764 \mathbf{z} Lab Number : 02645836 Tested MONCTON, NB : 05 Jul 2024 ISO 17025:2017 Accredited Laboratory Diagnosed Unique Number : 5803375 : 05 Jul 2024 - Wes Davis CA E1H 2P4 Test Package : MOB 1 Contact: Doug Balser To discuss this sample report, contact Customer Service at 1-800-268-2131. dbalser@wajax.com Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. T: (506)855-5371 Validity of results and interpretation are based on the sample and information as supplied. F: (506)870-4448

Contact/Location: Doug Balser - DDAMON Page 2 of 2