
WEAR CONTAMINATION **FLUID CONDITION** **NORMAL NORMAL NORMAL**

Machine Id

M95-8519

Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		CCS05794069		
Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.	Sample Date		Client Info		22 Feb 2023		
	Machine Age	hrs	Client Info		0		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
VEAR	Iron	ppm	ASTM D5185m	>50	0		
	Chromium	ppm	ASTM D5185m	>10	0		
All component wear rates are normal.	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	<1		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	0		
	Tin	ppm		>15	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	<1		
751tTAMMTATTSIT	Potassium	ppm	ASTM D5185m		<1		
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.	Water	1-1-	WC Method		NEG		
	Particles >4µm		ASTM D7647		1162		
	Particles >6µm		ASTM D7647	>2500	422		
	Particles >14μm		ASTM D7647	>320	57		
	Particles >21μm		ASTM D7647	>80	14		
	Particles >38μm		ASTM D7647	>20	1		
	Particles >71μm		ASTM D7647	>4	0		
	Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/16/13		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		5		
	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		370		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		0		
	Magnesium	ppm	ASTM D5185m		3		
	Calcium	ppm	ASTM D5185m		1		
	Phosphorus	ppm	ASTM D5185m		1		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		0		
	Acid Number (AN)	mg KOH/g	ASTM D8045		0.282		
	Visc @ 40°C	cSt	ASTM D445		25.0		

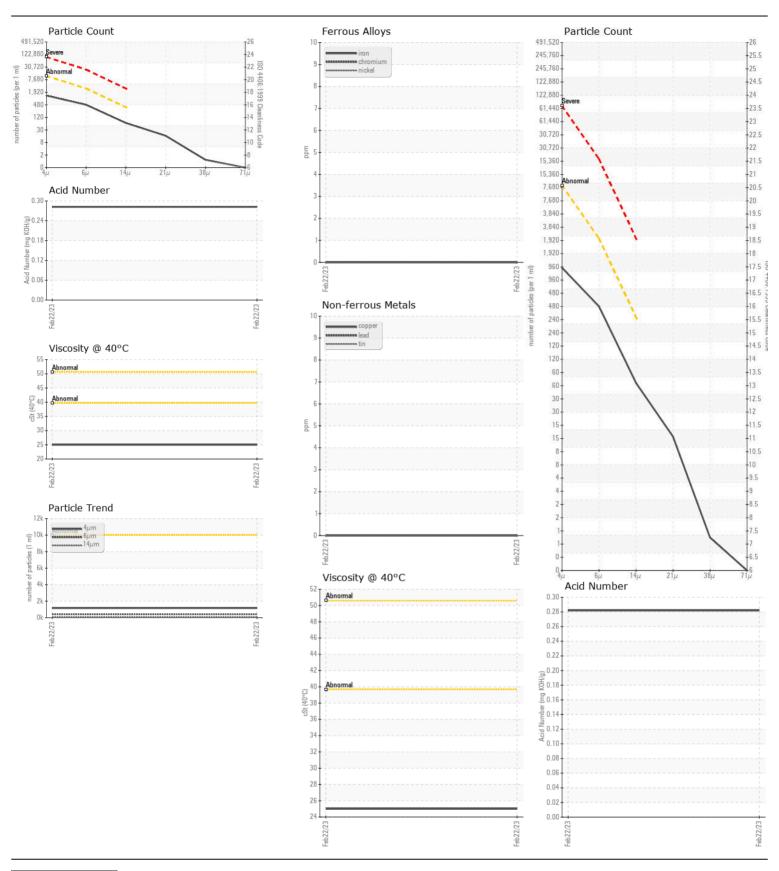



Certificate L2367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : CCS05794069 Lab Number : 05794069

Received **Tested** Unique Number: 10383753 Diagnosed : 16 Mar 2023

: 17 Mar 2023

: 20 Mar 2023 - Don Baldridge

Test Package: IND 2 (Additional Tests: PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BRIDGESTONE 4600 NW 2ND AVE DES MOINES, IA

US 50313

Contact: KEN MCDANIEL

T: F: