



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
ROTO XTEND
Machine Id
ATLAS COPCO API853496 - NVE CORP
Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH05848758	---	---
Sample Date		Client Info		09 May 2023	---	---
Machine Age	hrs	Client Info		15184	---	---
Oil Age	hrs	Client Info		7172	---	---
Filter Age	hrs	Client Info		7172	---	---
Oil Changed		Client Info		Not Changed	---	---
Filter Changed		Client Info		Not Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>15	<1	---	---
Lead	ppm	ASTM D5185m	>65	0	---	---
Copper	ppm	ASTM D5185m	>65	0	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>35	5	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		15	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		1	---	---
Phosphorus	ppm	ASTM D5185m		23	---	---
Zinc	ppm	ASTM D5185m		1	---	---
Sulfur	ppm	ASTM D5185m		0	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.127	---	---
Visc @ 40°C	cSt	ASTM D445	46	47.8	---	---

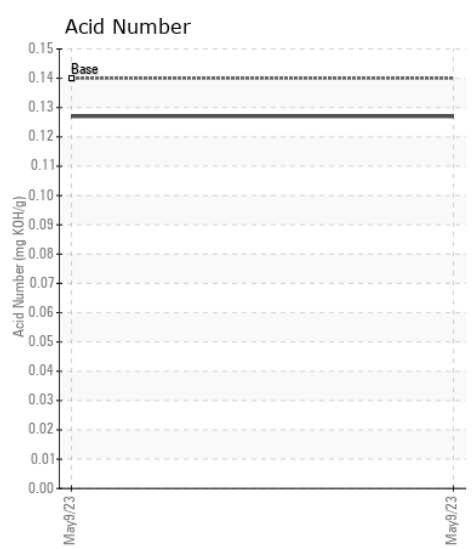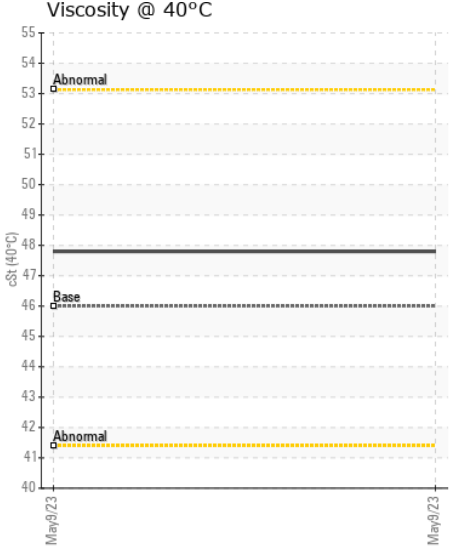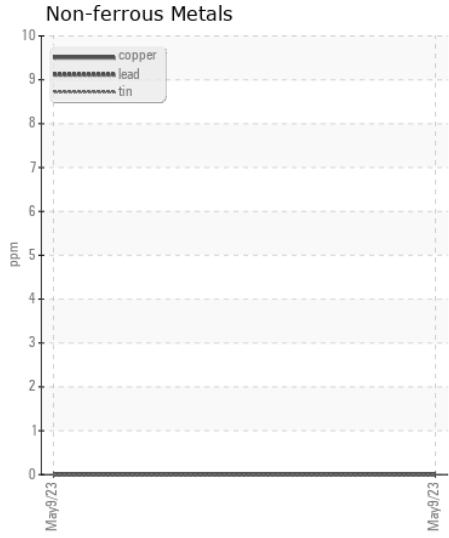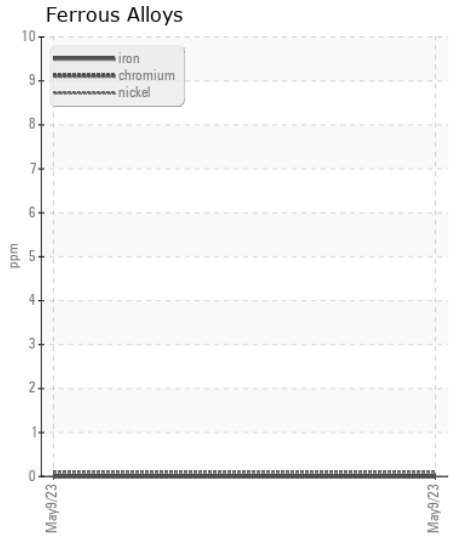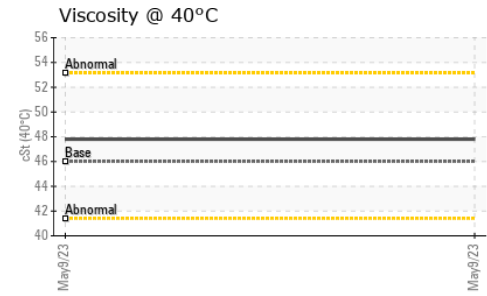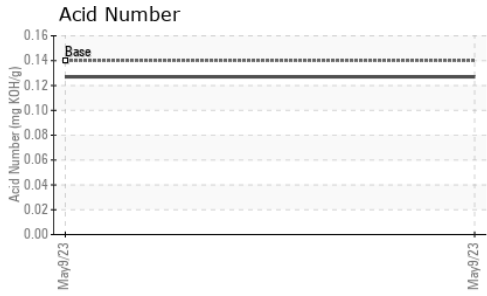

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH05848758 **Received** : 16 May 2023
Lab Number : 05848758 **Tested** : 19 May 2023
Unique Number : 10472865 **Diagnosed** : 19 May 2023 - Don Baldrige
Test Package : IND 2

JOHN HENRY FOSTER MINNESOTA INC
 3103 MIKE COLLINS DR
 EAGAN, MN
 US 55121-2298
 Contact: CHRIS BJERKE
 chris.bjerke@jhfooster.com
 T: (800)582-5162
 F: 800582826

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)