
WEAR CONTAMINATION **FLUID CONDITION**


NORMAL NORMAL **NORMAL**


Boiler Building


Boiler Feed Pump #2
Component Inbooard Bearing


RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		WC0804003	WC0803994	WC073867
	Sample Date		Client Info		26 Jun 2023	30 Mar 2023	05 Dec 20
	Machine Age	hrs	Client Info		0	0	0
	Oil Age	hrs	Client Info		0	0	0
	Filter Age	hrs	Client Info		0	0	0
	Oil Changed		Client Info		N/A	N/A	N/A
	Filter Changed		Client Info		N/A	N/A	N/A
	Sample Status				NORMAL	NORMAL	NORMA
WEAR	Iron	ppm	ASTM D5185m	>20	<1	0	0
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>20	0	0	0
	Nickel	ppm	ASTM D5185m	>20	<1	0	<1
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m		<1	0	0
	Aluminum	ppm	ASTM D5185m	>20	0	0	0
	Lead	ppm	ASTM D5185m	>20	<1	0	<1
	Copper	ppm	ASTM D5185m	>20	<1	1	1
	Tin	ppm	ASTM D5185m	>20	0	0	<1
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	LIGHT	NON
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NON
CONTAMINATION	Silicon	ppm	ASTM D5185m	<u> </u>	0	<1	2
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m		<1	0	<1
	Water	PPIII	WC Method		NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NON
	Debris	scalar	*Visual	NONE	NONE	NONE	NON
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NON
	Appearance	scalar	*Visual	NORML	NORML	NORML	NOR
	Odor	scalar	*Visual	NORML	NORML	NORML	NOR
	Emulsified Water	scalar	*Visual	>2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0	0	0
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0	0	0
	Barium	ppm	ASTM D5185m		0	<1	0
	Molybdenum	ppm	ASTM D5185m		0	0	0
	Manganese	ppm	ASTM D5185m		0	<1	0
	Magnesium	ppm	ASTM D5185m		0	3	<1
	Calcium	ppm	ASTM D5185m		0	2	0
	Phosphorus	ppm	ASTM D5185m		1189	1096	1097
	Zinc	ppm	ASTM D5185m		18	25	14
	Sulfur	ppm	ASTM D5185m		1	2	0
	Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	0.14	0.18	0.17
	Visc @ 40°C	cSt	ASTM D445		29.6	30.1	27.5

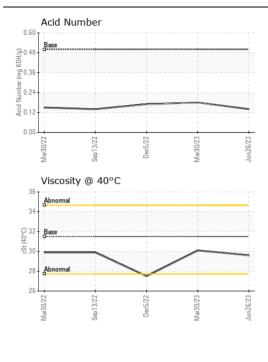

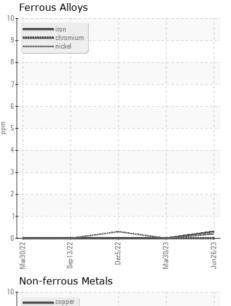









Certificate L2367

Laboratory Sample No.

: WC0804003 Lab Number : 05892952 Unique Number : 10548762 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested**

Diagnosed

: 10 Jul 2023

: 07 Jul 2023

: 11 Jul 2023 - Don Baldridge

VEOLIA NA - MADISON 125 HV CHANDLER COLBERT, GA US 30628 Contact: CRAIG STEPHENS

craig.stephens@veolia.com T: (281)906-7010

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

F: