

WEARNORMALCONTAMINATIONNORMALFLUID CONDITIONNORMAL

Boiler Building Boiler Feed Pump #2

Outboard Bearing

MOBIL SHC 824 (2)

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		WC0804004	WC0803993	WC0738677
	Sample Date		Client Info		26 Jun 2023	30 Mar 2023	05 Dec 2022
	Machine Age	hrs	Client Info		0	0	0
	Oil Age	hrs	Client Info		0	0	0
	Filter Age	hrs	Client Info		0	0	0
	Oil Changed		Client Info		N/A	N/A	N/A
	Filter Changed		Client Info		N/A	N/A	N/A
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>20	0	0	0
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>20	0	0	0
	Nickel	ppm	ASTM D5185m	>20	<1	0	0
	Titanium	ppm	ASTM D5185m		0	0	0
	Silver	ppm	ASTM D5185m		<1	0	0
	Aluminum	ppm	ASTM D5185m	>20	0	0	0
	Lead	ppm	ASTM D5185m	>20	0	0	<1
	Copper	ppm	ASTM D5185m	>20	<1	<1	<1
	Tin	ppm	ASTM D5185m	>20	0	0	<1
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	LIGHT	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	<u>_ 15</u>	0	0	<1
	Potassium	ppm	ASTM D5185m		1	0	<1
There is no indication of any contamination in the oil.	Water	ppm			NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water	scalar	*Visual	>2	NEG	NEG	NEG
FLUID CONDITION	Sodium		ASTM D5185m		0	0	0
	Boron	ppm ppm	ASTM D5185m		0	0	0
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0	<1	0
	Molybdenum	ppm	ASTM D5185m		0	0	0
	Manganese	ppm	ASTM D5185m		0	<1	0
	Magnesium	ppm	ASTM D5185m		0	3	<1
	Calcium	ppm	ASTM D5185m		0	2	0
	Phosphorus	ppm	ASTM D5185m		1212	1090	1101
	Zinc	ppm	ASTM D5185m		10	20	13
	Sulfur	ppm	ASTM D5185m		<1	3	0

Acid Number (AN) mg KOH/g ASTM D8045 0.5


Visc @ 40°C cSt ASTM D445 31.5

29.7 30.1 29.9 Submitted By: JOHNNY STONE

0.18

0.14

0.18

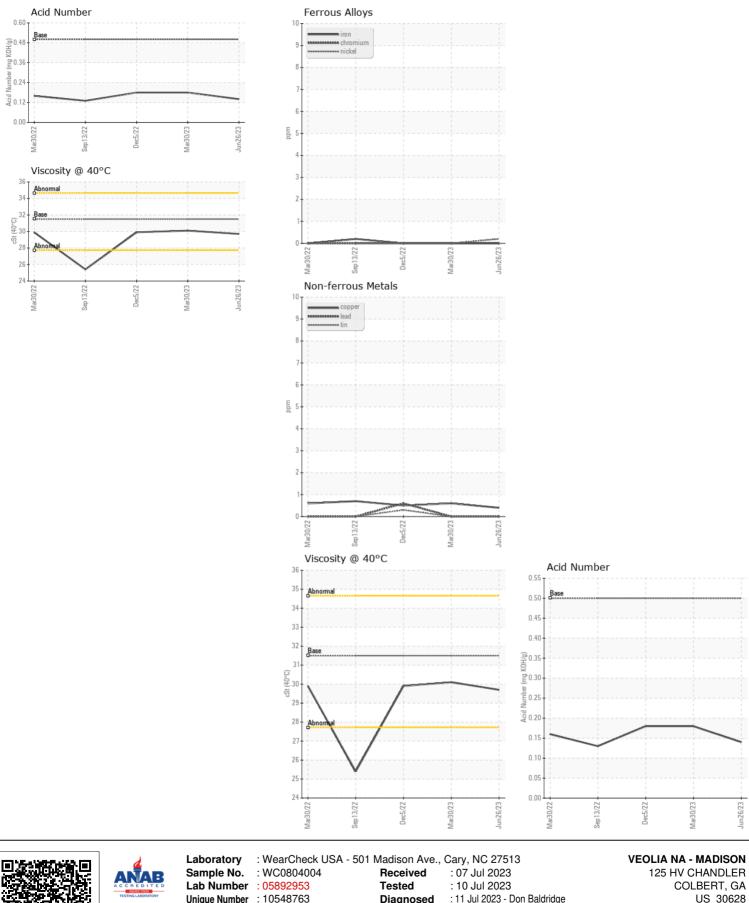

Unique Number : 10548763 Diagnosed : 11 Jul 2023 - Don Baldridge Test Package : IND 2 Contact: CRAIG STEPHENS Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. craig.stephens@veolia.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Submitted By: JOHNNY STONE Page 2 of 2

T: (281)906-7010

F: