



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area
46S
Machine Id
LEROI 4658X14
Component
Compressor

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.








CONTAMINATION

Moderate concentration of visible dirt/debris present in the oil. Free water present.

FLUID CONDITION

The AN level is acceptable for this fluid.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH05921557	---	---
Sample Date		Client Info		03 May 2023	---	---
Machine Age	hrs	Client Info		9717	---	---
Oil Age	hrs	Client Info		540	---	---
Filter Age	hrs	Client Info		690	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ATTENTION	---	---
Iron	ppm	ASTM D5185m	>50	14	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	2	---	---
Lead	ppm	ASTM D5185m	>25	<1	---	---
Copper	ppm	ASTM D5185m	>50	2	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	<1	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water	%	ASTM D6304	>0.1	0.072	---	---
ppm Water	ppm	ASTM D6304	>1000	720	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	---	---
Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m	0.9	0	---	---
Barium	ppm	ASTM D5185m	0.1	0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0.2	0	---	---
Magnesium	ppm	ASTM D5185m	0.9	0	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	224	18	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	273	2060	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.103	0.14	---	---
Visc @ 40°C	cSt	ASTM D445	41.61	47.2	---	---

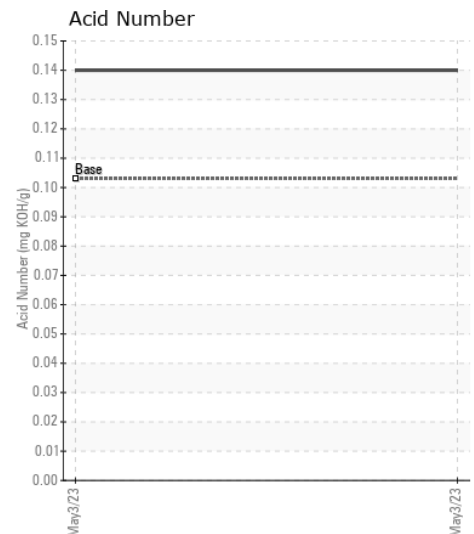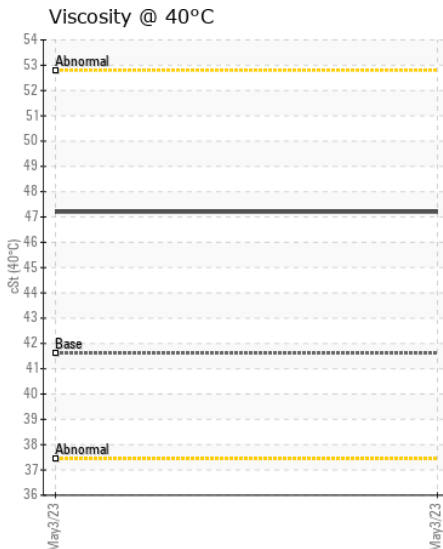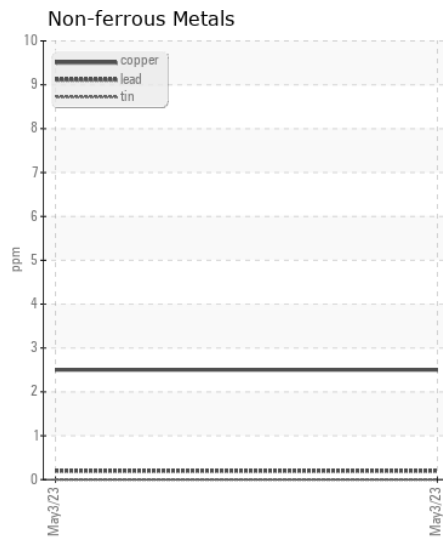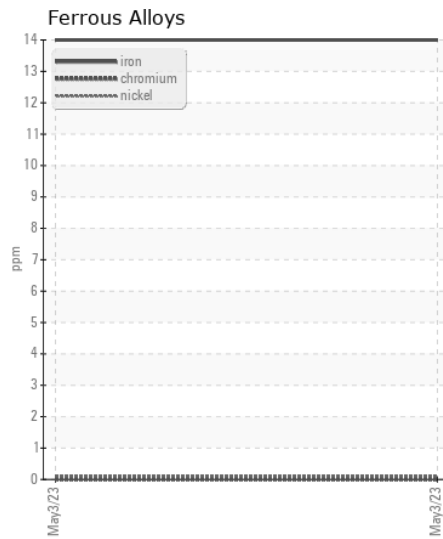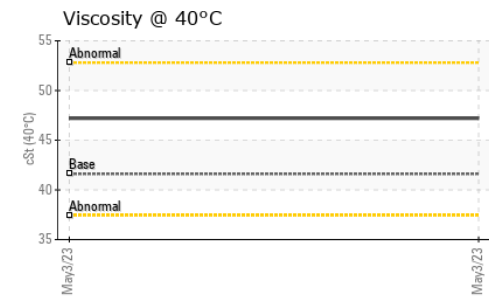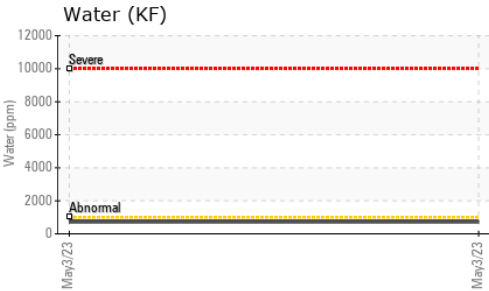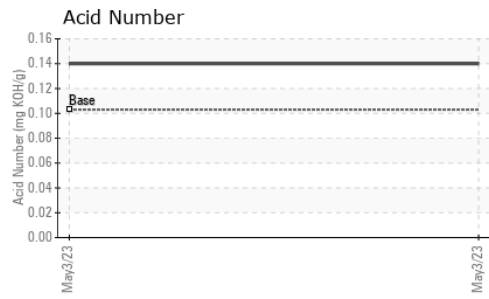

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UCH05921557

Lab Number : 05921557

Unique Number : 10593471

Test Package : IND 2 (Additional Tests: KF)

Received : 10 Aug 2023

Tested : 11 Aug 2023

Diagnosed : 12 Aug 2023 - Don Baldrige

AIR TECHNOLOGIES INC (CLE)

6500 DAVIS INDUSTRIAL PARKWAY

CLEVELAND, OH

US 44139

Contact: DERRICK PAES

DPAES@AIRCOMPRESSORS.COM

T: (440)349-3900

F: (440)349-0608

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)