



Built for a lifetime™

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Machine Id
KAESER SFC 37 3887845 (S/N 1126)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		KCPA006627	KCP51085	KCP42792
Sample Date		Client Info		27 Sep 2023	02 Sep 2022	13 Oct 2021
Machine Age	hrs	Client Info		29638	26405	24228
Oil Age	hrs	Client Info		0	0	2000
Filter Age	hrs	Client Info		0	0	2000
Oil Changed		Client Info		N/A	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				ATTENTION	NORMAL	ABNORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION











There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Silicon	ppm	ASTM D5185m	>25	0	0	0
Potassium	ppm	ASTM D5185m	>20	3	3	1
Water	%	ASTM D6304	>0.05	0.014	0.026	0.018
ppm Water	ppm	ASTM D6304	>500	147.5	268.4	186.3
Particles >4µm		ASTM D7647		4814	5215	8776
Particles >6µm		ASTM D7647	>1300	▲ 1403	1058	▲ 3341
Particles >14µm		ASTM D7647	>80	61	46	▲ 308
Particles >21µm		ASTM D7647	>20	13	6	▲ 41
Particles >38µm		ASTM D7647	>4	0	1	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	:-/17/13	▲ 19/18/13	20/17/13	▲ 19/15
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		15	14	18
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	8	15	10
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	61	71	60
Calcium	ppm	ASTM D5185m	2	2	2	<1
Phosphorus	ppm	ASTM D5185m		<1	4	13
Zinc	ppm	ASTM D5185m		2	2	5
Sulfur	ppm	ASTM D5185m		21877	22015	16607
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.36	0.38	0.364
Visc @ 40°C	cSt	ASTM D445	46	43.7	41.0	44.8

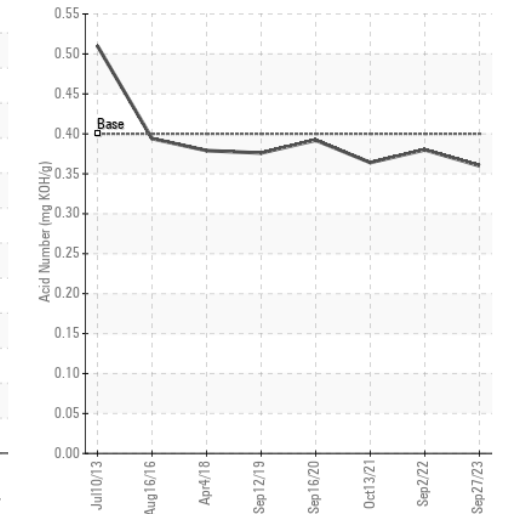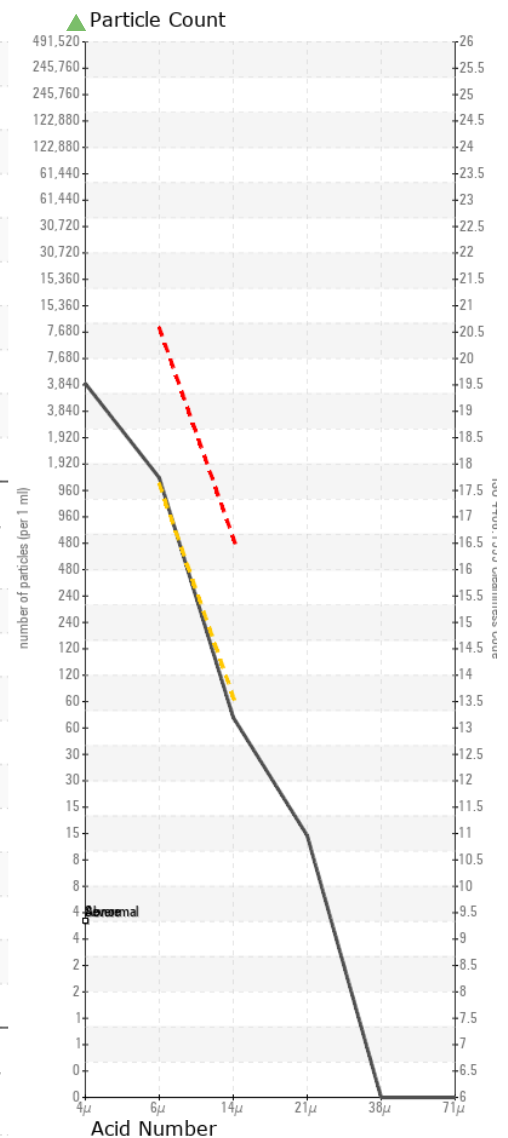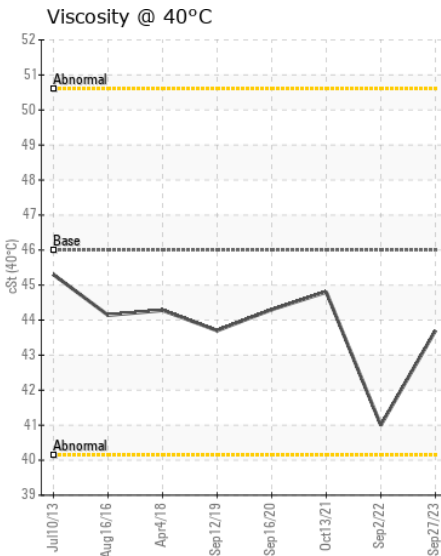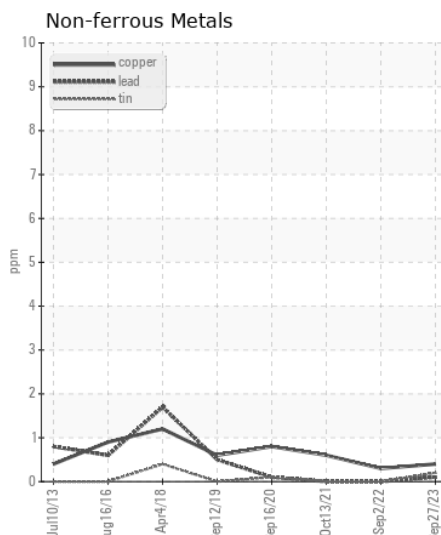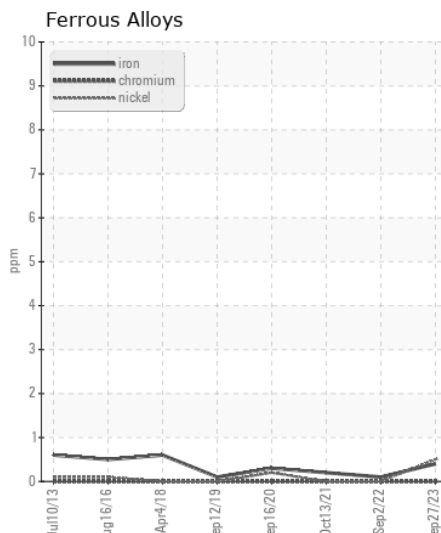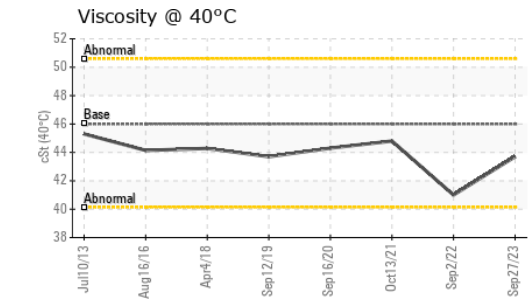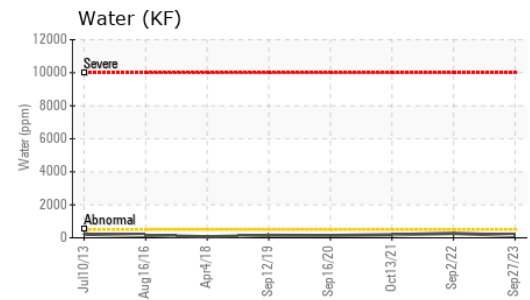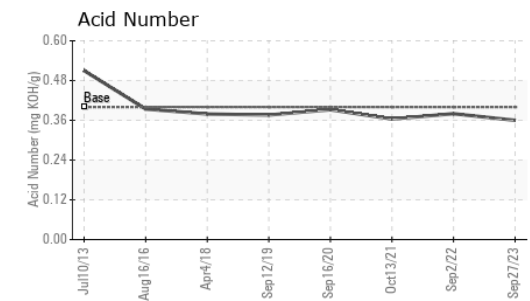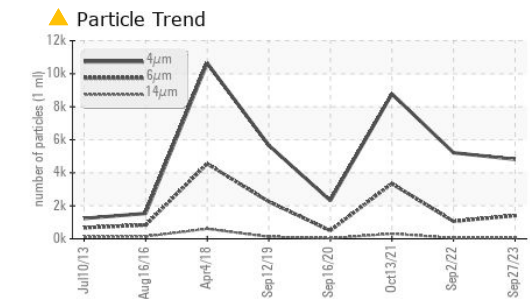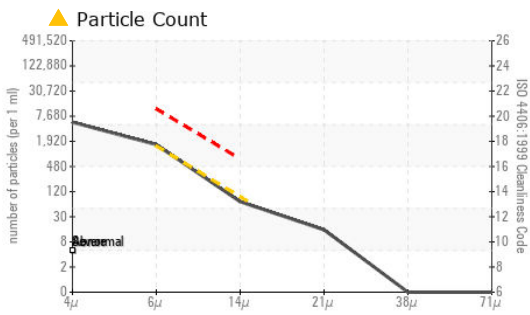

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA006627 **Received** : 06 Oct 2023
Lab Number : 05971471 **Diagnosed** : 10 Oct 2023
Unique Number : 10683421 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

GOLDER CONSTRUCTION SERVICES
 26250 FSR 330 / CR14
 DEL NORTE, CO
 US 81132
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: