



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
NOT GIVEN
Machine Id
C-201 (S/N 8752)
Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.








CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH06044981	---	---
Sample Date		Client Info		14 Dec 2023	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	0.002	---	---
ppm Water	ppm	ASTM D6304	>1000	24	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m	5	0	---	---
Barium	ppm	ASTM D5185m	5	0	---	---
Molybdenum	ppm	ASTM D5185m	5	0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m	5	0	---	---
Calcium	ppm	ASTM D5185m	12	0	---	---
Phosphorus	ppm	ASTM D5185m	12	0	---	---
Zinc	ppm	ASTM D5185m	12	0	---	---
Sulfur	ppm	ASTM D5185m	1000	0	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	0.014	---	---
Visc @ 40°C	cSt	ASTM D445	68	67.4	---	---

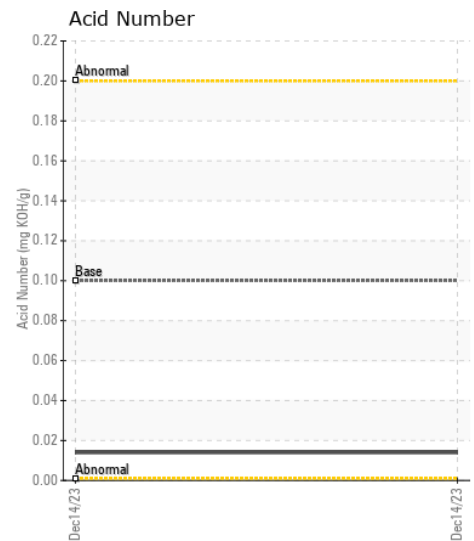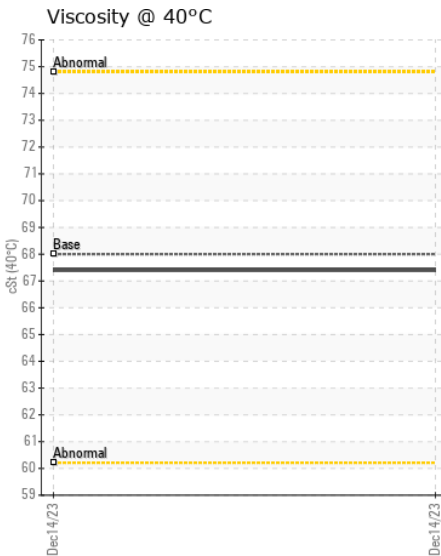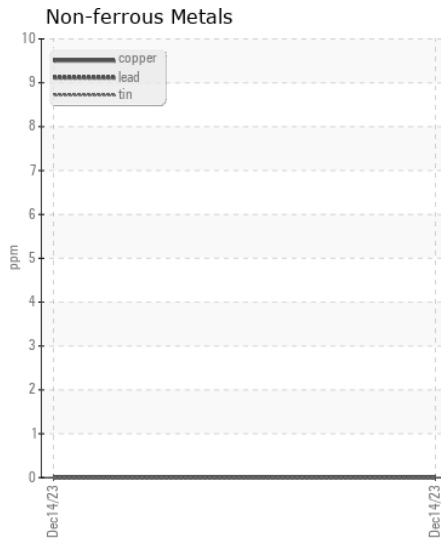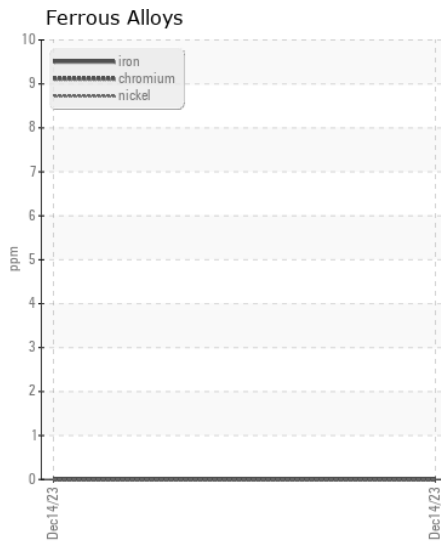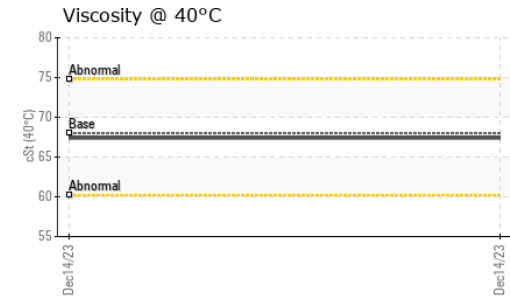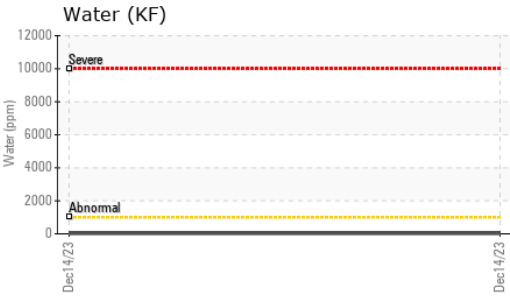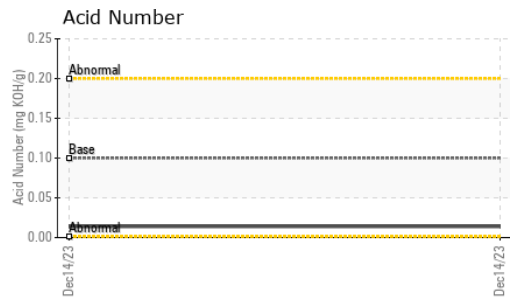

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06044981 **Recieved** : 26 Dec 2023
Lab Number : 06044981 **Diagnosed** : 27 Dec 2023
Unique Number : 10805589 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CLOVERDALE FOODS
 3015 34TH ST NW
 MANDAN, ND
 US 58554

Contact: Jason Hoke
 jasonh@cloverdalefoods.com

T: (701)516-7950

F: x: