



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**Co-Gen - Utilities**  
 Machine Id  
**27-2305 - MILL AC B**  
 Component  
**Air Compressor**  
 Fluid  
**{not provided} (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>PE0001466</b>	PE0001437	---
Sample Date		Client Info		<b>29 Dec 2023</b>	27 Sep 2023	---
Machine Age	hrs	Client Info		<b>0</b>	0	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>N/A</b>	N/A	---
Filter Changed		Client Info		<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

## WEAR

All component wear rates are normal.

PQ		ASTM D8184		<b>15</b>	15	---
Iron	ppm	ASTM D5185m	>50	<b>0</b>	2	---
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m	>40	<b>17</b>	32	---
Tin	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

## CONTAMINATION










The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	---
Water	%	ASTM D6304	>0.6	<b>NEG</b>	NEG	---
Particles >4µm		ASTM D7647	>10000	<b>484</b>	807	---
Particles >6µm		ASTM D7647	>2500	<b>102</b>	217	---
Particles >14µm		ASTM D7647	>320	<b>12</b>	21	---
Particles >21µm		ASTM D7647	>80	<b>4</b>	7	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>16/14/11</b>	17/15/12	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.6	<b>NEG</b>	NEG	---

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>22</b>	25	---
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	3	---
Calcium	ppm	ASTM D5185m		<b>95</b>	103	---
Phosphorus	ppm	ASTM D5185m		<b>217</b>	211	---
Zinc	ppm	ASTM D5185m		<b>1</b>	4	---
Sulfur	ppm	ASTM D5185m		<b>153</b>	312	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.02</b>	1.14	---
Visc @ 40°C	cSt	ASTM D445		<b>26.7</b>	26.5	---

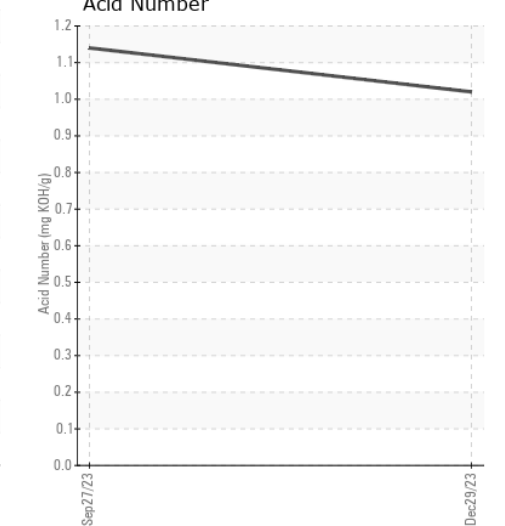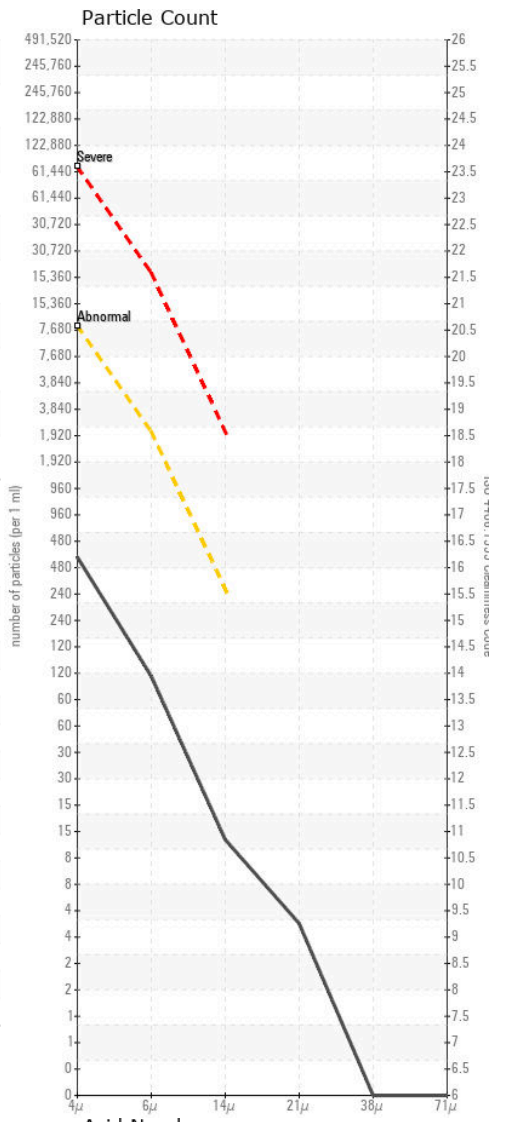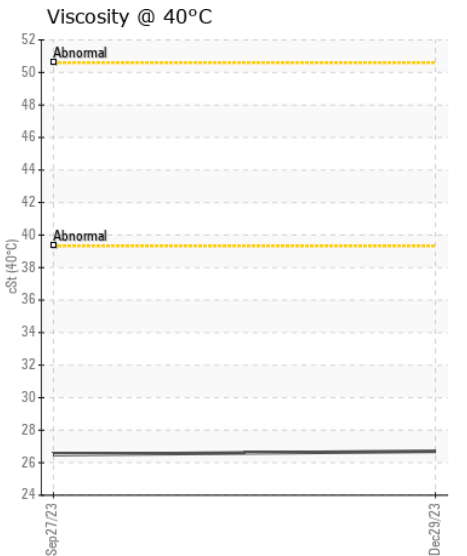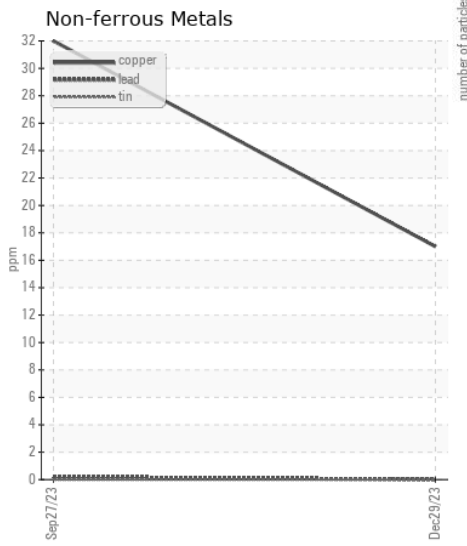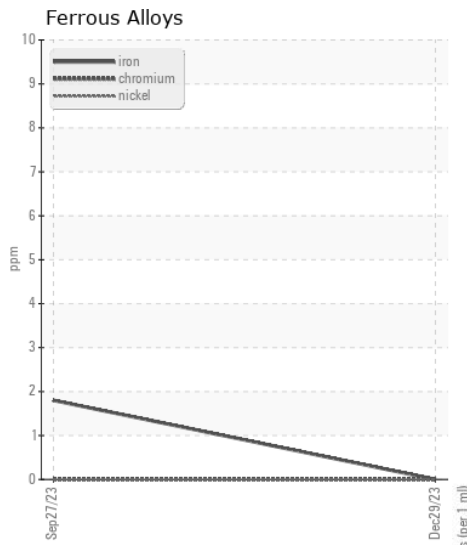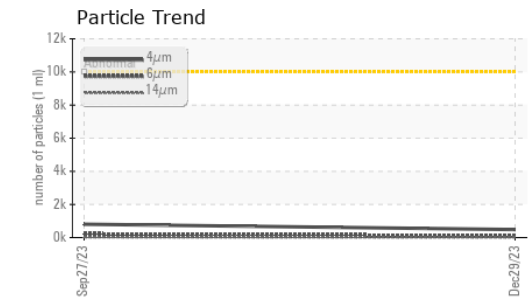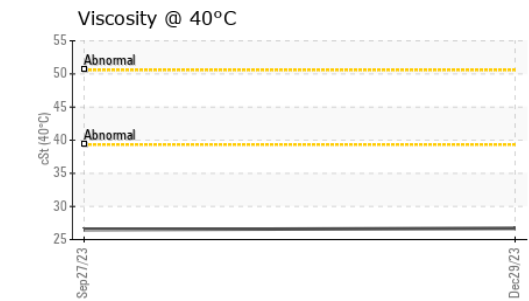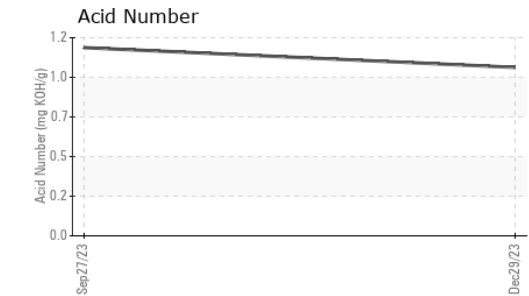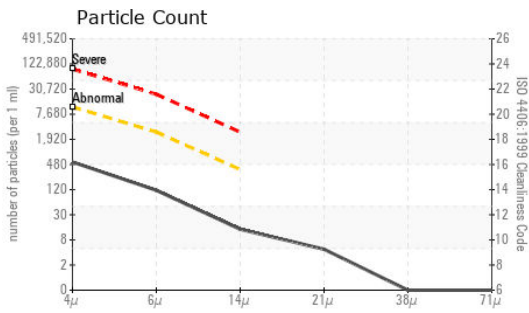

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PE0001466 **Received** : 08 Jan 2024  
**Lab Number** : 06054775 **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10820724 **Diagnostician** : Don Baldrige  
**Test Package** : PLANT ( Additional Tests: ICP, KF, KV40, PQ, PrtCount, SCREEN )

**MCKINLEY PAPER COMPANY**  
 1902 MARINE DR  
 PORT ANGELES, WA  
 US 98363  
 Contact: CHAD GALLAUHER  
 chad.gallauher@biopappel.com  
 T: (360)457-4474  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)