



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**EILEEN BIGELOW**  
Machine Id  
**[EILEEN BIGELOW] 007 588445-7**  
Component  
**Port Genset**  
Fluid  
**CHEVRON DELO 400 LE 15W40 (240 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>MW06055149</b>	MW06055150	MW05980115
Sample Date		Client Info		<b>01 Dec 2023</b>	20 Oct 2023	01 Oct 2023
Machine Age	hrs	Client Info		<b>14035</b>	13604	13203
Oil Age	hrs	Client Info		<b>0</b>	422	24
Filter Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed		Client Info		<b>N/A</b>	N/A	N/A
Filter Changed		Client Info		<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>4</b>	11	4
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>2</b>	2	3
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>3</b>	2	3
Lead	ppm	ASTM D5185m	>17	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m	>70	<b>3</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

**CONTAMINATION**







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>8</b>	8	6
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	<1
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.9</b>	8.8	6.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>21.1</b>	23.0	20.6
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

**FLUID CONDITION**

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	2
Boron	ppm	ASTM D5185m		<b>335</b>	278	323
Barium	ppm	ASTM D5185m		<b>0</b>	0	4
Molybdenum	ppm	ASTM D5185m		<b>114</b>	121	99
Manganese	ppm	ASTM D5185m		<b>1</b>	2	<1
Magnesium	ppm	ASTM D5185m		<b>666</b>	682	568
Calcium	ppm	ASTM D5185m		<b>1761</b>	1889	1595
Phosphorus	ppm	ASTM D5185m	1200	<b>676</b>	654	610
Zinc	ppm	ASTM D5185m	1300	<b>832</b>	850	688
Sulfur	ppm	ASTM D5185m	3200	<b>2933</b>	2737	2225
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>14.1</b>	17.8	14.5
Base Number (BN)	mg KOH/g	ASTM D2896	9.6	<b>9.1</b>	9.0	8.3
Visc @ 100°C	cSt	ASTM D445	15.7	<b>14.1</b>	13.2	13.2

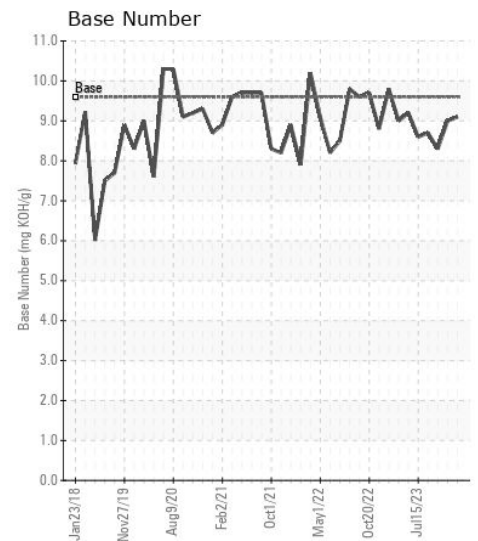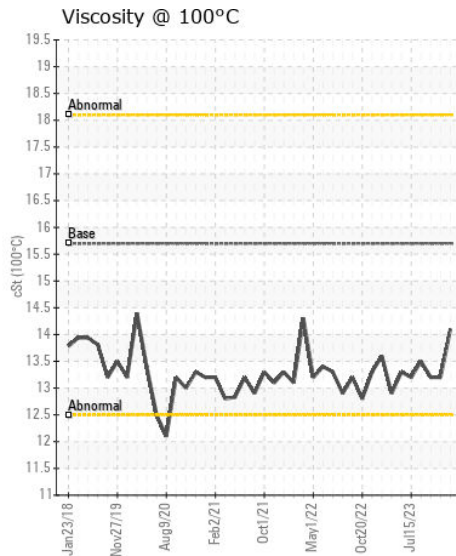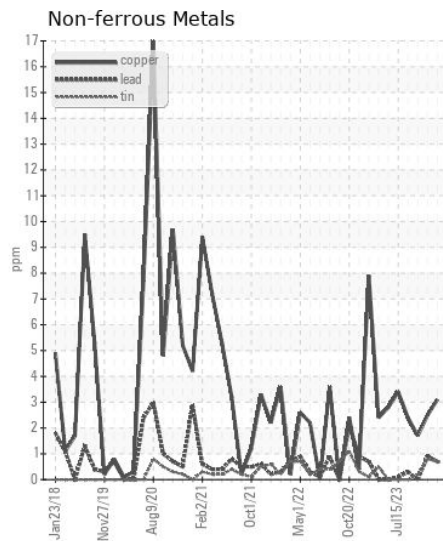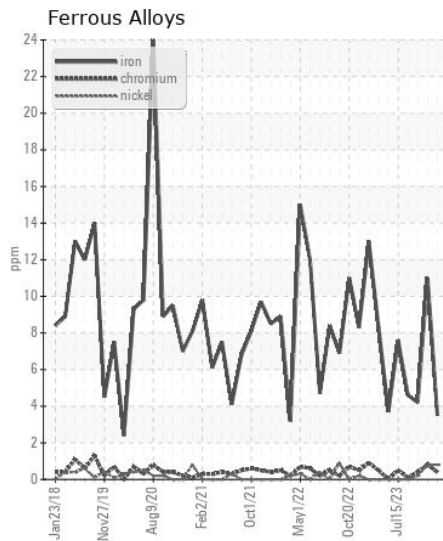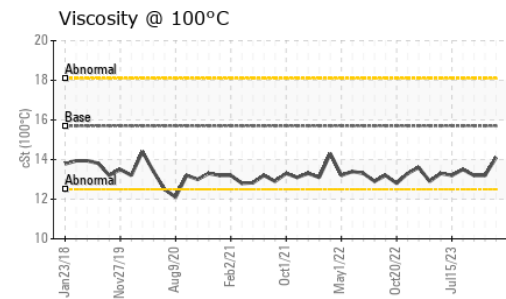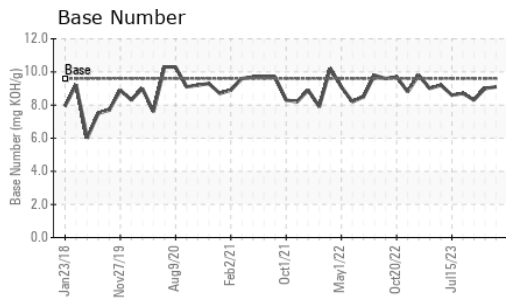

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : MW06055149 **Received** : 09 Jan 2024  
**Lab Number** : 06055149 **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10821098 **Diagnostician** : Wes Davis  
**Test Package** : MAR 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**INGRAM BARGE**  
 900 S 3RD ST  
 PADUCAH, KY  
 US 42003

Contact: TONY HUCKABEE  
 tony.huckabee@ingrambarge.com  
 T: (270)415-4467  
 F: (615)695-3697