
**WEAR** CONTAMINATION **FLUID CONDITION** 

**NORMAL ABNORMAL NORMAL** 

## **MATTEI JK34KN-2018**

Component Compressor

ROTOROIL 8000 (2 QTS)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Number		Client Info		AN25219	AN35559	
	Sample Date		Client Info		13 Dec 2023	27 Jan 2020	
	Machine Age	hrs	Client Info		4012	905	
	Oil Age	hrs	Client Info		0	0	
	Filter Age	hrs	Client Info		0	0	
	Oil Changed		Client Info		Changed	Changed	
	Filter Changed		Client Info		N/A	N/A	
	Sample Status				ABNORMAL	ABNORMAL	
WEAR	Iron	ppm	ASTM D5185m	>50	16	14	
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0	<1	
	Nickel	ppm	ASTM D5185m		0	0	
	Titanium	ppm	ASTM D5185m		0	0	
	Silver	ppm	ASTM D5185m		0	0	
	Aluminum	ppm	ASTM D5185m	>25	1	2	
	Lead	ppm	ASTM D5185m	>25	0	<1	
	Copper	ppm	ASTM D5185m	>50	2	5	
	Tin	ppm	ASTM D5185m	>15	0	<1	
	Vanadium	ppm	ASTM D5185m		0	0	
	White Metal	scalar	*Visual	NONE	LIGHT	VLITE	
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
CONTAMINATION	Silicon		ACTM DE10Em	. 05	A 07	A 202	
Elemental level of silicon (Si) above normal.		ppm	ASTM D5185m		▲ 87 0	<u>4</u> 202	
	Potassium Water	ppm %	ASTM D5185m ASTM D6304	>20	0.038	<1 0.052	
	ppm Water	ppm	ASTM D6304		387	523.2	
	Silt	scalar	*Visual	NONE	NONE	NONE	
	Debris	scalar	*Visual	NONE	LIGHT	NONE	
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
	Appearance	scalar	*Visual	NORML	NORML	NORML	
	Odor	scalar	*Visual	NORML	NORML	NORML	
	<b>Emulsified Water</b>		*Visual	>0.1	NEG	NEG	
FLUID CONDITION	Sodium	ppm	ASTM D5185m		9	13	
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0	<1	
	Barium	ppm	ASTM D5185m		0	0	
	Molybdenum	ppm	ASTM D5185m		0	0	
	Manganese	ppm	ASTM D5185m		0	<1	
	Magnesium	ppm	ASTM D5185m		0	1	
	Calcium	ppm	ASTM D5185m	001	<1	1225	
	Phosphorus Zinc	ppm	ASTM D5185m ASTM D5185m	004	939 66	1335 28	
	Sulfur	ppm	ASTM D5185m		261	28 22	
	Acid Number (AN)	ppm mg KOH/g	ASTM D5165111 ASTM D8045	0.1	0.21	0.148	
	Visc @ 40°C	cSt	ASTM D8045 ASTM D445		88.0		
	VISC @ 40 C	631	A3 11VI D443	07.09	00.0	78.6	

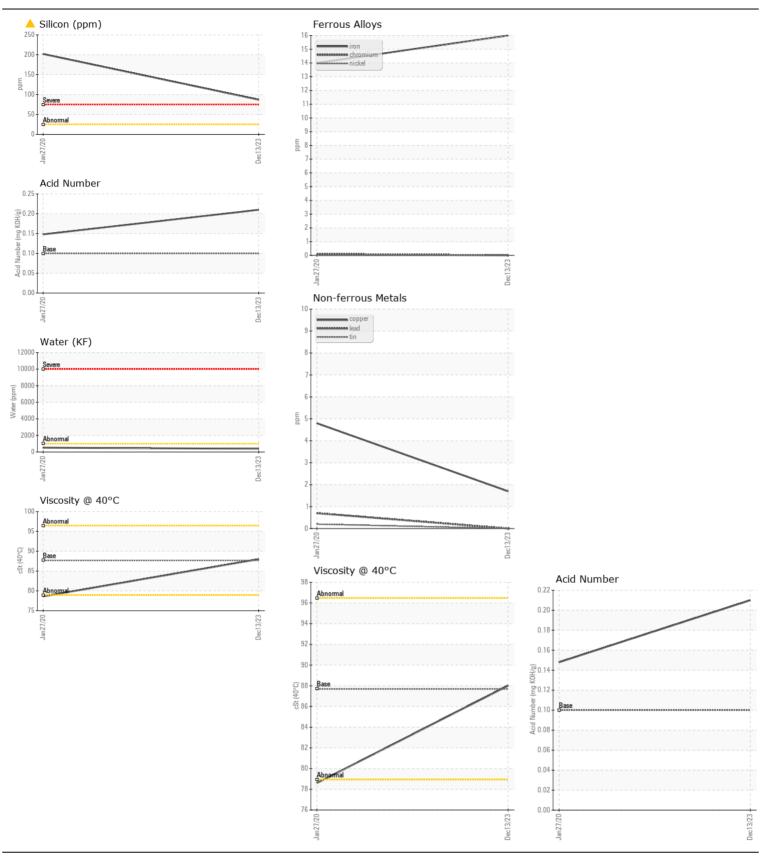





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** 

: AN25219 : 06055935 : 10821884 Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved : 09 Jan 2024 Diagnosed : 11 Jan 2024 : Jonathan Hester Diagnostician

US 21133 Contact: MARTY WARD jward@matteicomp.com T: (410)521-7020

RANDALLSTOWN, MD

MATTEI COMPRESSORS--OEM

9635 LIBERTY ROAD, SUITE E

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (410)521-7024