

WEAR CONTAMINATION FLUID CONDITION

NORMAL NORMAL NORMAL




Area [SV2310120340/1]

YORK MILPORE SIGMA BLD3 CH1 (S/N GFHM127790)

Refrigeration Compressor

YORK TYPE C (15 GAL)							
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		WC0664536		
	Sample Date		Client Info		09 Nov 2023		
	Machine Age	hrs	Client Info		18085		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Filtered		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>8	2		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m	-	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m	>2	0		
	Aluminum	ppm	ASTM D5185m		0		
	Lead	ppm	ASTM D5185m		0		
	Copper	ppm	ASTM D5185m	>8	8		
	Tin	ppm	ASTM D5185m		0		
	Vanadium	ppm	ASTM D5185m		<1		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon		ACTM DE10Em	. 15			
CONTAMINATION		ppm	ASTM D5185m		0		
There is no indication of any contamination in the oil.	Potassium Water	ppm %	ASTM D5185m ASTM D6304	>0.005	0		
	ppm Water		ASTM D6304		0.005 59		
	Silt	ppm scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.005	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m		0		
	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Maganese	ppm	ASTM D5185m		0		
	Magnesium Calcium	ppm	ASTM D5185m ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		0		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		142		
	Acid Number (AN)	mg KOH/g	ASTM D5165111		0.038		
	Visc @ 40°C	cSt	ASTM D974 ASTM D445		58.7		
Report Id: MCQUPP [WUSCAR] 06056773 (Generated: 01/11/2024 13:07:11) Rev: 1	¥100 @ 40 0	301			NDREW TU		

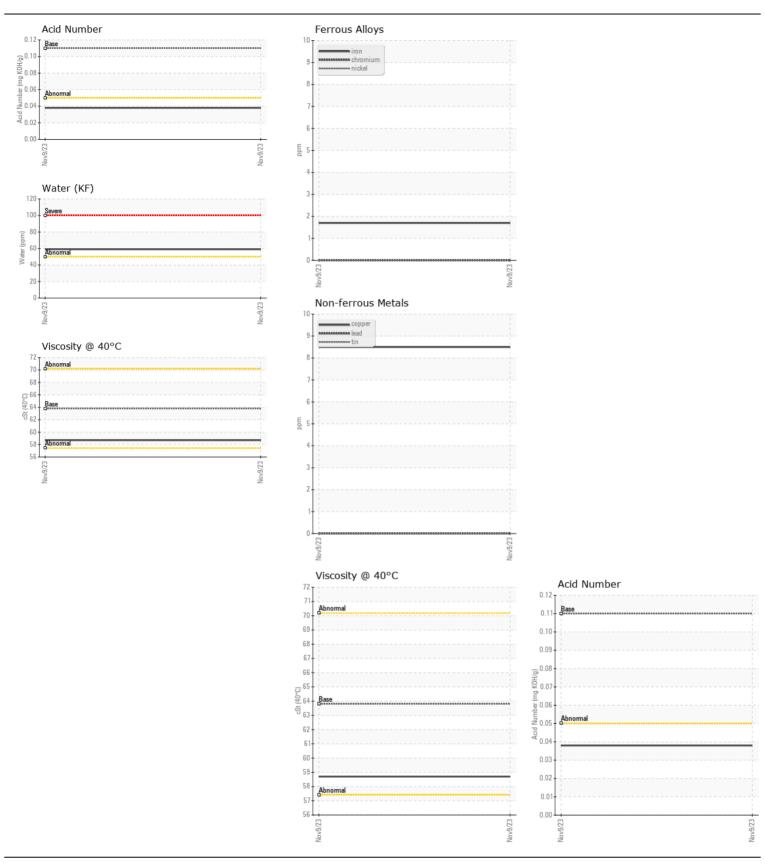





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

Test Package : PLANT

: WC0664536 : 06056773 : 10822722

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Recieved Diagnosed Diagnostician

: 10 Jan 2024 : 11 Jan 2024 : Don Baldridge

DAIKIN APPLIED 5021 HOWERTON WAY SUITE P

BOWIE, MD US 20715

Contact: ANDREW TURLINGTON andrew.turlington@daikinapplied.com

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (301)735-1440 F: (301)735-1838