



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
DURATECH HI
 Machine Id
SULLAIR 201107120017 - CAT/FIRESTONE 1360 BC 90
 Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH06056822	UCH04948108	UCH04922035
Sample Date		Client Info		11 Dec 2023	25 Mar 2020	07 Jan 2020
Machine Age	hrs	Client Info		0	64160	63045
Oil Age	hrs	Client Info		0	794	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	N/A
Filter Changed		Client Info		Changed	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	<1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>25	0	0	2
Copper	ppm	ASTM D5185m	>50	1	<1	6
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<1	<1	2
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	LIGHT	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	0	5
Boron	ppm	ASTM D5185m		3	<1	<1
Barium	ppm	ASTM D5185m		0	0	2
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		228	272	278
Zinc	ppm	ASTM D5185m		4	13	51
Sulfur	ppm	ASTM D5185m		247	147	208
Acid Number (AN)	mg KOH/g	ASTM D8045		0.58	0.507	0.379
Visc @ 40°C	cSt	ASTM D445		46.4	44.1	44.8

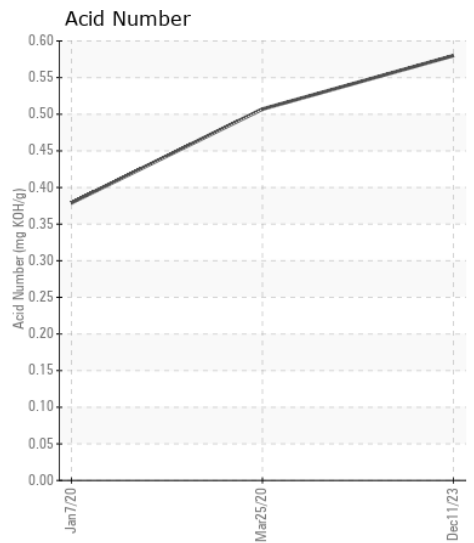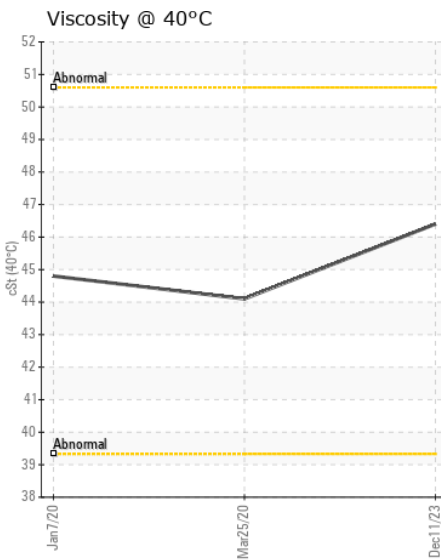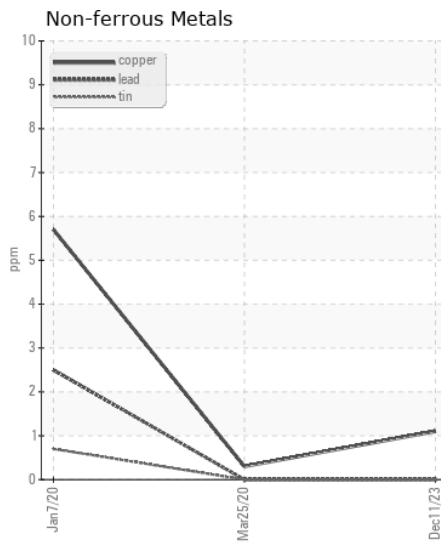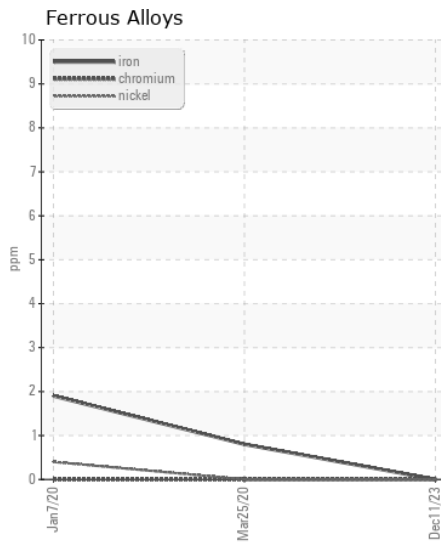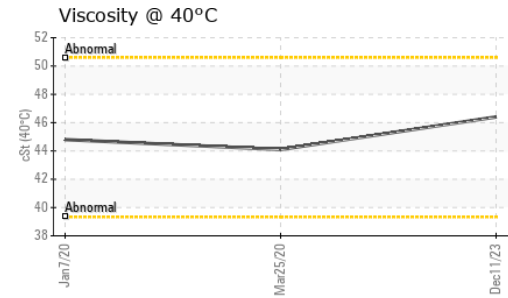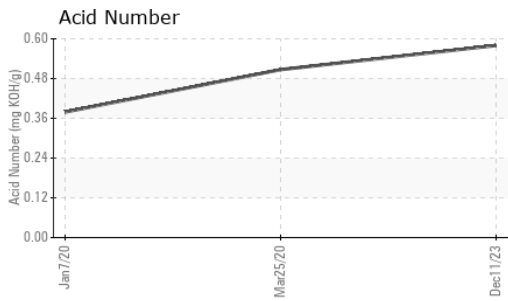

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06056822 **Received** : 10 Jan 2024
Lab Number : 06056822 **Diagnosed** : 11 Jan 2024
Unique Number : 10822771 **Diagnostician** : Don Baldrige
Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HTE TECHNOLOGIES
 2021 CONGRESSIONAL DR
 ST LOUIS, MO
 US 63146
 Contact: JOSH DYRLAND
 josh.dyrland@htetech.com
 T: (314)731-4444
 F: (314)731-4424