



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id  
**SHELL TELLUS VX 46**

Component  
**Tank New (Unused) Oil**

Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

This is a baseline read-out on the submitted sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>DC0023805</b>	---	---
Sample Date		Client Info		<b>15 Nov 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Filter Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed		Client Info		<b>N/A</b>	---	---
Filter Changed		Client Info		<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

**WEAR**











Iron	ppm	ASTM D5185m		<b>0</b>	---	---
Chromium	ppm	ASTM D5185m		<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m		<b>1</b>	---	---
Copper	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m		<b>1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---

**CONTAMINATION**

Silicon	ppm	ASTM D5185m		<b>1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Water		WC Method		<b>NEG</b>	---	---
Particles >4µm		ASTM D7647	>5000	<b>4696</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>822</b>	---	---
Particles >14µm		ASTM D7647	>160	<b>32</b>	---	---
Particles >21µm		ASTM D7647	>40	<b>10</b>	---	---
Particles >38µm		ASTM D7647	>10	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>19/17/12</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual		<b>NEG</b>	---	---

**FLUID CONDITION**

Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>56</b>	---	---
Calcium	ppm	ASTM D5185m		<b>141</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>319</b>	---	---
Zinc	ppm	ASTM D5185m		<b>383</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>944</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.37</b>	---	---
Visc @ 40°C	cSt	ASTM D445		<b>48.15</b>	---	---
Visc @ 100°C	cSt	ASTM D445		<b>8.18</b>	---	---
Viscosity Index (VI)	Scale	ASTM D2270		<b>143</b>	---	---

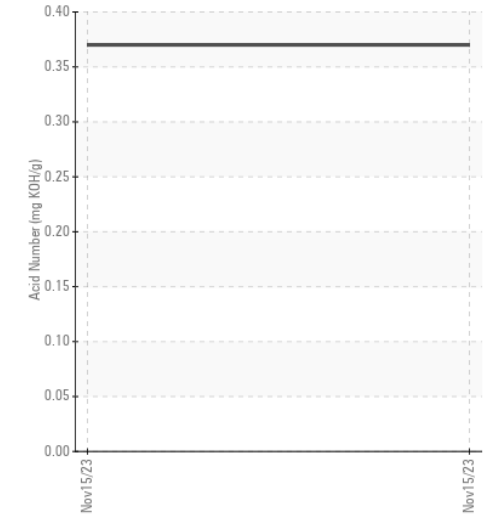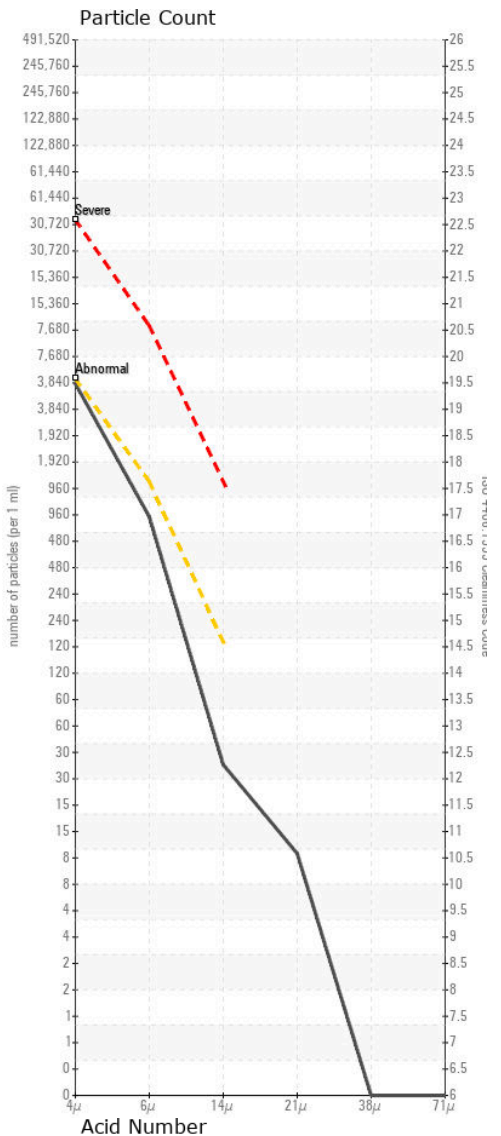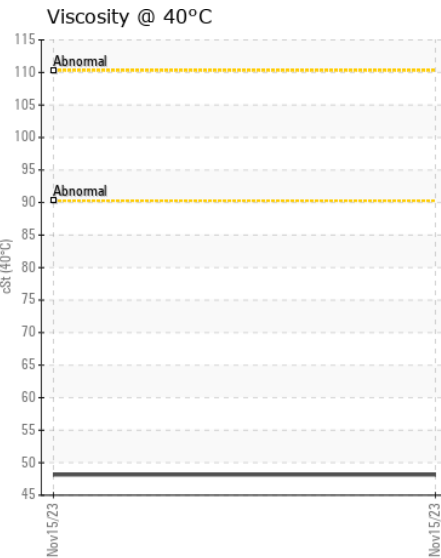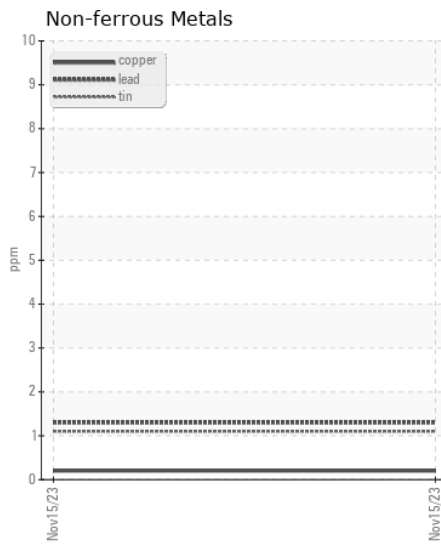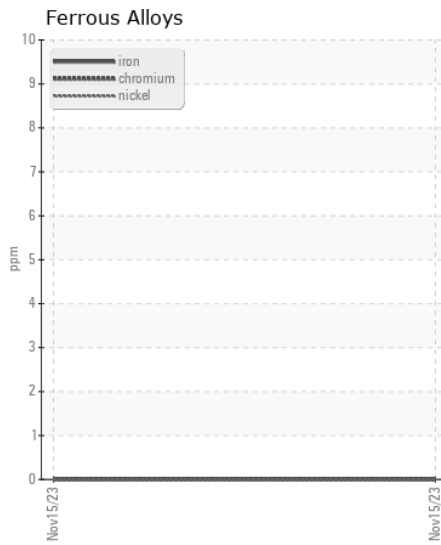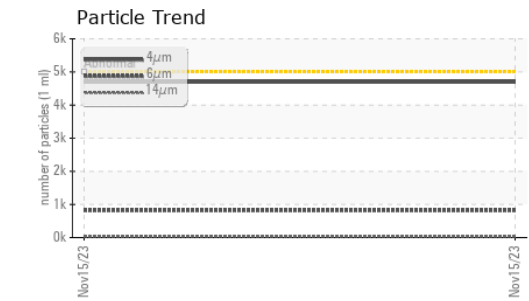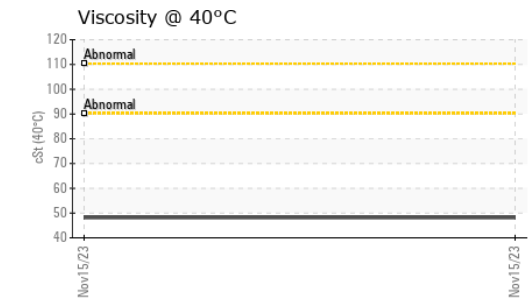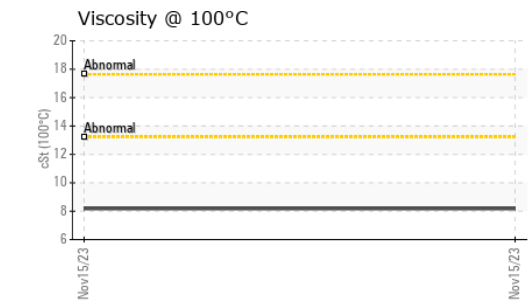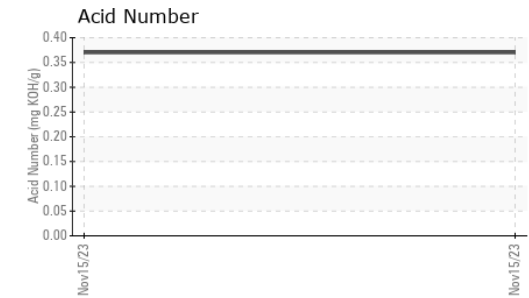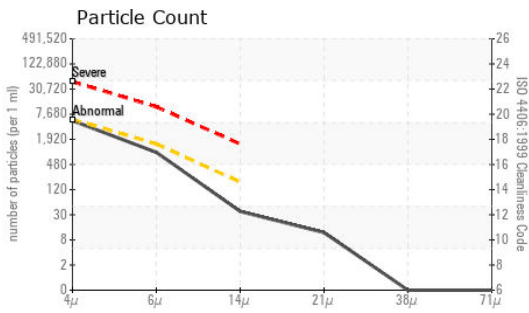

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0023805 **Received** : 10 Jan 2024  
**Lab Number** : 06057100 **Diagnosed** : 15 Jan 2024  
**Unique Number** : 10823049 **Diagnostician** : Doug Bogart  
**Test Package** : MOB 2 ( Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI )

**EQR - ENVIRONMENTAL QUALITY RESOURCES LLC**  
 1 CHURCHVIEW RD  
 MILLERSVILLE, MD  
 US 21108  
 Contact: PENNY TWIGG  
 ptwigg@eqri.com  
 T: (443)805-0761  
 F: (443)304-3315

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)