



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
[PMOAS2537218]
 Machine Id
SD100 3001236197 - ENBRIDGE POWER
 Component
Coolant
 Fluid
HYBRID (HOAT) COOLANT (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0023236	DC0021273	DC0010281
Sample Date		Client Info		14 Dec 2023	15 Nov 2022	13 Oct 2021
Machine Age	hrs	Client Info		282	234	164
Oil Age	hrs	Client Info		48	67	0
Oil Changed		Client Info		N/A	Changed	Not Changed
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				579.0	57.5	480.0
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Specific Gravity		*ASTM D1298		1.068	1.068	---
pH	Scale 0-14	ASTM D1287		7.57	7.91	7.57
Nitrites	ppm	AP-053:2009		900	824	900
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		50.2	50.8	50
Freezing Point	°F	ASTM D3321		-35	-35	-38
Carboxylate				n/a	n/a	n/a
Coolant Color		*Visual		Yllow	Yllow	Yllow

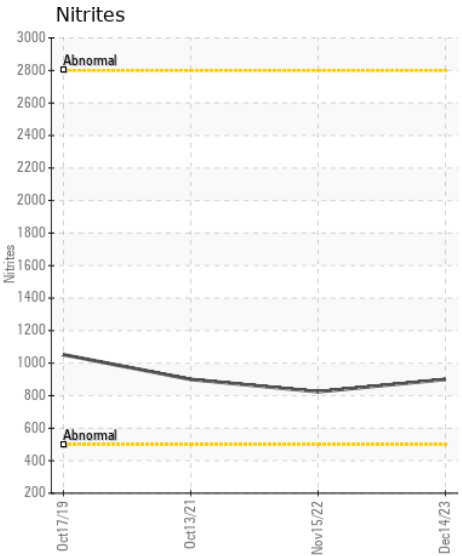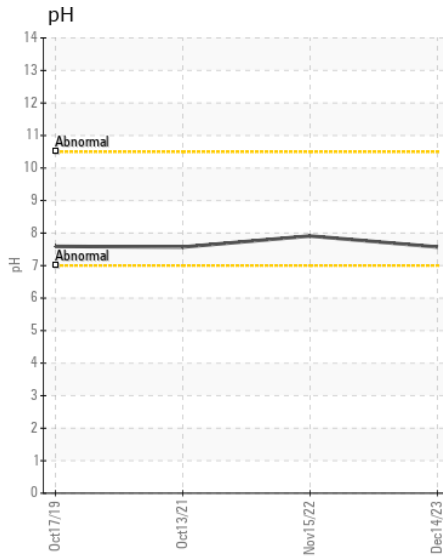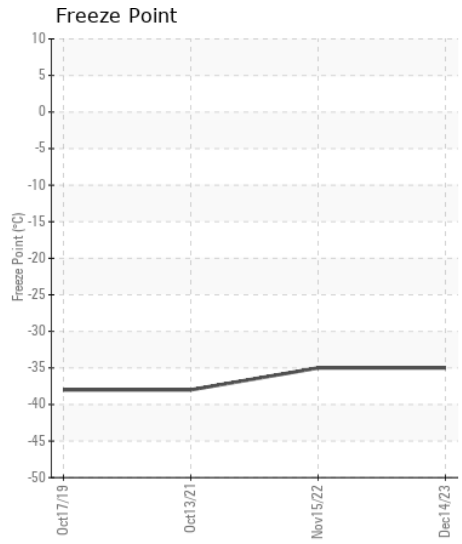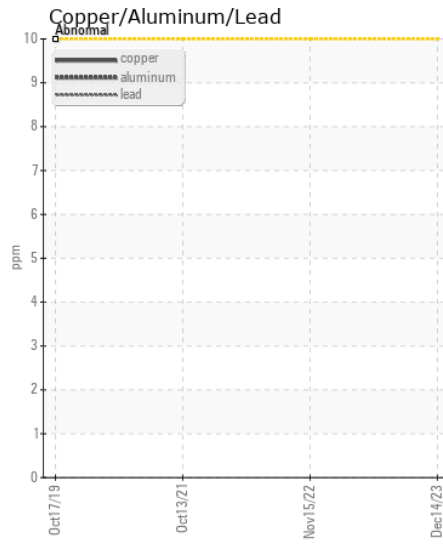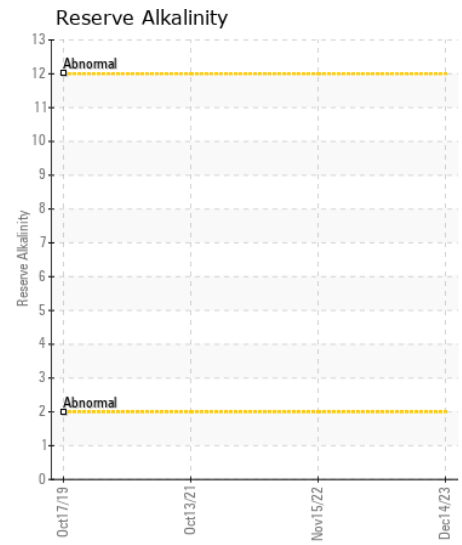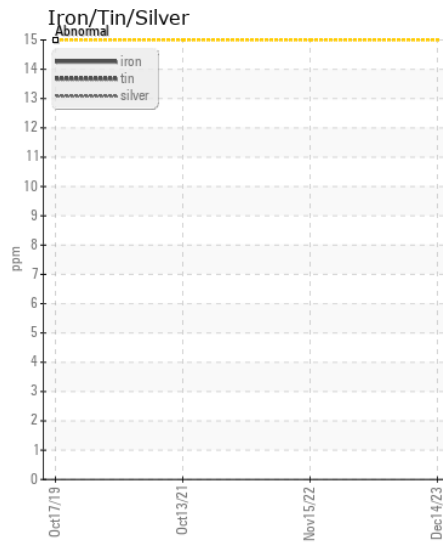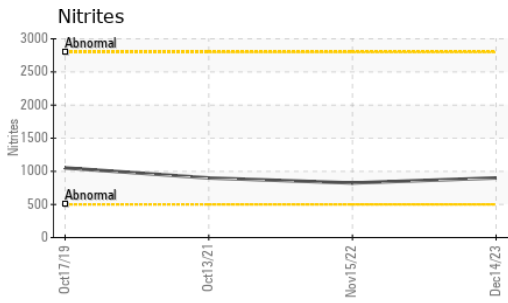

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0023236 **Received** : 10 Jan 2024
Lab Number : 06057119 **Diagnosed** : 12 Jan 2024
Unique Number : 10823068 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)