



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Machine Id
60530
 Component
Coolant
 Fluid
EXTENDED LIFE COOLANT (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0032993	DC0024321	DC0025136
Sample Date		Client Info		29 Dec 2023	11 Nov 2022	10 Nov 2022
Machine Age	hrs	Client Info		14090	13741	13717
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	Not Chngd
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				639.0	619.0	633.5
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Specific Gravity		*ASTM D1298		1.069	1.068	1.068
pH	Scale 0-14	ASTM D1287		8.65	8.66	8.68
Nitrites	ppm	AP-053:2009		2328	NT	NT
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		51.1	50.6	50.5
Freezing Point	°F	ASTM D3321		-38	-35	-35
Carboxylate				fail	fail	fail
Coolant Color		*Visual		Red	Red	Orange

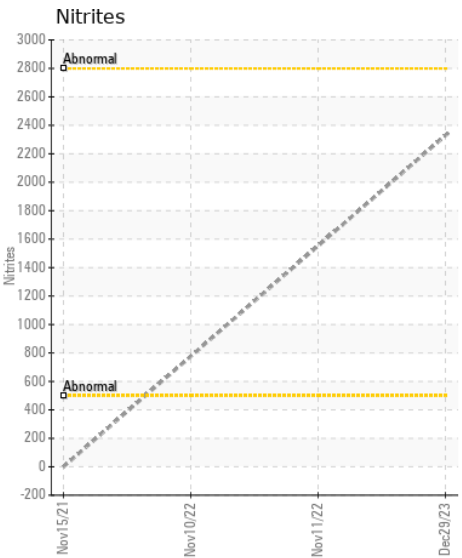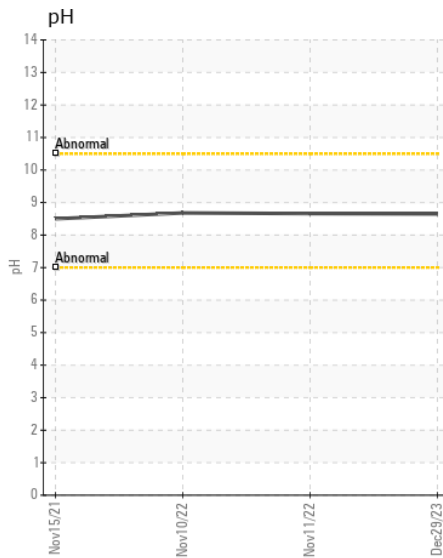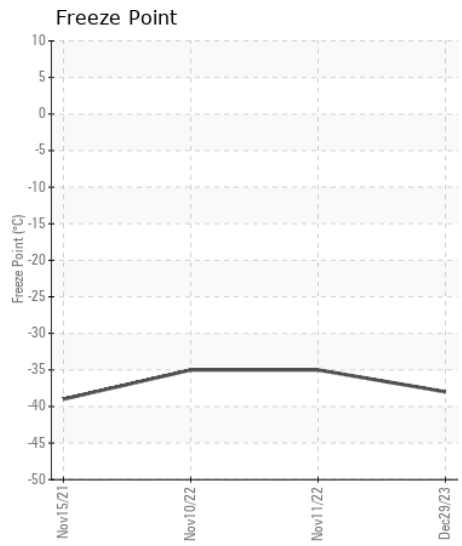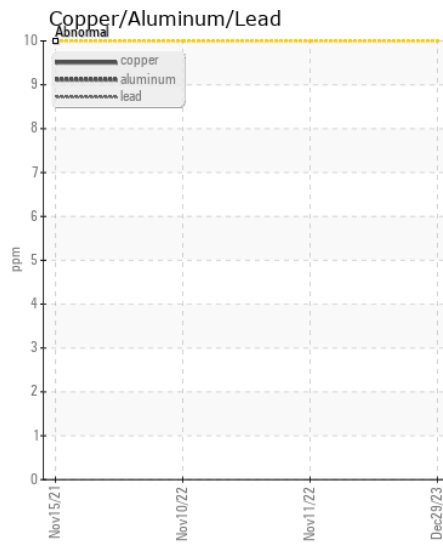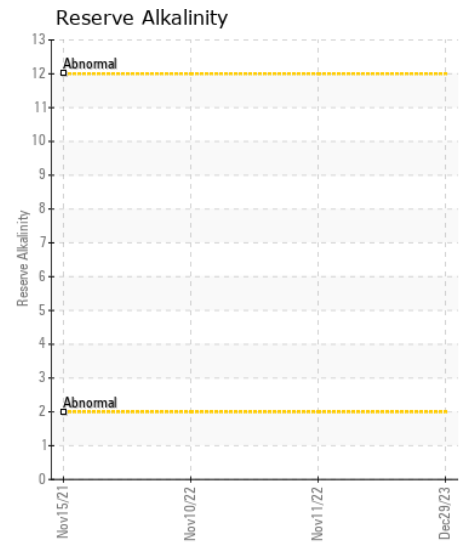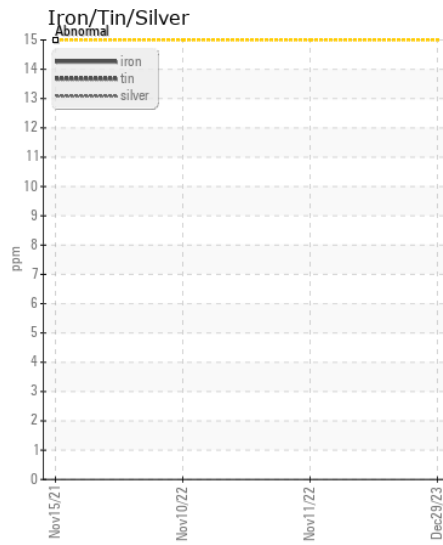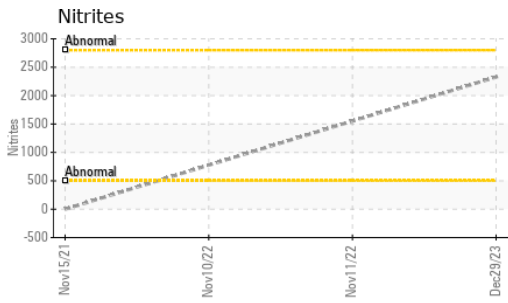

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0032993 **Received** : 10 Jan 2024
Lab Number : 06057131 **Diagnosed** : 12 Jan 2024
Unique Number : 10823080 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL)

FRANCIS O DAY
 14900 SOUTHLAWN LN
 ROCKVILLE, MD
 US 20850
 Contact: JAMIE FORESTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: