



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Machine Id
41880
 Component
Coolant
 Fluid
EXTENDED LIFE COOLANT (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0032885	DC0022144	DC0019348
Sample Date		Client Info		20 Dec 2023	20 Dec 2022	15 Mar 2022
Machine Age	hrs	Client Info		8591	0	8497
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				360.0	308.5	657.5
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Specific Gravity		*ASTM D1298		1.067	1.067	1.067
pH	Scale 0-14	ASTM D1287		7.95	61.7	7.96
Nitrites	ppm	AP-053:2009		NT	0	NT
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		49.3	49.2	49.2
Freezing Point	°F	ASTM D3321		-33	-33	-33
Carboxylate				fail	pass	pass
Coolant Color		*Visual		Red	Red	Red

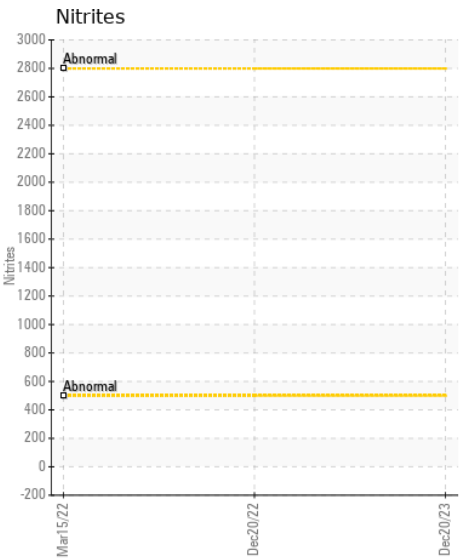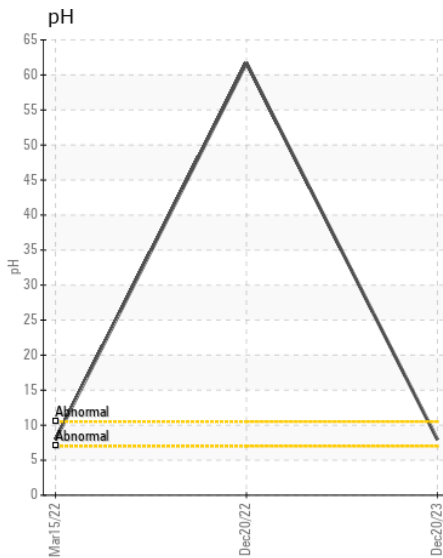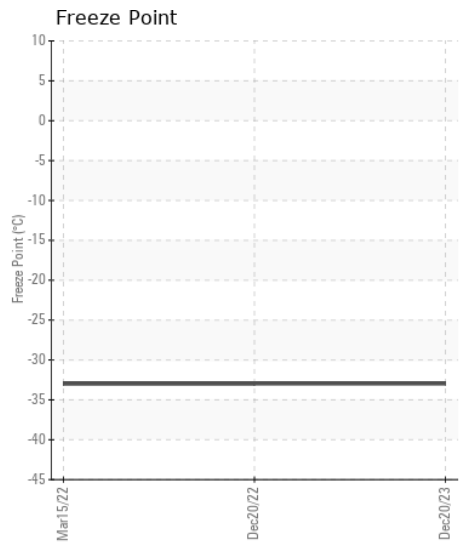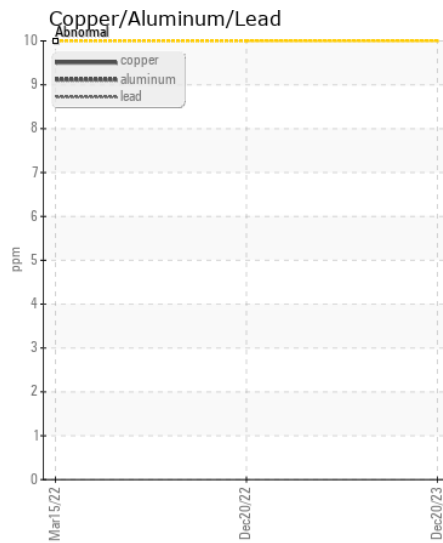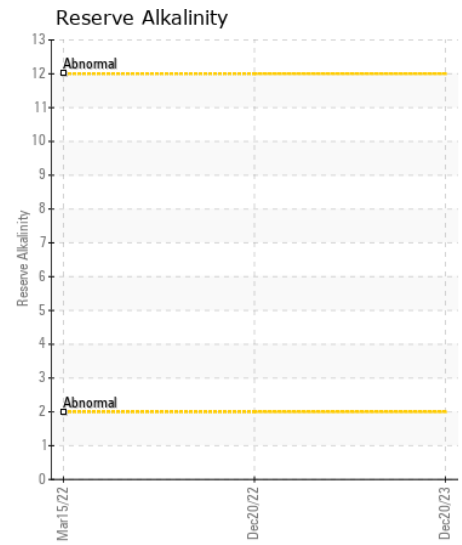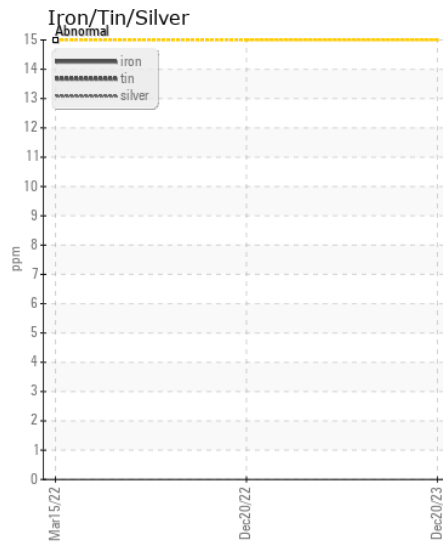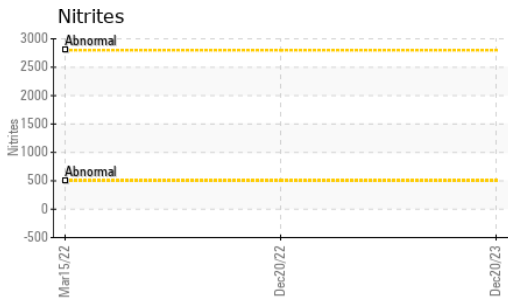

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0032885 **Received** : 10 Jan 2024
Lab Number : 06057168 **Diagnosed** : 12 Jan 2024
Unique Number : 10823117 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL)

FRANCIS O DAY
 14900 SOUTHLAWN LN
 ROCKVILLE, MD
 US 20850
 Contact: JAMIE FORESTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: