



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
CACO
 Component
Pump
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PCA0110391	---	---
Sample Date		Client Info		10 Jan 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>90	14	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m	>3	0	---	---
Silver	ppm	ASTM D5185m	>3	0	---	---
Aluminum	ppm	ASTM D5185m	>7	2	---	---
Lead	ppm	ASTM D5185m	>12	0	---	---
Copper	ppm	ASTM D5185m	>30	<1	---	---
Tin	ppm	ASTM D5185m	>9	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>60	0	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water		WC Method	>.1	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>.1	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	---	---
Boron	ppm	ASTM D5185m		6	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		7	---	---
Phosphorus	ppm	ASTM D5185m		120	---	---
Zinc	ppm	ASTM D5185m		13	---	---
Sulfur	ppm	ASTM D5185m		2717	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.69	---	---
Visc @ 40°C	cSt	ASTM D445		212	---	---

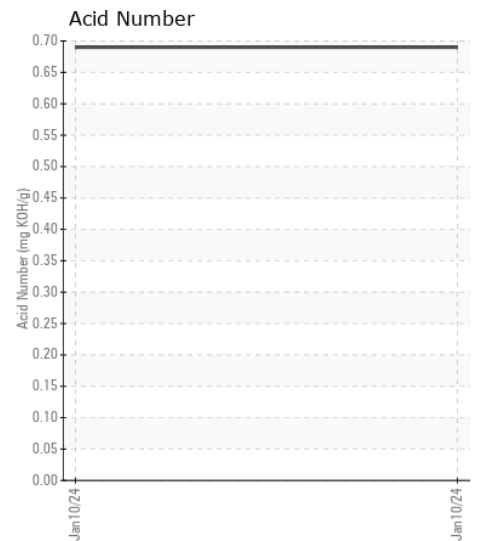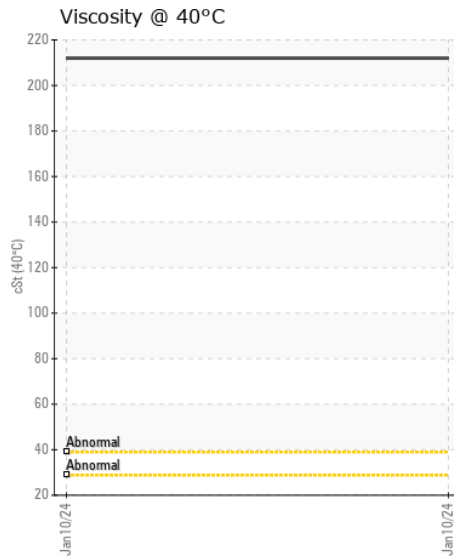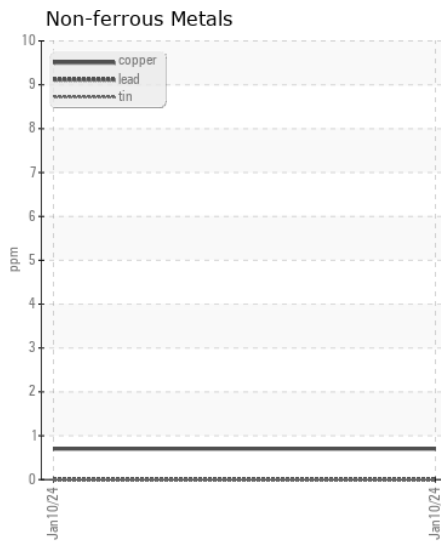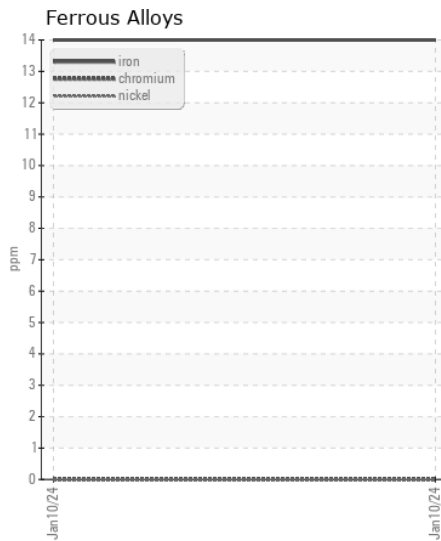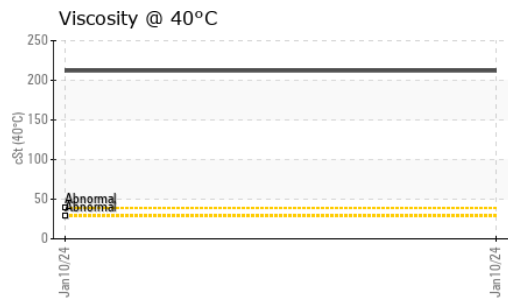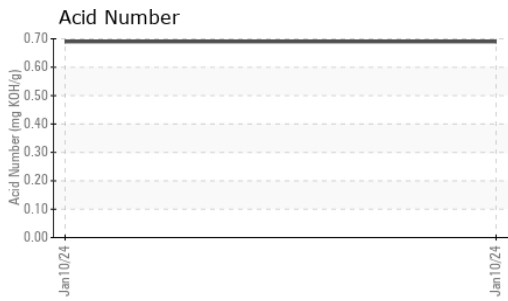

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0110391 **Recieved** : 11 Jan 2024
Lab Number : 06058262 **Diagnosed** : 14 Jan 2024
Unique Number : 10829644 **Diagnostician** : Don Baldrige
Test Package : IND 2

CERTAINTED CORP
 200 RONTHOR DR
 SOCIAL CIRCLE, GA
 US 30025

Contact: MARK KIRKPATRICK
 MARK.W.KIRKPATRICK@SAINT-GOBAIN.COM

T:
 F: (770)464-0878

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)